
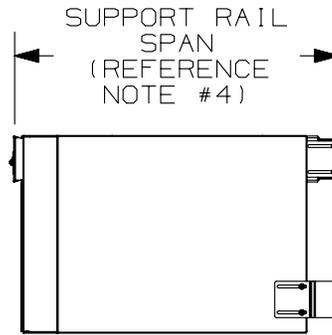
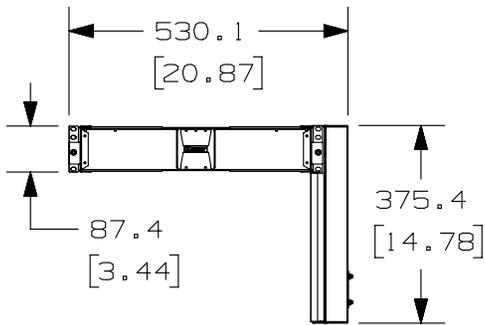
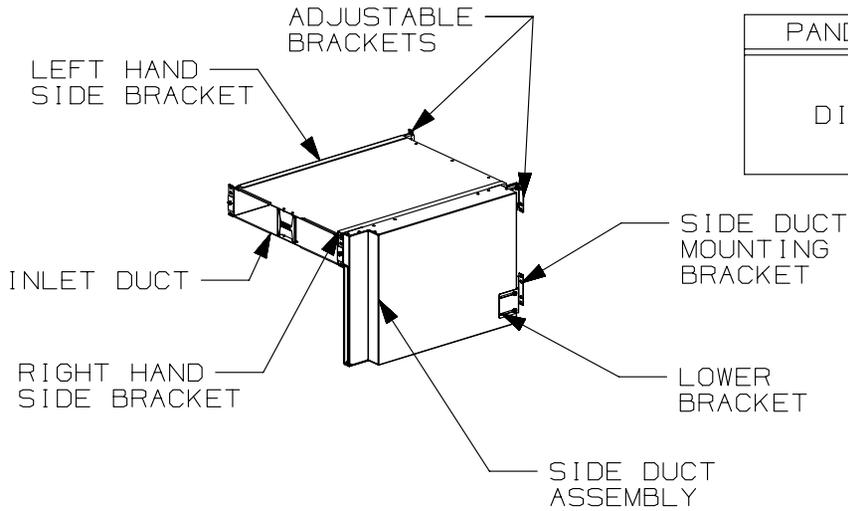


THIS COPY IS PROVIDED ON A RESTRICTED BASIS AND IS NOT TO BE USED IN ANY WAY DETRIMENTAL TO THE INTERESTS OF PANDUIT CORP.

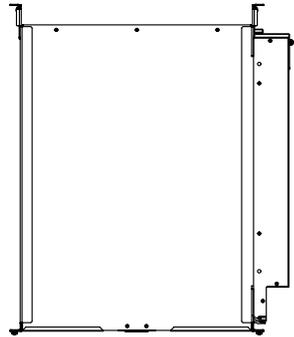

PANDUIT PART NO.	WEIGHT
DIRBB2007S21W	25.41 LBS (11.53 kg)

FOR USE WITH PANDUIT NET-ACCESS SWITCH CABINETES (N\*\* OR CN\*\*)



**NOTES:**

- VISIT OUR CATALOG ONLINE AT WWW.PANDUIT.COM FOR A LIST OF CURRENT PARTS APPLICABLE FOR USE WITH THIS PRODUCT.
- PARTS SUPPLIED:
  - 1 - SIDE DUCT ASSEMBLY
  - 1 - INLET DUCT
  - 2 - ADJUSTABLE BRACKETS
  - 1 - LEFT HAND SIDE BRACKET
  - 1 - RIGHT HAND SIDE BRACKET
  - 1 - LOWER BRACKET
  - 1 - SIDE DUCT MOUNTING BRACKET
  - 1 - HARDWARE KIT
- DIMENSIONS IN PARENTHESES ARE IN INCHES.
- ADJUSTABLE SUPPORT RAIL SPECIFICATIONS:  
RANGE: 615.9mm-663.6mm [ 24.25"-26.12" ]

TITLE		INLET DUCT FOR CISCO 7004 (DIRBB2007S21W) CUSTOMER DRAWING	
ITEM REVISION NAME		12V338AC/00	
DATASET FILE NAME		12V338AC_DC/00A	
MATERIAL:		N/A	
DRAWING NUMBER:		12V338AC	
DRAWN BY	DATE	CHK	SCALE
PJST	02/05/13		N/A
SHT 1 OF 3		A	

REV	DATE	BY	CHK	APR	DESCRIPTION	ECN
00	02/05/13	PJST			RELEASED TO PRODUCTION	12V338AC

THIS COPY IS PROVIDED ON A RESTRICTED BASIS AND IS NOT TO BE USED IN ANY WAY DETRIMENTAL TO THE INTERESTS OF PANDUIT CORP.

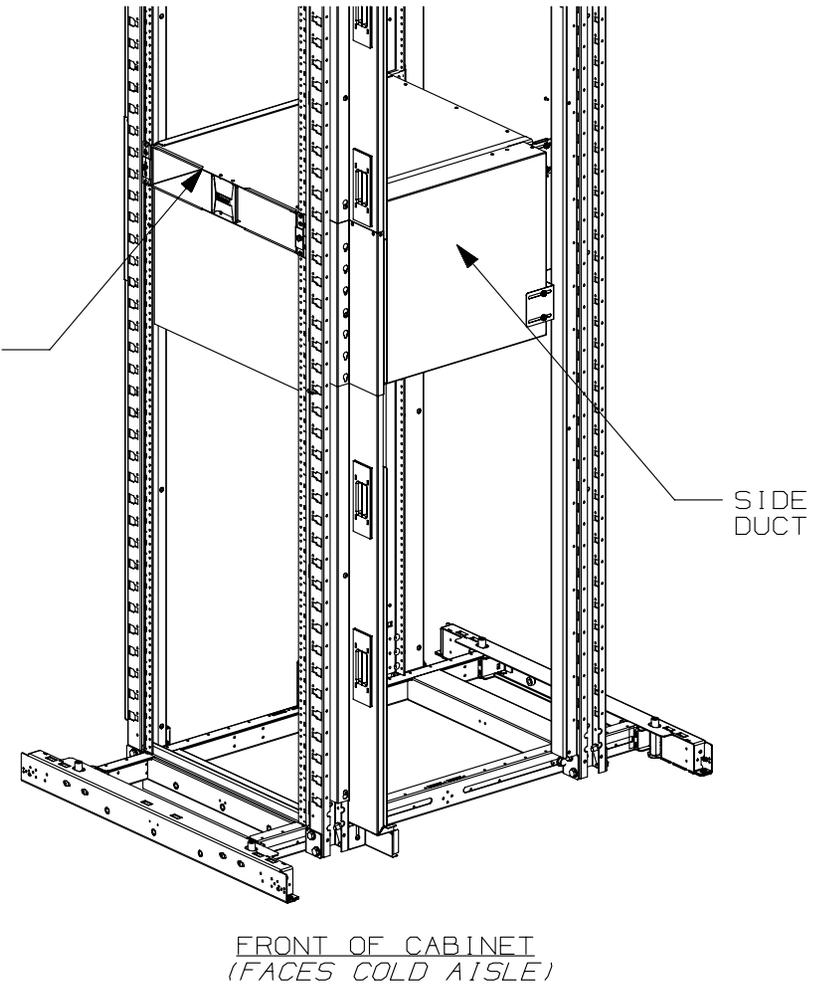
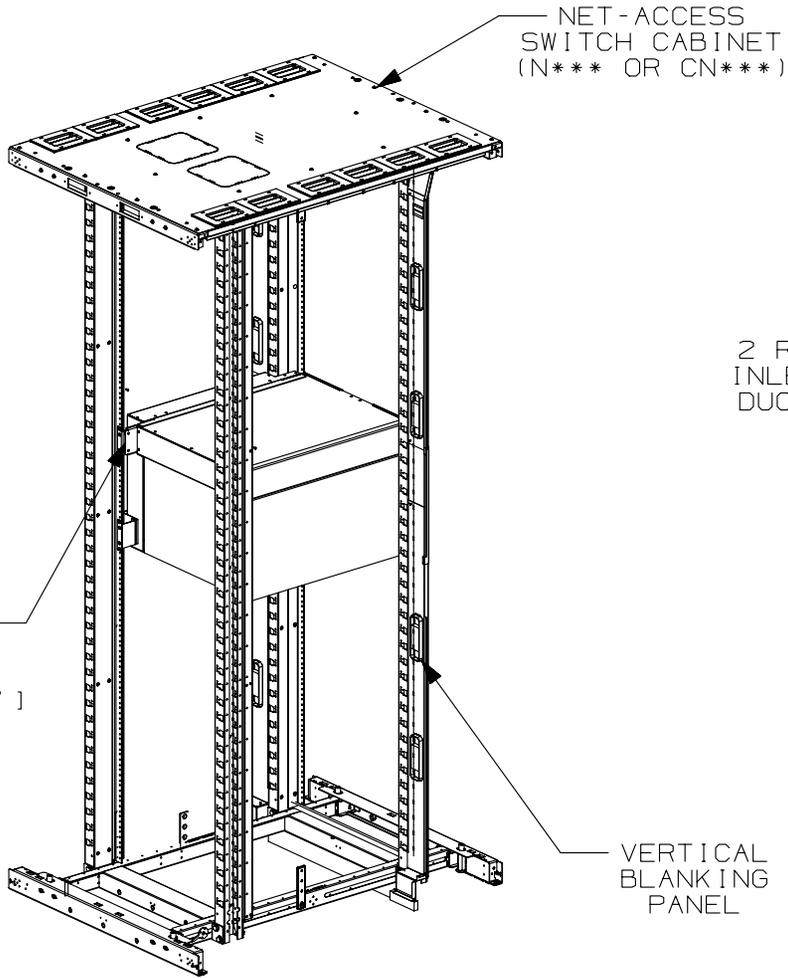


1. VERTICAL BLANKING PANELS MUST BE USED WITH THIS PRODUCT TO PREVENT EXHAUST RECIRCULATION.

00	02/05/13	PJST			RELEASED TO PRODUCTION	12V338AC
REV	DATE	BY	CHK	APR	DESCRIPTION	ECN

TITLE						INLET DUCT FOR CISCO 7004 (DIRBB2007S21W)		CUSTOMER DRAWING	
ITEM REVISION NAME						12V338AC/00		PANDUIT™	
DATASET FILE NAME						12V338AC_DC/00A		MATERIAL:	
								N/A	
								DRAWING NUMBER:	
								12V338AC	
DRAWN BY		DATE		CHK		SCALE		SIZE	
PJST		02/05/13				N/A		SHT 2 OF 3	

THIS COPY IS PROVIDED ON A RESTRICTED BASIS AND IS NOT TO BE USED IN ANY WAY DETRIMENTAL TO THE INTERESTS OF PANDUIT CORP.

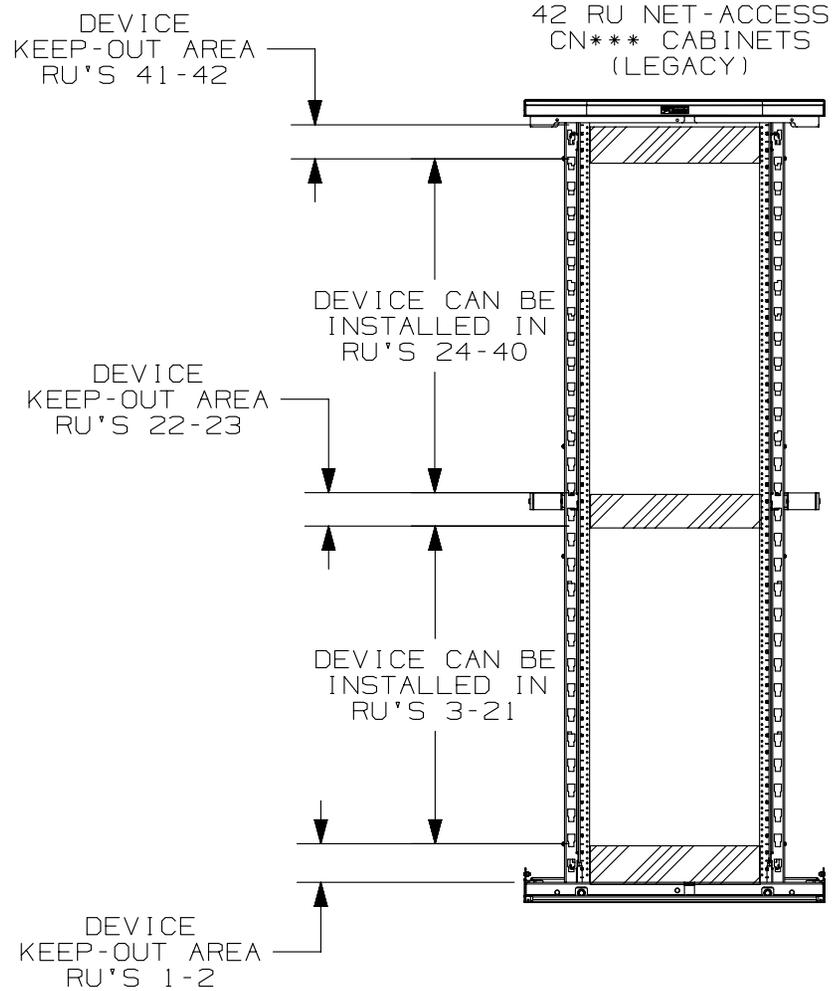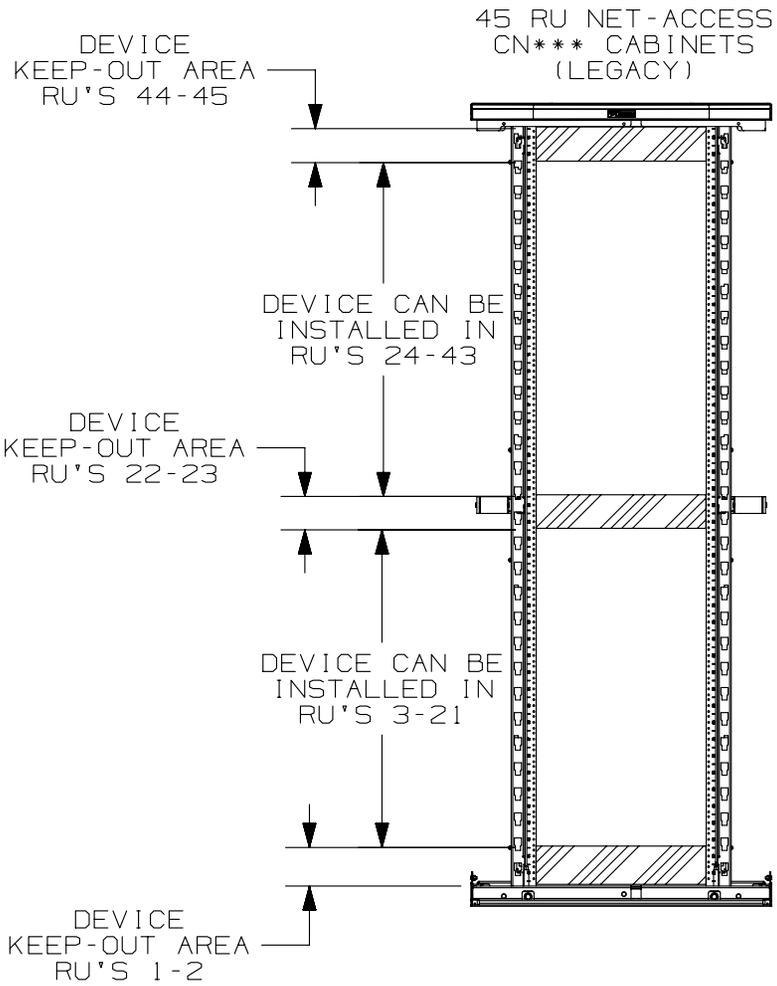

NOTES:

1. DUE TO PHYSICAL CONSTRAINTS POSED BY FRONT-TO-BACK FRAME BEAMS ON THE LEGACY NET-ACCESS CABINET, THERE ARE CERTAIN AREAS OF THE CABINET THAT THE DEVICE CANNOT BE MOUNTED WHEN USED IN CONJUNCTION WITH THIS INLET DUCT.

2. FOR NEW NET-ACCESS (N\*\*\*) CABINETS, THERE ARE NO DEVICE KEEP OUT AREAS. THE ONLY RESTRICTION ON THE SWITCH PLACEMENT IS THAT 2 RU MUST BE LEFT OPEN ABOVE THE SWITCH.

00	02/05/13	PJST			RELEASED TO PRODUCTION	12V338AC
REV	DATE	BY	CHK	APR	DESCRIPTION	ECN

TITLE							INLET DUCT FOR CISCO 7004 (DIRBB2007S21W) CUSTOMER DRAWING		
ITEM REVISION NAME							12V338AC/00		
DATASET FILE NAME							12V338AC_DC/00A		
MATERIAL:							N/A		
DRAWING NUMBER:							12V338AC		
DRAWN BY	DATE	CHK	SCALE				SHT 3 OF 3	SIZE	
PJST	02/05/13		N/A					A	