

Product Environmental Profile

Altivar Soft Starter ATS490 410A






General information

Reference product	Altivar Soft Starter ATS490 410A 208 to 690V AC control supply 110 to 230V AC - ATS490C41Y
Description of the product	The main function of the Altivar Soft Starter product range is primarily to intend for the soft starting and breaking of the rotational speed of an asynchronous electric motor for heavy duty industry and pumps.
Description of the range	Single product
Functional unit	The aim of soft starter is to drive an asynchronous motor (squirrel cage) by limitation of the current during acceleration and deceleration phase with a torque control. It's based on three phases dimmer with Silicon controlled rectifier (thyristor). The rating of softstarter is given by nominal current 410A in the case study which lead to drive several power motor depending of power network voltage ie 230V power motor of 110kW and 690V power motor of 400kW. Calculation of the environmental impacts is based on 10 years of product service lifetime. The usage profile taken into account is 2,16% uptime in active phase, 47,84% uptime in stand by phase and 50% in control phase.



Constituent materials

Reference product mass	23,56 kg including the product, its packaging, additional elements and accessories
------------------------	--

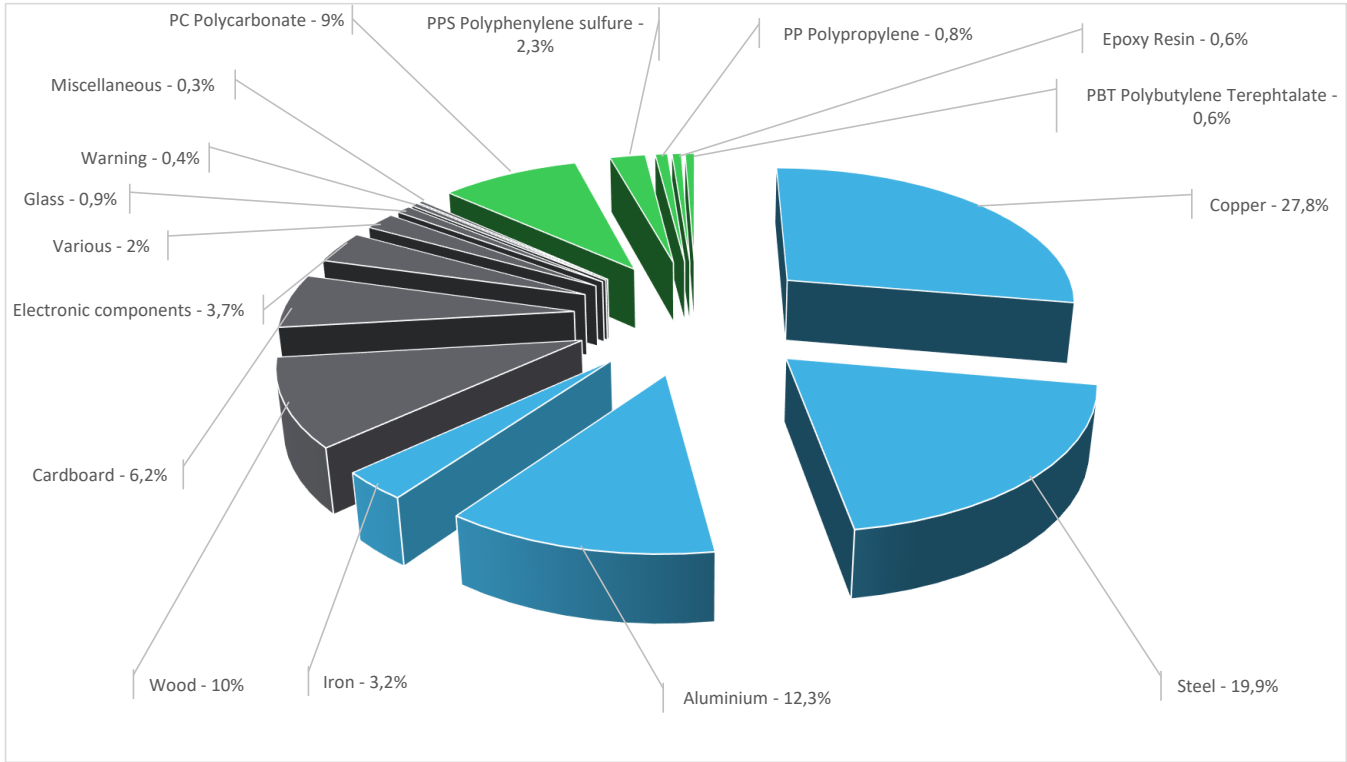

Plastics	13,30%
Metals	63,20%
Others	23,50%



Substance assessment

Details of ROHS and REACH substances information are available on the Schneider-Electric Green Premium website
<https://www.se.com/ww/en/work/support/green-premium/>



Additional environmental information

End Of Life	Recyclability potential:	92%	The recyclability rate was calculated from the recycling rates of each material making up the product based on REEECYLAB tool developed by Ecosystem, for components/materials not covered by the tool, data from the EIME database and the related PSR was taken. If no data was found a conservative assumption was used (0% recyclability).
-------------	--------------------------	-----	--



Environmental impacts

Reference service life time	10 years
Product category	Other equipments - Active product
Life cycle of the product	The manufacturing, the distribution, the installation, the use and the end of life were taken into consideration in this study
Electricity consumption	The electricity consumed during manufacturing processes is considered for each part of the product individually, the final assembly generates a negligible consumption.
Installation elements	The product does not require any installation operations.
Use scenario	The product is in active phase 2,16% of the time with a power use of 151,5 W, in stand-by phase 47,84% of the time with a power use of 134,8 W and in control phase 50% of the time with a power use of 34,5 W, for 10 years.
Time representativeness	The collected data are representative of the year 2024
Technological representativeness	The Modules of Technologies such as material production, manufacturing process and transport technology used in this PEP analysis (LCA EIME in this case) are similar and representative of the actual type of technologies used to make the product.
Final assembly site	Batam Indonesia
Geographical representativeness	Europe
Energy model used	[A1 - A3]
	Electricity Mix; Low voltage; 2022; Indonesia, ID (A1-A3) 2020; China, CN (A1-A2) 2018; Europe, EU-27 (A1-A2)
	[A5]
	Electricity Mix; Low voltage; 2018; Europe, EU-27
	[B6]
	Electricity Mix; Low voltage; 2018; Europe, EU-27
	[C1 - C4]
	Electricity Mix; Low voltage; 2018; Europe, EU-27

Detailed results of the optional indicators mentioned in PCRed4 are available in the LCA report and on demand in a digital format - Country Customer Care Center - <http://www.schneider-electric.com/contact>

Mandatory Indicators		Altivar Soft Starter ATS490 410A 208 to 690V AC control supply 110 to 230V AC - ATS490C41Y					
Impact indicators	Unit	Total	[A1 - A3] - Manufacturing	[A4] - Distribution	[A5] - Installation	[B1 - B7] - Use	[C1 - C4] - End of life
Contribution to climate change	kg CO2 eq	3,34E+03	2,41E+02	4,59E+00	4,58E+00	3,05E+03	3,89E+01
Contribution to climate change-fossil	kg CO2 eq	3,33E+03	2,37E+02	4,59E+00	3,31E+00	3,05E+03	3,75E+01
Contribution to climate change-biogenic	kg CO2 eq	1,10E+01	4,25E+00	0*	1,27E+00	4,07E+00	1,38E+00
Contribution to climate change-land use and land use change	kg CO2 eq	2,60E-03	2,57E-03	0*	0*	0*	2,89E-05
Contribution to ozone depletion	kg CFC-11 eq	4,73E-05	3,28E-05	7,03E-09	2,45E-08	1,31E-05	1,51E-06
Contribution to acidification	mol H+ eq	2,10E+01	3,25E+00	2,90E-02	5,75E-03	1,74E+01	2,58E-01
Contribution to eutrophication, freshwater	kg (PO4) ³⁻ eq	6,04E-02	8,46E-03	0*	4,41E-05	8,36E-03	4,35E-02
Contribution to eutrophication marine	kg N eq	2,34E+00	3,11E-01	1,36E-02	2,46E-03	1,98E+00	3,89E-02
Contribution to eutrophication, terrestrial	mol N eq	3,38E+01	3,43E+00	1,49E-01	1,86E-02	2,97E+01	4,74E-01
Contribution to photochemical ozone formation - human health	kg COVNM eq	7,65E+00	1,12E+00	3,77E-02	4,77E-03	6,35E+00	1,29E-01
Contribution to resource use, minerals and metals	kg Sb eq	5,75E-02	5,59E-02	0*	0*	2,21E-04	1,38E-03
Contribution to resource use, fossils	MJ	8,40E+04	4,75E+03	6,40E+01	1,79E+01	7,78E+04	1,43E+03
Contribution to water use	m3 eq	2,93E+02	1,33E+02	0*	2,77E-01	1,08E+02	5,19E+01

Inventory flows Indicators		Altivar Soft Starter ATS490 410A 208 to 690V AC control supply 110 to 230V AC - ATS490C41Y					
Inventory flows	Unit	Total	[A1 - A3] - Manufacturing	[A4] - Distribution	[A5] - Installation	[B1 - B7] - Use	[C1 - C4] - End of life
Contribution to use of renewable primary energy excluding renewable primary energy used as raw material	MJ	1,51E+04	1,30E+02	0*	1,29E+01	1,49E+04	3,54E+01
Contribution to use of renewable primary energy resources used as raw material	MJ	7,28E+01	7,28E+01	0*	0*	0*	0*
Contribution to total use of renewable primary energy resources	MJ	1,52E+04	2,03E+02	0*	1,29E+01	1,49E+04	3,54E+01
Contribution to use of non renewable primary energy excluding non renewable primary energy used as raw material	MJ	8,39E+04	4,61E+03	6,40E+01	1,79E+01	7,78E+04	1,43E+03
Contribution to use of non renewable primary energy resources used as raw material	MJ	1,49E+02	1,49E+02	0*	0*	0*	0*
Contribution to total use of non-renewable primary energy resources	MJ	8,40E+04	4,75E+03	6,40E+01	1,79E+01	7,78E+04	1,43E+03
Contribution to use of secondary material	kg	1,72E+00	1,72E+00	0*	0*	0*	0*
Contribution to use of renewable secondary fuels	MJ	0,00E+00	0*	0*	0*	0*	0*
Contribution to use of non renewable secondary fuels	MJ	0,00E+00	0*	0*	0*	0*	0*
Contribution to net use of freshwater	m³	6,88E+00	3,12E+00	0*	6,45E-03	2,51E+00	1,24E+00
Contribution to hazardous waste disposed	kg	2,49E+03	2,43E+03	0*	0*	5,70E+01	1,12E+00
Contribution to non hazardous waste disposed	kg	6,12E+02	1,64E+02	1,61E-01	2,50E+00	4,39E+02	6,26E+00
Contribution to radioactive waste disposed	kg	2,11E-01	1,14E-01	1,15E-04	1,45E-04	9,19E-02	4,30E-03
Contribution to components for reuse	kg	0,00E+00	0*	0*	0*	0*	0*
Contribution to materials for recycling	kg	2,15E+01	2,11E+00	0*	7,49E-01	0*	1,86E+01
Contribution to materials for energy recovery	kg	2,33E-08	2,33E-08	0*	0*	0*	0*
Contribution to exported energy	MJ	1,22E+00	2,41E-01	0*	8,62E-01	0*	1,17E-01

* represents less than 0.01% of the total life cycle of the reference flow

Contribution to biogenic carbon content of the product	kg de C	0,00E+00	According to
Contribution to biogenic carbon content of the associated packaging	kg de C	1,37E+00	ADEME - EN 16485 - APESA/RECORD

Mandatory Indicators		Altivar Soft Starter ATS490 410A 208 to 690V AC control supply 110 to 230V AC - ATS490C41Y							
Impact indicators	Unit	[B1 - B7] - Use	[B1]	[B2]	[B3]	[B4]	[B5]	[B6]	[B7]
Contribution to climate change	kg CO2 eq	3,05E+03	0*	0*	0*	0*	0*	3,05E+03	0*
Contribution to climate change-fossil	kg CO2 eq	3,05E+03	0*	0*	0*	0*	0*	3,05E+03	0*
Contribution to climate change-biogenic	kg CO2 eq	4,07E+00	0*	0*	0*	0*	0*	4,07E+00	0*
Contribution to climate change-land use and land use change	kg CO2 eq	0*	0*	0*	0*	0*	0*	0*	0*
Contribution to ozone depletion	kg CFC-11 eq	1,31E-05	0*	0*	0*	0*	0*	1,31E-05	0*
Contribution to acidification	mol H+ eq	1,74E+01	0*	0*	0*	0*	0*	1,74E+01	0*
Contribution to eutrophication, freshwater	kg (PO4)³⁻ eq	8,36E-03	0*	0*	0*	0*	0*	8,36E-03	0*
Contribution to eutrophication marine	kg N eq	1,98E+00	0*	0*	0*	0*	0*	1,98E+00	0*
Contribution to eutrophication, terrestrial	mol N eq	2,97E+01	0*	0*	0*	0*	0*	2,97E+01	0*
Contribution to photochemical ozone formation - human health	kg COVNM eq	6,35E+00	0*	0*	0*	0*	0*	6,35E+00	0*
Contribution to resource use, minerals and metals	kg Sb eq	2,21E-04	0*	0*	0*	0*	0*	2,21E-04	0*
Contribution to resource use, fossils	MJ	7,78E+04	0*	0*	0*	0*	0*	7,78E+04	0*
Contribution to water use	m3 eq	1,08E+02	0*	0*	0*	0*	0*	1,08E+02	0*

Inventory flows Indicators		Altivar Soft Starter ATS490 410A 208 to 690V AC control supply 110 to 230V AC - ATS490C41Y							
Inventory flows	Unit	[B1 - B7] - Use	[B1]	[B2]	[B3]	[B4]	[B5]	[B6]	[B7]
Contribution to use of renewable primary energy excluding renewable primary energy used as raw material	MJ	1,49E+04	0*	0*	0*	0*	0*	1,49E+04	0*
Contribution to use of renewable primary energy resources used as raw material	MJ	0*	0*	0*	0*	0*	0*	0*	0*
Contribution to total use of renewable primary energy resources	MJ	1,49E+04	0*	0*	0*	0*	0*	1,49E+04	0*
Contribution to use of non renewable primary energy excluding non renewable primary energy used as raw material	MJ	7,78E+04	0*	0*	0*	0*	0*	7,78E+04	0*
Contribution to use of non renewable primary energy resources used as raw material	MJ	0*	0*	0*	0*	0*	0*	0*	0*
Contribution to total use of non-renewable primary energy resources	MJ	7,78E+04	0*	0*	0*	0*	0*	7,78E+04	0*
Contribution to use of secondary material	kg	0*	0*	0*	0*	0*	0*	0*	0*
Contribution to use of renewable secondary fuels	MJ	0*	0*	0*	0*	0*	0*	0*	0*
Contribution to use of non renewable secondary fuels	MJ	0*	0*	0*	0*	0*	0*	0*	0*
Contribution to net use of freshwater	m³	2,51E+00	0*	0*	0*	0*	0*	2,51E+00	0*
Contribution to hazardous waste disposed	kg	5,70E+01	0*	0*	0*	0*	0*	5,70E+01	0*
Contribution to non hazardous waste disposed	kg	4,39E+02	0*	0*	0*	0*	0*	4,39E+02	0*
Contribution to radioactive waste disposed	kg	9,19E-02	0*	0*	0*	0*	0*	9,19E-02	0*
Contribution to components for reuse	kg	0*	0*	0*	0*	0*	0*	0*	0*
Contribution to materials for recycling	kg	0*	0*	0*	0*	0*	0*	0*	0*
Contribution to materials for energy recovery	kg	0*	0*	0*	0*	0*	0*	0*	0*
Contribution to exported energy	MJ	0*	0*	0*	0*	0*	0*	0*	0*

* represents less than 0.01% of the total life cycle of the reference flow

Life cycle assessment performed with EIME version v6.1, database version 2023-02 in compliance with ISO14044, EF 3.0 method is applied, for biogenic carbon storage, assessment methodology 0/0 is used

Please note that the values given above are only valid within the context specified and cannot be used directly to draw up the environmental assessment of an installation.

Registration number :	SCHN-01120-V01.01-EN	Drafting rules	PCR-4-ed4-EN-2021 09 06
		Supplemented by	PSR-0005-ed3-EN-2023 06 06
Verifier accreditation N°	VH42	Information and reference documents	www.pep-ecopassport.org
Date of issue	05-2024	Validity period	5 years
Independent verification of the declaration and data, in compliance with ISO 14025 : 2006			
Internal External X			
The PCR review was conducted by a panel of experts chaired by Julie Orgelet (DDemain)			
PEPs are compliant with XP C08-100-1:2016 and EN 50693:2019 or NF E38-500 :2022			
The components of the present PEP may not be compared with components from any other program.			
Document complies with ISO 14025:2006 "Environmental labels and declarations. Type III environmental declarations"			



Schneider Electric Industries SAS

Country Customer Care Center
<http://www.se.com/contact>

Head Office
 35, rue Joseph Monier
 CS 30323
 F- 92500 Rueil Malmaison Cedex
 RCS Nanterre 954 503 439
 Capital social 928 298 512 €

www.se.com

Published by Schneider Electric

SCHN-01120-V01.01-EN

©2024 - Schneider Electric – All rights reserved

05-2024