# **Product Environmental Profile**

### Compact NSX400N 3P3T Circuit Breaker with Micrologic 2.3 Trip unit and Motor Mechanism MT400/630








#### General information

Representative product	Compact NSX400N 3P3T Circuit Breaker with Micrologic 2.3 Trip unit and Motor Mechanism MT400/630 -LV432693 & LV432641
Description of the product	This product (Circuit Breaker with Motor mechanism) is having combination of functions. The Compact NSX400N 3 pole circuit breaker equipped with Micrologic 2.3 trip units is designed to provide protection against overloads and short-circuits for industrial and commercial electrical distribution systems with assigned voltage upto 690VAC and rated current of 400A. The Motor mechanism module is designed to control, operate, Open, Close and Reset the circuit breakers by manually or electrical remote order.
Functional unit	This product (Circuit Breaker 400A with Micrologic 2.3 and Motor mechanism) is having combination of functions. It is to protect the installation during 20 years against overloads and short-circuits in circuit with assigned voltage 690VAC and rated current 400A. This protection is ensured in accordance with the following parameters: - Number of poles = 3 - Rated service breaking capacity Ics at 380/415 V AC = 50 kA (according to IEC 60947-2) - Tripping curve = Long time and instantanous protections

## Constituent materials

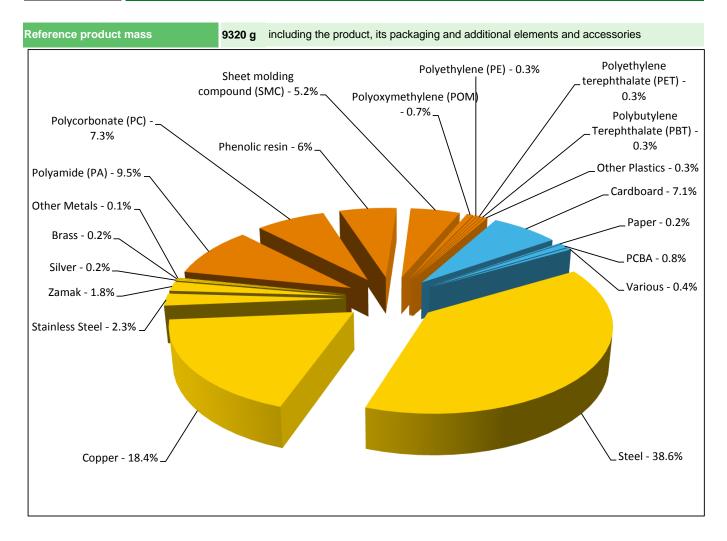

#### **Substance assessment**

Products of this range are designed in conformity with the requirements of the RoHS directive (European Directive 2011/65/EU of 8 June 2011) and do not contain, or only contain in the authorised proportions, lead, mercury, cadmium, hexavalent chromium or flame retardants (polybrominated biphenyls - PBB, polybrominated diphenyl ethers - PBDE) as mentioned in the Directive

As the products of the range are designed in accordance with the RoHS Directive (European Directive 2002/95/EC of 27 January 2003), they can be incorporated without any restriction in an assembly or an installation subject to this Directive.

Details of ROHS and REACH substances information are available on the Schneider-Electric Green Premium website http://www2.schneider-electric.com/sites/corporate/en/products-services/green-premium/green-premium.page

## **Additional environmental information**


The Compact NSX400N 3P3T Circuit Breaker with Micrologic 2.3 Trip unit and Motor Mechanism MT400/630 presents the following relevent environmental aspects						
Manufacturing	Manufactured at a Schneider Electric production site ISO14001 certified					
Distribution	Weight and volume of the packaging optimized, based on the European Union's packaging directive Packaging weight is 730.3 g, consisting of Cardboard (93.1%), PE film (4.2%) and Paper (2.7%). Product distribution optimised by setting up local distribution centres					
Installation	The product does not require special installation procedure and requires little to no energy to install. The disposal of the packaging materials are accounted for during the installation phase (including transport to disposal).					
Use	The end user must refer to maintenance guide of the product in order to do the appropriate maintenance operations. The Motor mechanism unit has to be replaced every 10 years.					
End of life	End of life optimized to decrease the amount of waste and allow recovery of the product components and materials This product contains Printed Circuit Board Assembly (35g) in Micrologic unit, that should be separated from the stream of waste so as to optimize end-of-life treatment. The location of these components and other recommendations are given in the End of Life Instruction document which is available on the Schneider-Electric Green Premium website http://www2.schneider-electric.com/sites/corporate/en/products-services/green-premium/green-premium.page Recyclability potential: 69% Based on "ECO'DEEE recyclability and recoverability calculation method" (version V1, 20 Sep. 2008 presented to the French Agency for Environment and Energy Management: ADEME).					

#### $\mathcal{O}$ Environmental impacts

Reference life time	20 years						
Product category	Passive products - non-continue	ous operation					
Installation elements	No special components needed						
Use scenario	Product dissipation is 14.4 W, lo	bading rate is 50% and servio	ce uptime percentage is 30	0%			
Geographical representativeness	China						
Technological representativeness	This product (Circuit Breaker with Motor mechanism) is having combination of functions. The Compact NSX400N 3 pole circuit breaker equipped with Micrologic 2.3 trip units is designed to provide protection against overloads and short-circuits for industrial and commercial electrical distribution systems with assigned voltage upto 690VAC and rated current of 400A. The Motor mechanism module is designed to control, operate, Open, Close and Reset the circuit breakers by manually or electrical remote order.						
	Manufacturing	Installation	Use	End of life			
Energy model used	Energy model used: SBMLV, China	Electricity mix; AC; consumption mix, at consumer; 220V; CN	Electricity mix; AC; consumption mix, at consumer; 220V; CN	Electricity mix; AC; consumption mix, at consumer; 220V; CN			

#### SCHN-00199-V01.01-EN - PEP ECOPASSPORT® - Compact NSX400N 3P3T Circuit Breaker with Micrologic 2.3 Trip unit and Motor Mechanism MT400/630

Compulsory indicators		Compact NSX400N 3P3T Circuit Breaker with Micrologic 2.3 Trip unit and Motor Mechanism MT400/630 - LV432693 & LV432641					
Impact indicators	Unit	Total	Manufacturing	Distribution	Installation	Use	End of Life
Contribution to mineral resources depletion	kg Sb eq	2,76E-02	2,37E-02	0*	0*	3,88E-03	0*
Contribution to the soil and water acidification	$kg SO_2 eq$	1,01E+00	1,12E-01	9,21E-03	0*	8,83E-01	2,64E-03
Contribution to water eutrophication	kg PO4 <sup>3-</sup> eq	3,16E-01	5,54E-02	2,12E-03	1,85E-03	2,56E-01	7,00E-04
Contribution to global warming	$kg CO_2 eq$	8,41E+02	4,73E+01	2,03E+00	1,02E+00	7,89E+02	1,22E+00
Contribution to ozone layer depletion	kg CFC11 eq	1,58E-05	7,00E-06	4,11E-09	0*	8,75E-06	5,89E-08
Contribution to photochemical oxidation	kg $C_2H_4$ eq	1,18E-01	1,34E-02	6,56E-04	2,19E-04	1,04E-01	2,79E-04
Resources use	Unit	Total	Manufacturing	Distribution	Installation	Use	End of Life
Net use of freshwater	m3	2,00E+00	8,30E-01	0*	0*	1,17E+00	1,15E-03
Total Primary Energy	MJ	1,38E+04	7,75E+02	2,87E+01	0*	1,30E+04	1,30E+01

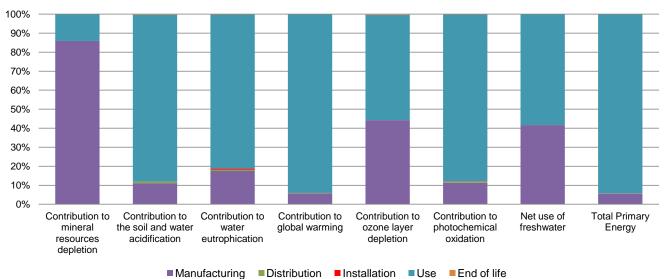

Manufacturing Distribution Installation Us
--

Optional indicators		Compact NSX400N 3P3T Circuit Breaker with Micrologic 2.3 Trip unit and Motor Mechanism MT400/630 - LV432693 & LV432641					
Unit	Total	Manufacturing	Distribution	Installation	Use	End of Life	
MJ	1,29E+04	5,91E+02	2,85E+01	0*	1,23E+04	1,19E+01	
m³	1,06E+05	1,91E+04	8,52E+01	0*	8,71E+04	9,32E+01	
m³	4,77E+04	6,76E+03	3,33E+02	5,30E+01	4,04E+04	1,08E+02	
Unit	Total	Manufacturing	Distribution	Installation	Use	End of Life	
kg	5,50E-01	4,57E-01	0*	0*	9,37E-02	0*	
MJ	6,77E+02	2,31E+01	0*	0*	6,54E+02	0*	
MJ	1,31E+04	7,52E+02	2,86E+01	0*	1,23E+04	1,30E+01	
MJ	6,58E+02	9,06E+00	0*	0*	6,49E+02	0*	
MJ	1,88E+01	1,40E+01	0*	0*	4,74E+00	0*	
MJ	1,30E+04	6,80E+02	2,86E+01	0*	1,23E+04	1,30E+01	
MJ	9,57E+01	7,18E+01	0*	0*	2,38E+01	0*	
MJ	0,00E+00	0*	0*	0*	0*	0*	
MJ	0,00E+00	0*	0*	0*	0*	0*	
	MJ ( ) ( ) ( ) ( ) ( ) ( ) ( ) ( ) ( ) (	Mechanism   Unit Total   MJ 1,29E+04   m³ 1,06E+05   m³ 4,77E+04   Unit Total   kg 5,50E-01   MJ 6,77E+02   MJ 1,31E+04   MJ 6,58E+02   MJ 1,30E+04   MJ 1,30E+04   MJ 9,57E+01   MJ 0,00E+00	Mechanism MT400/630 - LV43   Unit Total Manufacturing   MJ 1,29E+04 5,91E+02   m³ 1,06E+05 1,91E+04   m³ 4,77E+04 6,76E+03   Unit Total Manufacturing   kg 5,50E-01 4,57E-01   MJ 6,77E+02 2,31E+01   MJ 6,58E+02 9,06E+00   MJ 1,31E+04 7,52E+02   MJ 1,38E+01 1,40E+01   MJ 9,57E+01 7,18E+01   MJ 9,07E+00 0*	Mechanism MT400/630 - LV432E93 & LV432   Unit Total Manufacturing Distribution   MJ 1,29E+04 5,91E+02 2,85E+01   m³ 1,06E+05 1,91E+04 8,52E+01   m³ 4,77E+04 6,76E+03 3,33E+02   Unit Total Manufacturing Distribution   kg 5,50E-01 4,57E-01 0*   MJ 6,77E+02 2,31E+01 0*   MJ 6,58E+02 9,06E+00 0*   MJ 1,38E+01 1,40E+01 0*   MJ 9,57E+01 7,18E+01 0*   MJ 9,057E+01 0* 0*	Mechanism WT400/630 - LV432693 & LV432641   Unit Total Manufacturing Distribution Installation   MJ 1,29E+04 5,91E+02 2,85E+01 0*   m³ 1,06E+05 1,91E+04 8,52E+01 0*   m³ 4,77E+04 6,76E+03 3,33E+02 5,30E+01   Muit Total Manufacturing Distribution Installation   kg 5,50E-01 4,57E-01 0* 0*   MJ 6,77E+02 2,31E+01 0* 0*   MJ 6,58E+02 9,06E+00 0* 0*   MJ 1,31E+04 7,52E+02 2,86E+01 0*   MJ 1,88E+01 1,40E+01 0* 0*   MJ 1,30E+04 6,80E+02 2,86E+01 0*   MJ 9,57E+01 7,18E+01 0* 0*   MJ 0,00E+00 0* 0* 0*	Mechanism WT400/630 - LV432693 & LV43264   Unit Total Manufacturing Distribution Installation Use   MJ 1,29E+04 5,91E+02 2,85E+01 0* 1,23E+04   m³ 1,06E+05 1,91E+04 8,52E+01 0* 8,71E+04   m³ 4,77E+04 6,76E+03 3,33E+02 5,30E+01 4,04E+04   Muit Total Manufacturing Distribution Installation Use   kg 5,50E-01 4,57E-01 0* 0* 9,37E-02   MJ 6,77E+02 2,31E+01 0* 0* 6,54E+02   MJ 1,31E+04 7,52E+02 2,86E+01 0* 6,49E+02   MJ 6,58E+02 9,06E+00 0* 0* 4,74E+00   MJ 1,88E+01 1,40E+01 0* 0* 1,23E+04   MJ 1,30E+04 6,80E+02 2,86E+01 0* 2,38E+01   MJ 9,57E+01 7,18E+01 0* 0* 0* 0	

#### SCHN-00199-V01.01-EN - PEP ECOPASSPORT<sup>®</sup> - Compact NSX400N 3P3T Circuit Breaker with Micrologic 2.3 Trip unit and Motor Mechanism MT400/630

Waste categories	Unit	Total	Manufacturing	Distribution	Installation	Use	End of Life
Hazardous waste disposed	kg	9,50E+02	6,42E+02	0*	0*	2,96E+02	1,17E+01
Non hazardous waste disposed	kg	2,09E+02	4,78E+01	7,20E-02	5,39E-01	1,60E+02	3,99E-02
Radioactive waste disposed	kg	3,11E-02	1,88E-02	5,13E-05	0*	1,23E-02	6,26E-05
Other environmental information	Unit	Total	Manufacturing	Distribution	Installation	Use	End of Life
Materials for recycling	kg	7,09E+00	9,91E-01	0*	0*	0*	6,10E+00
Components for reuse	kg	0,00E+00	0*	0*	0*	0*	0*
Materials for energy recovery	kg	1,45E-01	1,66E-02	0*	0*	0*	1,28E-01
Exported Energy	MJ	1,13E-02	0*	0*	1,13E-02	0*	0*

\* represents less than 0.01% of the total life cycle of the reference flow

Life cycle assessment performed with EIME version EIME v5.5, database version 2015-04.

## The use phase is the life cycle phase which has the greatest impact on the majority of environmental indicators (based on compulsory indicators).

Please note that the values given above are only valid within the context specified and cannot be used directly to draw up the environmental assessment of an installation.

Registration N°	SCHN-00199-V01.01-EN	Drafting rules	PCR-ed3-EN-2015 04 02			
Verifier accreditation N°	VH08	Supplemented by	PSR-0005-ed2-EN-2016 03 29			
Date of issue	03/2017	Information and reference documents	www.pep-ecopassport.org			
		Validity period	5 years			
Independent verification of the declaration and data, in compliance with ISO 14025 : 2010						
Internal External X						
The PCR review was condu	ucted by a panel of experts chaired l	by Philippe Osset (SOLINNEN)				
The elements of the present PEP cannot be compared with elements from another program.						
Document in compliance with ISO 14025 : 2010 « Environmental labels and declarations. Type III environmental declarations »						

Schneider Electric Industries SAS

Country Customer Care Center

http://www2.schneider-electric.com/sites/corporate/en/support/operations/local-operations/local-operations.page

35, rue Joseph Monier

CS 30323

F- 92506 Rueil Malmaison Cedex RCS Nanterre 954 503 439 Capital social 896 313 776 €

www.schneider-electric.com

SCHN-00199-V01.01-EN

Published by Schneider Electric

© 2016 - Schneider Electric – All rights reserved

03/2017