
Product Environmental Profile

PANEL BASIC 19" 1U 24RJ45 MODULAR JACK STP






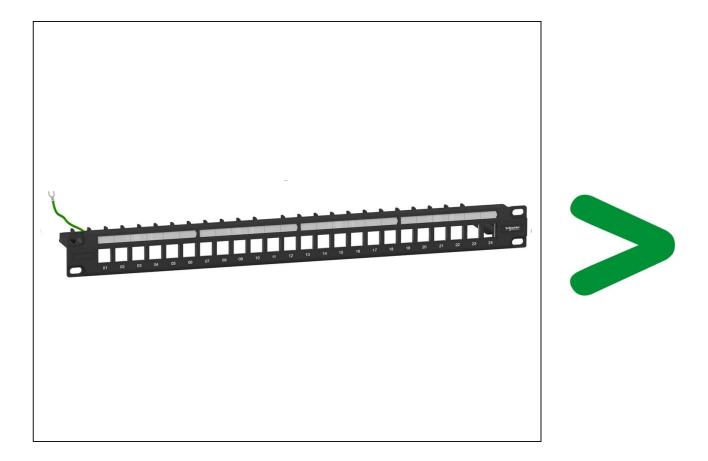

ے General Information					
Representative product	PANEL BASIC 19" 1U 24RJ45 MODULAR JACK STP -VDIG017241B				
Description of the product	The main purpose of the Actassi RJ45 Modular Jack Patch panel is to support copper cable terminations within a 19" frame.				
Functional unit	Actassi Modular Jack B131U panels allows to support the 24 Ethernet cable with RJ45 connectors, This product is only available in a shielded version. The panel is without Modular Jack connectors and provided with cage nuts and a rear cable manager.				

Constituent materials

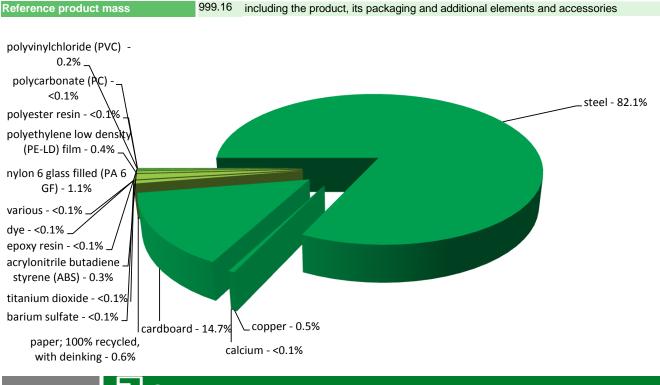

Substance assessment

Products of this range are designed in conformity with the requirements of the RoHS directive (European Directive 2011/65/EU of 8 June 2011) and do not contain, or only contain in the authorised proportions, lead, mercury, cadmium, hexavalent chromium or flame retardants (polybrominated biphenyls - PBB, polybrominated diphenyl ethers - PBDE) as mentioned in the Directive

As the products of the range are designed in accordance with the RoHS Directive (European Directive 2002/95/EC of 27 January 2003), they can be incorporated without any restriction in an assembly or an installation subject to this Directive.

Details of ROHS and REACH substances information are available on the Schneider-Electric Green Premium website <u>http://www2.schneider-electric.com/sites/corporate/en/products-services/green-premium/green-premium.page</u>

Additional environmental information

The PANEL BASIC 19" 1U 24RJ45 MODULAR JACK STP presents the following relevent environmental aspects						
Manufacturing	Manufactured at a Schneider Electric production site ISO14001 certified					
	Weight and volume of the packaging optimized, based on the European Union's packaging directive					
Distribution	Packaging weight is 149.4 g, consisting of cardboard (93.72%), Paper (3.53%), Polyethylene low density (PE-LD) film (2.74%)					
	Product distribution optimised by setting up local distribution centres					
Installation	0					
Use	The product does not require special maintenance operations.					
End of life	End of life optimized to decrease the amount of waste and allow recovery of the product components and materials No special end-of-life treatment required. According to countries' practices this product can enter the usual end-of-life treatment process.					
	Recyclability potential: 93% Based on Eco'DEEE method					

O Environmental impacts

Reference life time	20 years					
Product category	Enclosures					
Installation elements	No special components needed					
Use scenario	This product does not have any energy consumption					
Geographical representativeness	France					
Technological representativeness	The main purpose of the Actassi RJ45 Modular Jack Patch panel is to support copper cable terminations within a 19" frame.					
	Manufacturing	Installation	Use	End of life		
				End of life		

Compulsory indicators		PANEL BASIC 19" 1U 24RJ45 MODULAR JACK STP - VDIG017241B					
Impact indicators	Unit	Total	Manufacturing	Distribution	Installation	Use	End of Life
Contribution to mineral resources depletion	kg Sb eq	9.58E-04	9.58E-04	0*	0*	0*	0*
Contribution to the soil and water acidification	kg SO ₂ eq	1.61E-02	1.52E-02	5.99E-04	4.48E-05	0*	2.30E-04
Contribution to water eutrophication	kg PO ₄ ³⁻ eq	2.70E-03	2.50E-03	1.38E-04	1.06E-05	0*	5.46E-05
Contribution to global warming	kg CO ₂ eq	4.80E+00	4.58E+00	1.31E-01	1.44E-02	0*	7.66E-02
Contribution to ozone layer depletion	kg CFC11 eq	4.35E-07	4.28E-07	2.66E-10	1.17E-09	0*	4.78E-09
Contribution to photochemical oxidation	kg C_2H_4 eq	1.46E-03	1.39E-03	4.27E-05	4.71E-06	0*	2.49E-05

SCHN-2016-006 - PEP ECOPASSPORT® - PANEL BASIC 19" 1U 24RJ45 MODULAR JACK STP



Optional indicators PANEL BASIC 19" 1U 24RJ45 MODULAR JACK STP - VDIG017241B Impact indicators MJ 5.98E+01 2.02E-01 0* Contribution to fossil resources depletion 5.67E+01 1.84E+00 1.06E+00 m³ 1.38E+03 1.58E+00 Contribution to air pollution 1.39E+03 5.58E+00 0* 8.20E+00 Contribution to water pollution m³ 3.26E+02 2.94E+02 2.16E+01 1.69E+00 0* 8.80E+00 **Resources use** Use of secondary material 6.02E-03 6.02E-03 0* 0* 0* 0* kg Total use of renewable primary energy resources MJ 3.36E+00 3.35E+00 2.47E-03 0* 0* 1.30E-03 Total use of non-renewable primary energy resources MJ 9.72E+01 9.38E+01 1.85E+00 2.45E-01 0* 1.28E+00 Use of renewable primary energy excluding renewable MJ 8.37E-01 8.33E-01 2.47E-03 2.43E-04 0* 1.30E-03 primary energy used as raw material Use of renewable primary energy resources used as MJ 2.52E+00 2.52E+00 0* 0* 0* 0* raw material Use of non renewable primary energy excluding non MJ 9.65E+01 9.31E+01 1.85E+00 2.45E-01 0* 1.28E+00 renewable primary energy used as raw material Use of non renewable primary energy resources used MJ 0* 0* 0* 0* 6.85E-01 6.85E-01 as raw material Use of non renewable secondary fuels MJ 0.00E+00 0* 0* 0* 0* 0* Use of renewable secondary fuels MJ 0.00E+00 0* 0* 0* 0* 0* Waste categories Unit Manufacturing Hazardous waste disposed 7.70E+01 7.59E+01 0* 2.96E-01 0* 8.58E-01 kg Non hazardous waste disposed kg 2.54E+00 2.53E+00 4.66E-03 6.70E-04 0* 3.58E-03 Radioactive waste disposed 1.15E-03 1.15E-03 3.32E-06 1.10E-06 0* 5.49E-06 kg Other environmental information Unit Materials for recycling 3.69E-03 7.48E-01 kg 7.51E-01 0* 0* 0* Components for reuse kg 0.00E+00 0* 0* 0* 0* 0* 4.10E-05 0* 6.77E-04 Materials for energy recovery 7.18E-04 0* 0* kg Exported Energy 0* 0* MJ 0.00E+00 0* 0* 0*

SCHN-2016-006 - PEP ECOPASSPORT® - PANEL BASIC 19" 1U 24RJ45 MODULAR JACK STP

* represents less than 0.01% of the total life cycle of the reference flow

Life cycle assessment performed with EIME version EIME v5.5, database version 2015-04.

The manufacturing phase is the life cycle phase which has the greatest impact on the majority of environmental indicators (based on compulsory indicators).

Please note that the values given above are only valid within the context specified and cannot be used directly to draw up the environmental assessment of an installation.

Registration N°	SCHN-2016-006	Drafting rules	PCR-ed3-EN-2015 04 02		
Verifier accreditation N°	0				
Date of issue	2/8/2016	Information and reference documents	www.pep-ecopassport.org		
		Validity period	5 years		
Independent verification of the declaration and data, in compliance with ISO 14025 : 2010					
Internal X	External				
The PCR review was conducted by a panel of experts chaired by Philippe Osset (SOLINNEN)					
The elements of the present PEP cannot be compared with elements from another program.					
Document in compliance with ISO 14025 : 2010 « Environmental labels and declarations. Type III environmental declarations »					

Schneider Electric Industries SAS

35, rue Joseph Monier CS 30323 F- 92506 Rueil Malmaison Cedex RCS Nanterre 954 503 439 Capital social 896 313 776 €

www.schneider-electric.com

SCHN-2016-006

Published by Schneider Electric

© 2015 - Schneider Electric – All rights reserved

2/8/2016