

# Product Environmental Profile

EXW-LIGHT-AMB IP65 ACT/L L/1LFP






## General information

Representative product	EXW-LIGHT-AMB IP65 ACT/L L/1LFP - OVA59331
Description of the product	Maintained emergency luminaire (EN 60598-2-22) luminaire in which the emergency lighting lamps are energized at all times when normal or emergency lighting is required
Functional unit	Facilitate the evacuation of personnel by providing 650 lumens of light for one hour in the event of an electrical power cut. This function is provided for ten years by its self-contained power supply



## Constituent materials

Reference product mass	510 g	including the product, its packaging and additional elements and accessories
------------------------	-------	------------------------------------------------------------------------------

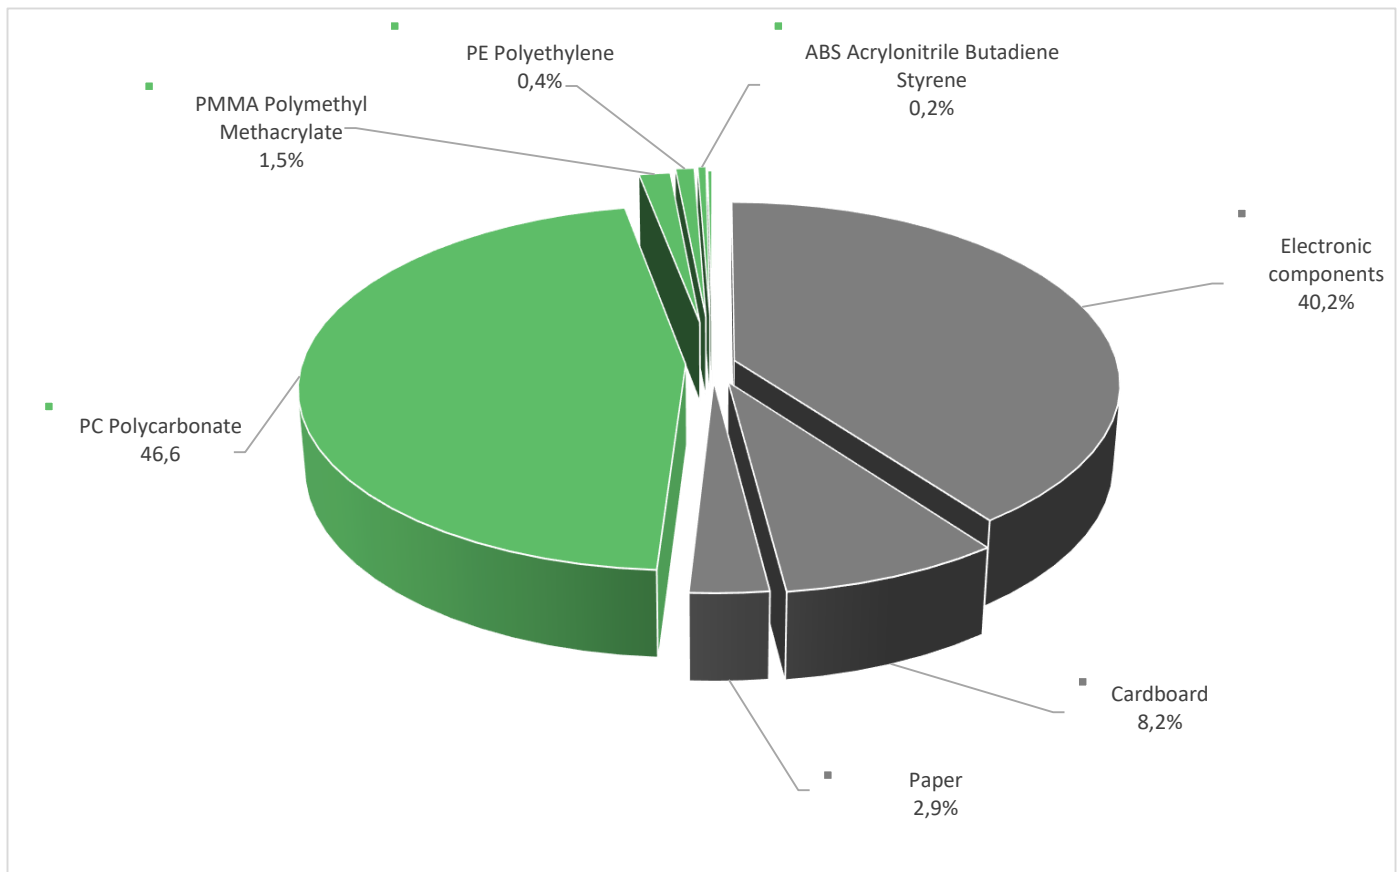

Plastics	48,7%
Metals	0,0%
Others	51,3%

## Substance assessment

Products of this range are designed in conformity with the requirements of the RoHS directive (European Directive 2011/65/EU of 2 January 2013, amended in March 2015, 2015/863/EU and in November 2017, 2017/2102/EU) and do not contain, or only contain in the authorised proportions, lead, mercury, cadmium, hexavalent chromium or flame retardants (polybrominated biphenyls - PBB, polybrominated diphenyl ethers – PBDE), Bis (2-ethylhexyl)phthalate - DEHP, Benzyl butyl phthalate– BBP, Dibutyl phthalate - DBP, Diisobutyl phthalate - DIBP) as mentioned in the Directive.

Details of ROHS and REACH substances information are available on the Schneider-Electric Green Premium website

<http://www2.schneider-electric.com/sites/corporate/en/products-services/green-premium/green-premium.page>

## Additional environmental information


The EXW-LIGHT-AMB IP65 ACT/L L/1LFP presents the following relevant environmental aspects

<b>Design</b>	The small capacity of the battery and the high efficiency of the LED light source reduce the energy consumption in the installation
<b>Manufacturing</b>	Manufactured at a Schneider Electric production site ISO14001 certified
<b>Distribution</b>	Weight and volume of the packaging optimized, based on the European Union's packaging directive Packaging weight is 53,3 g, consisting of Cardboard(90%) Paper (10%) Packaging recycled materials is 90% of total packaging mass. Product distribution optimised by setting up local distribution centres
<b>Installation</b>	Wall or ceiling installations needed
<b>Use</b>	During the product service life, a battery of 97g should be changed 1 times to guarantee the rated discharge duration. The LEDs light source last 10 years or longer and doesn't need to be substituted.
<b>End of life</b>	End of life optimized to decrease the amount of waste and allow recovery of the product components and materials This product contains batteries: (97g), electronic card: (50g) that should be separated from the stream of waste so as to optimize end-of-life treatment. The location of these components and other recommendations are given in the End of Life Instruction document which is available on the Schneider-Electric Green Premium website <a href="http://www2.schneider-electric.com/sites/corporate/en/products-services/green-premium/green-premium.page">http://www2.schneider-electric.com/sites/corporate/en/products-services/green-premium/green-premium.page</a> Recyclability potential: <b>65%</b> Based on "ECO'DEEEE recyclability and recoverability calculation method" (version V1, 20 Sep. 2008 presented to the French Agency for Environment and Energy Management: ADEME).

## Environmental impacts

Reference life time	10 years			
Installation elements	During the installation phase, the packaging must be disposed off.			
Use scenario	In his lifetime, lamp uses 1% of its time in active mode for autotest to verify the correct function of the battery and 99% of his life in standby mode (normal function) for 10 years with a power consumption of 0,7W			
Geographical representativeness	Europe			
Technological representativeness	Maintained emergency luminaire (EN 60598-2-22) luminaire in which the emergency lighting lamps are energized at all times when normal or emergency lighting is required			
Energy model used	Manufacturing	Installation	Use	End of life
	Energy model used: Italy	Electricity grid mix; AC; consumption mix, at consumer; < 1kV; EU-27	Electricity grid mix; AC; consumption mix, at consumer; < 1kV; EU-27	Electricity grid mix; AC; consumption mix, at consumer; < 1kV; EU-27

Compulsory indicators		EXW-LIGHT-AMB IP65 ACT/L L/1LFP - OVA59331					
Impact indicators	Unit	Total	Manufacturing	Distribution	Installation	Use	End of Life
Contribution to mineral resources depletion	kg Sb eq	6,53E-04	6,45E-04	0*	4,15E-06	3,23E-06	0*
Contribution to the soil and water acidification	kg SO <sub>2</sub> eq	1,33E-01	3,78E-02	3,00E-04	5,24E-05	9,48E-02	2,23E-04
Contribution to water eutrophication	kg PO <sub>4</sub> <sup>3-</sup> eq	3,16E-02	2,54E-02	6,92E-05	7,97E-06	6,04E-03	7,60E-05
Contribution to global warming	kg CO <sub>2</sub> eq	3,25E+01	9,05E+00	6,58E-02	1,71E-02	2,32E+01	1,85E-01
Contribution to ozone layer depletion	kg CFC11 eq	7,10E-06	5,04E-06	0*	2,76E-09	2,04E-06	1,16E-08
Contribution to photochemical oxidation	kg C <sub>2</sub> H <sub>4</sub> eq	7,04E-03	1,79E-03	2,14E-05	4,93E-06	5,21E-03	2,35E-05
Resources use	Unit	Total	Manufacturing	Distribution	Installation	Use	End of Life
Net use of freshwater	m3	8,10E+01	7,73E-02	0*	0*	8,09E+01	0*
Total Primary Energy	MJ	6,11E+02	1,23E+02	9,30E-01	3,38E-01	4,85E+02	1,20E+00

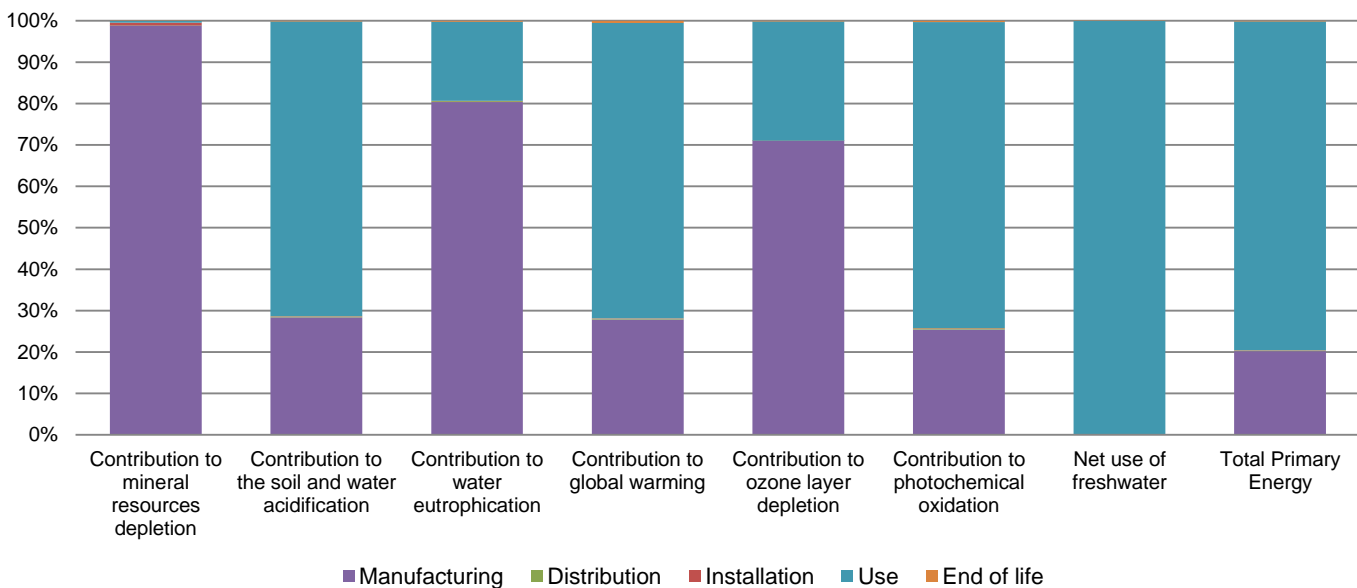


Optional indicators		EXW-LIGHT-AMB IP65 ACT/L L/1LFP - OVA59331					
Impact indicators	Unit	Total	Manufacturing	Distribution	Installation	Use	End of Life
Contribution to fossil resources depletion	MJ	3,58E+02	9,37E+01	9,24E-01	1,76E-01	2,63E+02	8,96E-01
Contribution to air pollution	m <sup>3</sup>	1,97E+03	8,60E+02	2,80E+00	5,75E+00	1,09E+03	1,05E+01
Contribution to water pollution	m <sup>3</sup>	2,30E+03	1,28E+03	1,08E+01	8,85E-01	9,94E+02	1,05E+01
Resources use	Unit	Total	Manufacturing	Distribution	Installation	Use	End of Life
Use of secondary material	kg	5,67E-02	5,67E-02	0*	0*	0*	0*
Total use of renewable primary energy resources	MJ	6,09E+01	4,20E+00	0*	0*	5,67E+01	0*
Total use of non-renewable primary energy resources	MJ	5,50E+02	1,19E+02	9,29E-01	3,35E-01	4,28E+02	1,20E+00
Use of renewable primary energy excluding renewable primary energy used as raw material	MJ	6,09E+01	4,16E+00	0*	0*	5,67E+01	0*
Use of renewable primary energy resources used as raw material	MJ	4,20E-02	4,20E-02	0*	0*	0*	0*
Use of non renewable primary energy excluding non renewable primary energy used as raw material	MJ	5,39E+02	1,09E+02	9,29E-01	3,35E-01	4,28E+02	1,20E+00
Use of non renewable primary energy resources used as raw material	MJ	1,10E+01	1,07E+01	0*	0*	3,06E-01	0*
Use of non renewable secondary fuels	MJ	0,00E+00	0*	0*	0*	0*	0*
Use of renewable secondary fuels	MJ	0,00E+00	0*	0*	0*	0*	0*
Waste categories	Unit	Total	Manufacturing	Distribution	Installation	Use	End of Life
Hazardous waste disposed	kg	4,21E+01	3,94E+01	0*	3,28E-01	1,68E+00	7,60E-01
Non hazardous waste disposed	kg	8,93E+01	6,03E+00	0*	1,11E-02	8,33E+01	1,79E-02
Radioactive waste disposed	kg	6,03E-02	4,29E-03	0*	0*	5,60E-02	7,60E-06
Other environmental information	Unit	Total	Manufacturing	Distribution	Installation	Use	End of Life
Materials for recycling	kg	4,02E-01	3,27E-02	0*	5,31E-02	0*	3,17E-01
Components for reuse	kg	0,00E+00	0*	0*	0*	0*	0*
Materials for energy recovery	kg	3,57E-02	0*	0*	0*	0*	3,57E-02
Exported Energy	MJ	1,69E-04	1,59E-05	0*	1,53E-04	0*	0*

\* represents less than 0.01% of the total life cycle of the reference flow

Life cycle assessment performed with EIME version EIME v5.8.1, database version 2016-11 in compliance with ISO14044.

The use phase is the life cycle phase which has the greatest impact on the majority of environmental indicators (based on compulsory indicators).

Please note that the values given above are only valid within the context specified and cannot be used directly to draw up the environmental assessment of an installation.

<i>Registration number :</i>	SCHN-00717-V01.01-EN	<i>Drafting rules</i>	PCR-ed3-EN-2015 04 02
<i>Verifier accreditation N°</i>	VH39	<i>Supplemented by</i>	PSR-0007-ed1.1-EN-2015 10 16
<i>Date of issue</i>	10/2021	<i>Information and reference documents</i>	<a href="http://www.pep-ecopassport.org">www.pep-ecopassport.org</a>
		<i>Validity period</i>	5 years
<i>Independent verification of the declaration and data, in compliance with ISO 14025 : 2010</i>			
<i>Internal</i>		<i>External</i>	X
<i>The PCR review was conducted by a panel of experts chaired by Philippe Osset (SOLINNEN)</i>			
<i>PEP are compliant with XP C08-100-1 :2016</i>			
<i>The elements of the present PEP cannot be compared with elements from another program.</i>			
<i>Document in compliance with ISO 14025 : 2010 « Environmental labels and declarations. Type III environmental declarations »</i>			
			

Schneider Electric Industries SAS

Country Customer Care Center  
<http://www.schneider-electric.com/contact>

35, rue Joseph Monier

CS 30323

F- 92506 Rueil Malmaison Cedex

RCS Nanterre 954 503 439  
 Capital social 896 313 776 €

[www.schneider-electric.com](http://www.schneider-electric.com)

Published by Schneider Electric

SCHN-00717-V01.01-EN

© 2019 - Schneider Electric – All rights reserved

10/2021