

Product Environmental Profile

APC Smart-UPS RT 6000VA, 220V




General information

Reference product	APC Smart-UPS RT 6000VA, 220V - SURT6000XLI-CH
Description of the product	Smart-UPS™ On-Line provides high-density, true double-conversion online power protection for servers, voice/data networks, medical labs, and light industrial applications.
Description of the range	APC Smart-UPS RT 5-8KVA The environmental impacts of this referenced product are representative of the impacts of the other products of the range which are developed with a similar technology.
Functional unit	To protect the load of 6000 Watts against input power failure during 10 years and provide a backup time of 66 minutes in case of a power outage.

Constituent materials

Reference product mass	68000 g including the product, its packaging and additional elements and accessories
------------------------	--

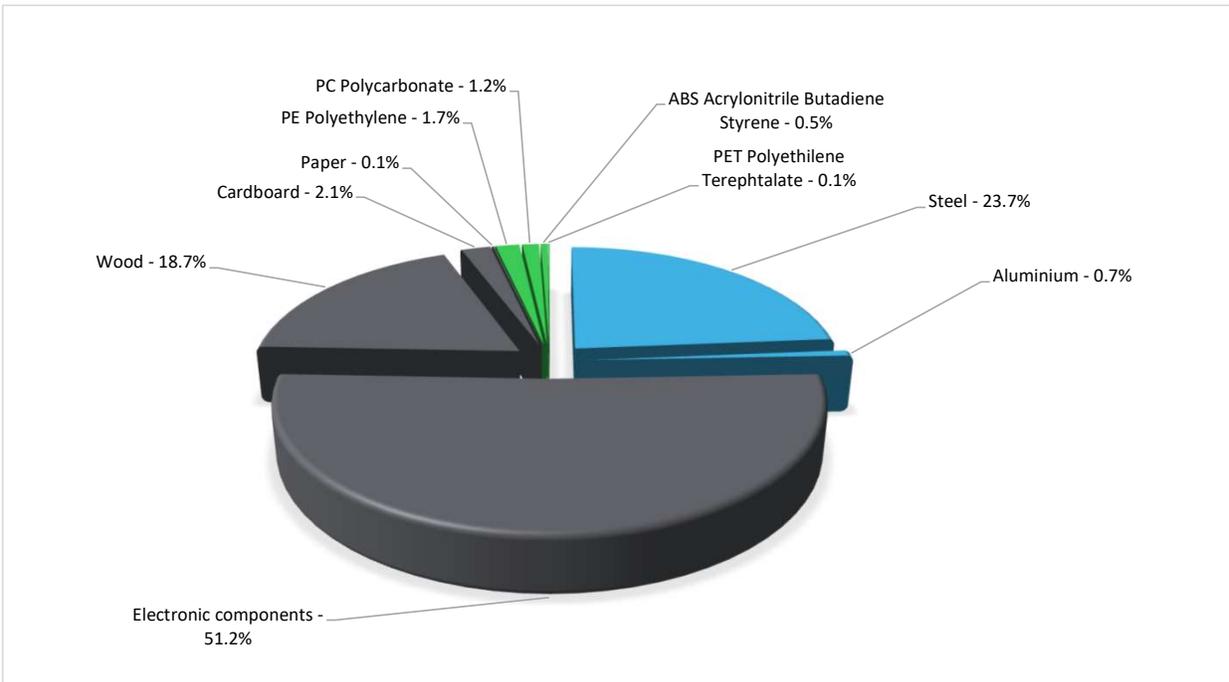

Plastics	3.50%
Metals	24.40%
Others	72.10%

Substance assessment

Details of ROHS and REACH substances information are available on the Schneider-Electric Green Premium website <https://www.se.com/ww/en/work/support/green-premium/>

Additional environmental information

End Of Life	Recyclability potential:	31%	Recyclability rate has been calculated based on REEECYLAB tool developed by Ecosystem, for components/materials not covered by the tool, data from the "ECO'DEEE recyclability and recoverability calculation method" was taken. If no data was found a conservative assumption was used (0% recyclability).
-------------	--------------------------	------------	--

Environmental impacts

Reference service life time	10 years		
Installation elements	Ref SURT6000XLI-CH does not require any installation operations, the disposal of the packaging materials are accounted for 22.9% during the installation phase (including transport to disposal).		
Use scenario	Power consumption conforms to the requirements in PSR0010 where it is modeled to operate 50% load for 30% of the time, 75% load for 40% of the time, and 100% load for 30% of the time. The UPS is modeled to operate in normal mode (average efficiency of 94.6% and annual use of 2136.56kWh) 75% of the time and in ECO mode (average efficiency of 97.6% and annual use of 914.54kWh) 25% of the time		
Technological representativeness	The Modules of Technologies such as material production, manufacturing process and transport technology used in this PEP analysis (LCA EIME in this case) are Similar and representative of the actual type of technologies used to make the product in production.		
Geographical representativeness	China		
Energy model used	[A1 - A3]	[A5]	[B6]
	Electricity Mix; Production mix; Low voltage; CN	Electricity Mix; Production mix; Low voltage; CN	Electricity Mix; Production mix; Low voltage; CN
			[C1 - C4]
			Electricity Mix; Production mix; Low voltage; CN

Detailed results, including all the optional indicators mentioned in PCRed4, and the split of the Use Phase (B1 to B7), are available in the LCA report and on demand in a digital format - Country Customer Care Center - <http://www.schneider-electric.com/contact>

Mandatory Indicators			APC Smart-UPS RT 6000VA, 220V - SURT6000XLI-CH					
Impact indicators	Unit	Total	Manufacturing	Distribution	Installation	Use	End of Life	Benefits
			[A1 - A3]	[A4]	[A5]	[B1 - B7]	[C1 - C4]	[D]
Contribution to climate change	kg CO2 eq	1.65E+04	4.06E+02	1.96E+01	1.35E+01	1.60E+04	6.14E+01	-7.50E+01
Contribution to climate change-fossil	kg CO2 eq	1.65E+04	4.06E+02	1.96E+01	2.06E+01	1.60E+04	6.14E+01	-7.44E+01
Contribution to climate change-biogenic	kg CO2 eq	-3.90E+00	0*	0*	-7.04E+00	0*	0*	-5.59E-01
Contribution to climate change-land use and land use change	kg CO2 eq	7.70E-06	8.61E-07	0*	6.84E-06	0*	0*	0.00E+00
Contribution to ozone depletion	kg CFC-11 eq	2.03E-04	9.20E-05	1.73E-05	2.50E-07	9.13E-05	2.58E-06	-1.06E-05
Contribution to acidification	mol H+ eq	1.23E+02	3.07E+00	8.52E-02	2.21E-02	1.20E+02	2.55E-01	-4.33E-01
Contribution to eutrophication, freshwater	kg (PO4) ³⁻ eq	4.67E-03	1.14E-03	2.30E-06	1.26E-04	3.37E-03	2.74E-05	-2.35E-04
Contribution to eutrophication marine	kg N eq	1.33E+01	3.93E-01	3.91E-02	7.66E-03	1.28E+01	6.66E-02	-4.55E-02
Contribution to eutrophication, terrestrial	mol N eq	1.50E+02	4.33E+00	4.24E-01	6.96E-02	1.45E+02	5.30E-01	-5.14E-01
Contribution to photochemical ozone formation - human health	kg COVNM eq	4.46E+01	1.46E+00	1.39E-01	2.26E-02	4.27E+01	1.87E-01	-1.80E-01
Contribution to resource use, minerals and metals	kg Sb eq	1.76E-01	1.75E-01	0*	0*	2.05E-04	0*	-1.95E-02
Contribution to resource use, fossils	MJ	2.69E+05	6.49E+03	2.38E+02	4.40E+01	2.58E+05	3.55E+03	-1.65E+03
Contribution to water use	m3 eq	1.20E+03	1.32E+02	9.94E-01	3.12E+00	7.05E+02	3.57E+02	-3.21E+01

Inventory flows Indicators			APC Smart-UPS RT 6000VA, 220V - SURT6000XLI-CH					
Inventory flows	Unit	Total	Manufact.	Distribution	Installation	Use	End of Life	Benefits
			[A1 - A3]	[A4]	[A5]	[B1 - B7]	[C1 - C4]	[D]
Contribution to use of renewable primary energy excluding renewable primary energy used as raw material	MJ	2.76E+04	2.37E+02	0*	5.70E+01	2.73E+04	0*	-6.32E-01
Contribution to use of renewable primary energy resources used as raw material	MJ	2.61E+02	2.61E+02	0*	0*	0*	0*	-6.32E+01
Contribution to total use of renewable primary energy resources	MJ	2.79E+04	4.98E+02	0*	5.70E+01	2.73E+04	0*	-6.39E+01
Contribution to use of non renewable primary energy excluding non renewable primary energy used as raw material	MJ	2.69E+05	6.27E+03	2.38E+02	4.40E+01	2.58E+05	3.55E+03	-1.59E+03
Contribution to use of non renewable primary energy resources used as raw material	MJ	2.27E+02	2.27E+02	0*	0*	0*	0*	-5.82E+01
Contribution to total use of non-renewable primary energy resources	MJ	2.69E+05	6.49E+03	2.38E+02	4.40E+01	2.58E+05	3.55E+03	-1.65E+03
Contribution to use of secondary material	kg	7.60E-04	7.60E-04	0*	0*	0*	0*	0.00E+00
Contribution to use of renewable secondary fuels	MJ	0.00E+00	0*	0*	0*	0*	0*	0.00E+00
Contribution to use of non renewable secondary fuels	MJ	0.00E+00	0*	0*	0*	0*	0*	0.00E+00
Contribution to net use of freshwater	m³	2.89E+01	3.08E+00	2.32E-02	7.26E-02	1.64E+01	9.29E+00	-7.47E-01
Contribution to hazardous waste disposed	kg	2.42E+03	1.85E+03	0*	0*	4.85E+02	8.30E+01	-1.54E+03
Contribution to non hazardous waste disposed	kg	2.97E+03	1.56E+02	0*	1.92E+01	2.78E+03	5.91E+00	-9.96E+01
Contribution to radioactive waste disposed	kg	1.88E-01	6.72E-02	3.90E-03	1.62E-03	1.14E-01	1.39E-03	-3.33E-02
Contribution to components for reuse	kg	0.00E+00	0*	0*	0*	0*	0*	0.00E+00
Contribution to materials for recycling	kg	2.29E+01	2.76E-02	0*	6.41E+00	0*	1.64E+01	0.00E+00
Contribution to materials for energy recovery	kg	1.29E-07	1.29E-07	0*	0*	0*	0*	0.00E+00
Contribution to exported energy	MJ	8.78E+00	8.25E-01	0*	7.95E+00	0*	0*	0.00E+00
Contribution to biogenic carbon content of the product	kg de C	0.00E+00	0*	0*	0*	0*	0*	0.00E+00
Contribution to biogenic carbon content of the associated packaging	kg de C	0.00E+00	0*	0*	0*	0*	0*	0.00E+00

* represents less than 0.01% of the total life cycle of the reference flow

Life cycle assessment performed with EIME version v5.9.4, database version 2022-01 in compliance with ISO14044.

Detailed results, including all the optional indicators mentioned in PCRed4, and the split of the Use Phase (B1 to B7), are available in the LCA report and on demand in a digital format - Country Customer Care Center - <http://www.schneider-electric.com/contact>

Please note that the values given above are only valid within the context specified and cannot be used directly to draw up the environmental assessment of an installation.

Registration number :	ENVPEP2304007_V1	Drafting rules	PEP-PCR-ed4-2021 09 06
Verifier accreditation N°		Supplemented by Information and reference documents	PSR-0010-ed1.1-2015 10 16 www.pep-ecopassport.org
Date of issue	2023/09/13	Validity period	5 years
Independent verification of the declaration and data, in compliance with ISO 14021 : 2016			
Internal	X	External	
The PCR review was conducted by a panel of experts chaired by Julie ORGELET (DDemain)			
PEP are compliant with XP C08-100-1 :2016 or EN 50693:2019			
The elements of the present PEP cannot be compared with elements from another program.			
Document in compliance with ISO 14021 : 2016 « Environmental labels and declarations. Type II environmental declarations »			

Schneider Electric Industries SAS
Country Customer Care Center
<http://www.schneider-electric.com/contact>
35, rue Joseph Monier
CS 30323
F- 92500 Rueil Malmaison Cedex
RCS Nanterre 954 503 439
Capital social 896 313 776 €

www.se.com

Published by Schneider Electric
©2023 - Schneider Electric – All rights reserved

2023/09/13