### **SpaceLogic** Sensors SCD2 Series Air Quality Sensors – BACnet and Modbus





#### **Product Description**

SpaceLogic SCD2 Series Air Quality Sensors are duct mount all-in-one sensors for monitoring air quality. The device combines CO<sub>2</sub>, temperature, humidity, VOC and particulate matter (PM) sensing into a single unit to ensure a building's optimum air quality and energy efficiency.

Each device is an active sensor that converts a measurement into BACnet MS/TP or Modbus RTU output.

As an integral part of Schneider Electric EcoStruxture<sup>™</sup> Building Operation (EBO) software, the SCD2 protocol models' Ready-Connect feature enables a plug & play experience for easy integration and configuration.

Different models are available based on application requirements for lower-cost installations.

SCD2 is available with an LCD display option on select models (see Available Products, page 2).

#### Features

- Field calibratable, non-dispersive infrared CO<sub>2</sub> sensor
   NDIR-based, dual-channel device compensates for drift and deterioration for high-accuracy output
- Solid state capacitive humidity sensor element recovers from 100% saturation
- Solid state temperature sensor providing high accuracy measurements
- Laser-scatter type PM sensor featuring innovative contamination resistance technology for highly accurate measurement of particulate matter
- Automatic Background Calibration for improved accuracy and field performance
- Easy to install:
  - Latch-on sensor cover
  - Screwless terminal block wiring with spring actuator
  - Rotating probe for best alignment with airflow
- Quick to commission with DIP switch selectable outputs: - BACnet, Modbus via RS-485
- 1% or 2% with NIST certificate, 2% RH module replaceable in the field
- 2-point calibration certificate available for humidity and temperature or temperature-only replaceable module
- Key component for the LEED green building program and WELL Building Standard\*

\*Leadership in Energy and Environmental Design (LEED) is a registered trademark of the US Green Building Council. The WELL Building Standard is a trademark of the International WELL Building Institute in the United States and other countries..

USA: +1 888-444-1311 Europe: +46 10 478 2000 Asia: +65 6484 7877 www.schneider-electric.com

C PM	voc	NDIR CO2	Temp. Transmitter	2% RH Sensor	LCD	Model Number
X X	Х	Х	Х	Х	Х	SCD2LP2AVP
(	Х	Х	Х	Х	Х	SCD2LP2AVX
X X	Х	Х	Х		Х	SCD2LPXAVP
(	Х	Х	Х		Х	SCD2LPXAVX
(	Х	Х			Х	SCD2LPXXVX
X X	Х	Х	Х	Х		SCD2XP2AVP
(	Х	Х	Х	Х		SCD2XP2AVX
Х	Х	Х	Х			SCD2XPXAVP
(	Х	Х	Х			SCD2XPXAVX
< ( ( (	X X X X X	X X X X X	X X X			SCD2LPXXVX SCD2XP2AVP SCD2XP2AVX SCD2XPXAVP

\*Note: Replaceable RH and temperature modules available to be ordered separately per table below.

#### Replaceable RH Elements & Temperature and Humidity Calibration Modules

Part Number	Description
SLXRHS1N	Replaceable RH sensor, 1% with NIST certificate
SLXRHS2N	Replaceable RH sensor, 2% with NIST certificate
SLXRHS2X	Replaceable RH sensor, 2%
SLXXT2*	Replaceable temperature module with 2-point calibration certificate
SLXRHT2*	Replaceable temperature and humidity module with 2-point calibration certificate

\*For temperature transmitter models only.

Note: For instructions on installing replaceable elements, see Z207941, Replacement Humidity and Temperature Sensors Installation Guide.

#### Safety Information Important Information

Read these instructions carefully and look at the equipment to become familiar with the device before trying to install, operate, service or maintain it. The following special message may appear throughout this bulletin or on the equipment to warn of potential hazards or to call attention to information that clarifies or simplifies a procedure.

#### NOTICE

NOTICE is used to address practices not related to physical injury.

#### **A**WARNING

WARNING indicates a hazardous situation which, if not avoided **could result in** death or serious injury.

#### **Please Note**

Electrical equipment should be installed, operated, serviced and maintained only by qualified personnel. No responsibility is assumed by Schneider Electric for any consequences arising out of the use of this material.

A qualified person is one who has the skills and knowledge related to the construction, installation and operation of electrical equipment and has received safety training to recognize and avoid the hazards involved.

#### Safety Precautions

#### A WARNING



HAZARD OF ELECTRIC SHOCK, EXPLOSION OR ARC FLASH

- Apply appropriate personal protective equipment (PPE) and follow safe electrical work practices. See NFPA 70E or CSA Z462.
- This equipment must only be installed and serviced by qualified electrical personnel.
- Turn off all power supplying this equipment before working on or inside equipment.
- Always use a properly rated voltage sensing device to confirm power is off.
- Replace all devices, doors and covers before turning on power to this equipment.

Failure to follow these instructions can result in death, serious injury or equipment damage.

This product is intended for use in HVAC and building environmental control applications.

It is not intended for direct medical monitoring of patients.

Read and understand these instructions before installing this product.

The installer is responsible for all applicable codes.

If this product is used in a manner not specified by the manufacturer, the protection provided by the product may be impaired. No responsibility is assumed by the manufacturer for any consequences arising out of the use of this material.




#### SpaceLogic Sensors, SCD2 Series Air Quality Sensors – BACnet and Modbus, Installation Instructions

Specifications		Temperature Sensor Option		
Operating and Storage	e Environment	Sensor transmitter type	Solid state, integrated circuit	
Operating temperature	0 to 50 °C (32 to 122 °F)	- Time constant	Air velocity 1.5 m/s. approx. 72 s;	
Operating humidity	0 to 95% RH (non-condensing)	- A agura gu/**	Air velocity 3.0 m/s. approx. 52 s	
Storage temperature	-25 to 70 °C (-13 to 158 °F)	Accuracy**	±0.2 °C (±0.4 °F) typical @ 25 °C	
Storage humidity	0 to 95% RH (non-condensing)	Resolution	0.1 °C (0.1 °F)	
Power supply	3-wire volt mode: 20 to 30 Vdc, 24 Vac, 50 to	Range	0 to 50 °C (32 to 131 °F)	
Output	60 Hz BACnet MS/TP, Modbus RTU	PM Sensor Option	Looor coottor	
	See Maximum Power Consumption table,	_ Sensor type	Laser-scatter	
Power consumption	page 8	Particulate size	PM1.0, PM2.5, PM4.0, PM10	
Tube length	200 mm	- Mass concentration	± 1 µg/m³	
Medium	Neutral gas, air	_ output range	0 to 1000 μg/m³	
Housing material	Polycarbonate; Flammability rating UL 94 V0	_	PM1 and PM2.5: 0 to 100 μg/m³ +/-[5μg/m³+5% m.v.], 100 to	
Mounting location	For indoor use only. Not suitable for wet locations.	Accuracy	1000 ug/m <sup>3</sup> +/-[10% m.v.] PM4 and PM10:***	
IP rating	IP 65	_	0 to 100 μg/m <sup>3</sup> +/-[25μg/m <sup>3</sup> ], 100 to 1,000 μg m <sup>3</sup> +/-[25% m.v.]	
Protection class	Class III		(sensor-to-sensor deviation)	
CO <sub>2</sub> Sensor				
Sensor type	Non-dispersive infrared (NDIR), diffusion sampling	LCD type	Positive display with backlight	
Output range	0 to 10,000 ppm		CO₂: ppm Temperature: °C or °F	
Accuracy	±30 ppm ±3% of measured value	<ul> <li>Measurement values displayed</li> </ul>	Humidity: % RH	
Repeatability	±20 ppm ±1% of measured value	_ , ,	VOC: % AQI PM: µg/m <sup>3</sup>	
Response time	<60 seconds for 90% step change		CO <sub>2</sub> : 1 ppm Humidity: 0.1% RH Temperature: 0.1 °C or °F VOC: 1% AQI	
Calibration	Field calibration support	<ul> <li>Display resolution</li> </ul>		
VOC Sensor Option		Display resolution		
Sensor type	Solid state	-	PM: 1 μg/m³	
Accuracy	±15% sensor-to-sensor variation	Wiring		
	Level Ventilation Recommendation	Wiring	Screwless terminal block with spring actuato 16-24 AWG	
	>61% Greatly increased		Download Modbus Device Type template fo	
	20 to 61% Significantly increased	<ul> <li>EBO integration</li> </ul>	Modbus models from the Building Application tool. Device import file and instructions:	
AQI table	10 to 20% Slightly increased		https://bms-applications.schneider-electric.	
	5 to 10% Average		com/type/MB/download/263	
	0 to 5% Target value	Warranty	-	
RH Sensor Option		<ul> <li>Limited warranty</li> <li>Regulatory Information</li> </ul>	2 years	
Sensor type	•			
Accuracy*	±2% from 10 to 80% RH @ 25 °C (77 °F) ±1%, ±2% replaceable models	_	UL 916 European conformance CE: EN61000-6-2, EN61000-6-3, EN61000	
Hysteresis	1.5% typical	Agency	Series immunity, EN 61326-1	
Linearity	Included in accuracy specification	approvals	FCC Part 15 Class A Green Premium (REACH, RoHS),	
Stability	±1% @ 20°C (68 °F) annually for 2 years	_	RoHS 2 (China), RCM (Australia), ICES-003	
Output range	0 to 100% RH	-	(Canada), UKCA (UK)	
Temperature coefficient	±0.1% RH/°C above or below 25 °C (77 °F) typical	<ul> <li>*Humidity sensor measurem temperature coefficient and **±0.5 °C over full operating</li> </ul>		


\*\*\*PM4 and PM10 output values are calculated based on the distribution profile of all measured particles.

USA: +1 888-444-1311 Europe: +46 10 478 2000 Asia: +65 6484 7877 www.schneider-electric.com

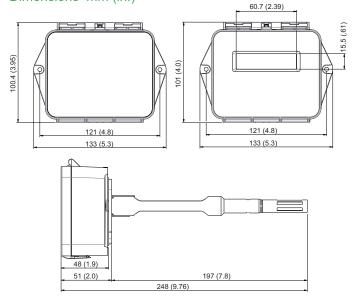


#### Installation


Prepare the duct for installation by drilling holes to accommodate the probe tubes for the PM sensor and CO<sub>2</sub>/VOC intake. Ensure the gasket on the back is depressed to prevent leakage between the product and the duct. Do not over-tighten the screws.



2. Ensure the probes are installed in the direction of the air flow. Install the probe in the middle of the duct and away from any restrictions to allow proper air flow.



3. Release the latch on the lid to access the DIP switches and terminal block.

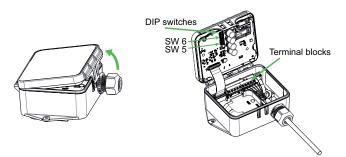


4. Wire the connections according to the diagram in the Wiring section. This device features spring terminals for screwless termination. Open the terminal point by inserting a screwdriver, then insert the wire above. Release the screwdriver to hold the wire in place. Details on wiring and configuration are contained in the next sections of this document.

#### NOTICE

- **MISSING TEMPERATURE & HUMIDITY READINGS**
- Ensure flex cable is in place after wiring.

Failure to follow these instructions can result in no temperature or humidity readings.





#### Installation (cont.)

 Secure the latch-on cover in the closed position and remove the clear protective mask on the front label of the device.



#### Wiring

#### NOTICE

PRODUCT DAMAGE DUE TO ELECTRO-STATIC DISCHARGE Circuit boards and components can be damaged by static electricity or electro-static discharge (ESD). Observe the following electro-static precautions when handling this product and cables and components connected to the product.

- Keep static-producing material such as plastic, upholstery, carpeting, etc. out of the immediate work area.
- Store the product in ESD-protective packaging when it is not installed in the panel
- When handling the product or a conductive cable/ESD-sensitive component connected to the product, wear a conductive wrist strap connected to ground through a minimum of 1 M $\Omega$  resistance
- Do not touch exposed conductors and component leads with skin or clothing.

Failure to follow these instructions can result in equipment damage.


#### NOTICE

#### INACCURATE READINGS

• Do not run wiring in the same conduit as AC power wiring. Close proximity to AC power may influence accuracy.

Failure to follow these instructions can result in reduced accuracy

#### Wiring Diagram




#### Configuration

#### Address Configuration

Each device on a single network must have a unique address. Set the DIP switch labeled "ADDRESS" to assign a unique address before the device is connected to the network. If an address is selected that conflicts with another device, neither device will be able to communicate.

Address the device as any whole number between and including 1 to 127. Note that zero is not a valid address for Modbus; zero is a valid address for BACnet. Positions 1 through 7 of the "ADDRESS" DIP switch designate the address. Position 8 toggles between the Modbus and BACnet communication protocols, as shown in the diagram below. This is the right bank of DIP switches on the sensor.



To set an address using the DIP switch, simply add the values of any switches that are in the ON position.

For example, an address of 73 is set as shown in the diagram below.

LSB	ON	2	3	4	5	6	7	8	= 73 MSB
	1	2	4	8	16	32	64		

Position number 1 has an ON value of 1, position number 4 has an ON value of 8 and position number 7 has an ON value of 64 (1 + 8 + 64 = 73).


#### **Communications Configuration**

See the Installation section, Step 3 for the location of the DIP switch. The following parameters are configurable:

- Parity (Modbus only): None, Odd, None1 (one stop bit), Even
- Baud rate: 9600, 19200, 38400, 57600 (Modbus), 76800 (BACnet)

USA: +1 888-444-1311 Europe: +46 10 478 2000 Asia: +65 6484 7877 www.schneider-electric.com

#### SpaceLogic Sensors, SCD2 Series Air Quality Sensors - BACnet and Modbus, Installation Instructions

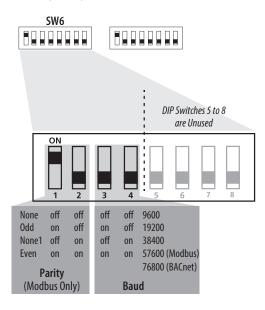

#### Example: No Parity, 19200 Baud

1	2	3	4	5	6	7	8
off	off	on	off	off	off	off	off
No	None 19200 Baud			Unu	ised	-	

#### Modbus Point Map Function Codes:

#### Function Codes.

Function Code	Function
03	Read holding (RW) registers
04	Read input (RO) registers
06	Write single register*
16	Write multiple registers
01	Read coils
05	Write single coil
15	Write multiple coils

\* Not supported.

All of these values correspond to BACnet objects with the same name. See the BACnet Conformance Statement for their definitions.

Note that an attempt to write to "read only" holding registers will give an error and the entire write command will not be executed even if writing to read/write locations were also requested. Exception code 2 is given in this case. "Preserved" means the values is maintained through power outages.

#### 16-Bit Register Location Description Format 1 Temp reading 32-bit floating point 2 3 Humidity reading 32-bit floating point 4 5~8 Unused NA 9 10 5x16-bit ASCII characters 11 Model number as a single query 12 13 14~41 Unused NA 42 43 4x16-bit ASCII characters Serial number as a single query 44 45

#### 32-Bit Holding Registers (Read/Write):

32-Bit Input Registers (Read Only):

16-Bit Register Location	Description	Format
1	Tomp option	22 bit floating point
2	- Temp setpoint	32-bit floating point
3	Humidity	22 bit floating point
4	setpoint	32-bit floating point
5	- Screen color set	20 + 2
6	- Screen color set	52-DIL
7~39	Device name	4x16-bit ASCII characters as a single query
40	Fan anod	32-bit
41	- Fan speed	32-DIL

Note: All holding registers are preserved during power outages.

#### Coils (Read/Write)

Register	Description
4*	Invoke CO <sub>2</sub> calibration
5*	Sets display (only) temperature units (1 = $^{\circ}F$ , 0 = $^{\circ}C$ )
11	Triggers the CO <sub>2</sub> FRC 400 command

\*Preserved during power outages.

#### **BACnet Descriptions**

Note: In the tables below, all properties are read-only unless otherwise noted. "Preserved" means the value is maintained through power outages.



#### **BACnet Descriptions (cont.)**

#### Present Value Range Restrictions

Object Name	Minimum Value	Maximum Value
DEV - Object_ Name	1 Character	65 Characters
Device_Instance	0	4,194,302

#### Standard Object Types Supported

Object Type	Supported Optional Properties	Writable Properties
Analog Input - Al	Reliability	None
Binary Value - BV	None	Present Value
Device - DEV	Max Info Frames Max_Master	APDU_Timeout Max_Master Object_Name

#### Objects Table

Object Name	Object Identifier	Object Property
Room Temperature	AI 1	Temperature in room (°C)
Room Humidity	AI 2	Humidity in room
CO2 Sensor	AI 3	CO <sub>2</sub> concentration
VOC Sensor	AI 4	VOC level
PM1 Sensor	AI 5	PM1.0 level
PM2.5 Sensor	AI 6	PM2.5 level
PM4 Sensor	AI 7	PM4.0 level
PM10 Sensor	AI 8	PM10.0 level
CO2 ABC Cal	BV3	ACTIVE enables ABC calibra- tion INACTIVE disables ABC cali- bration
Temperature Units*	BV4	ACTIVE displays temperature in Fahrenhiet INACTIVE displays temperature in Celsius
CO2 FRC 400	BV10	ACTIVE sets 400 ppm as CO <sub>2</sub> baseline after Present_Value is read INACTIVE leaves CO2 baseline in last state (no action)

#### Device Objects Table

Object Name	Object Identifier	Object Property	Descrip.
Plant Room Units XXXXXXXX	Vendor_ID + nnn	Object _Identifer (R/W)	Unique value where nnn initially is the MS/TP address

## BACnet Protocol Implementation Conformance Statement

Vendor Name: Schneider Electric

Product Name: Plant Room Air Quality Unit

Product Model: SCD2XPXXXX

**BACnet Protocol Version: 1** 

BACnet Protocol Revision: 16

Product Description: Environmental Sensor


BACnet Standardized Device Profile (AnnexL): BACnet Application Specific Controller (B-ASC)

#### CO<sub>2</sub> Sensor Calibration

There are two methods for CO<sub>2</sub> calibration available: 400 ppm baseline calibration and automatic baseline calibration (ABC).

#### 400 ppm Baseline Calibration

400 ppm baseline calibration allows the sensor to be set at 400 ppm. Push and hold the calibration button for 3 to 5 seconds. The LED will flash green. Once the button is released, calibration is complete and the LED switches off.



#### Automatic Baseline Calibration (ABC)

The ABC mode addresses the 400 ppm calibration. It allows turning on or off a background correction/recovery mode that will minimize any calibration error that has been caused by shock during handling and transportation or is caused by a long term shift in measurement. The ABC algorithm constantly keeps track of the sensor's lowest reading over a preconfigured time interval and slowly corrects for any long-term drift detected as compared to the expected fresh air value of 400 ppm. After initial startup, it is expected that the sensor reaches specified accuracy after 7 to 21 days.




#### LCD Operation

The screen displays sensor values for CO<sub>2</sub>, PM, VOC (if equipped), RH (if equipped), temperature and Celsius/Fahrenheit.


#### Single-Screen Operation



#### 3-Screen Operation



#### 4-Screen Operation



#### China RoHS Compliance Information

Environment-Friendly Use Period (EFUP) Table

部件名称	有害物质 - Hazardous Substances						
Part Name	铅 (Pb)	汞 (Hg)	镉 (Cd)	<b>六价</b> 铬 (Cr (VI))	<b>多溴</b> 联苯 (PBB)	多溴二苯醚 (PBDE)	
电子件 Electronic	Х	0	0	0	0	0	

#### 本表格依据SJ/T11364的规定编制。

O:表示该有害物质在该部件所有均质材料中的含量均在GB/T 26572规定的限量要求以下。

X:表示该有害物质至少在该部件的某一均质材料中的含量超出GB/T 26572规定的限量要求。


(企业可在此处,根据实际情况对上表中打 × 的技术原因进行进一步说明。)

This table is made according to SJ/T 11364.

O: indicates that the concentration of hazardous substance in all of the homogeneous materials for this part is below the limit as stipulated in GB/T 26572.

X: indicates that concentration of hazardous substance in at least one of the homogeneous materials used for this part is above the limit as stipulated in GB/T 26572

Z000057-0B



USA: +1 888-444-1311 Europe: +46 10 478 2000 Asia: +65 6484 7877 www.schneider-electric.com

#### Maximum Power Consumption

Series	LCD	CO <sub>2</sub> / VOC	PM	Temp./ RH	Max. Power
SCD2 Protocol	Yes	Yes	Yes	Yes	4VA @ 24VAC
	Yes	Yes	No	Yes	3VA @ 24VAC
	No	Yes	Yes	Yes	2VA @ 24VAC
	Yes	Yes	No	Yes	1.5VA @ 24VAC