

BLIND ACTUATOR (BA-M-8.230.1.X1)

PEP ecopassport® Product Environmental Profile





Document in compliance with ISO 14025: 2006 "Environmental labels and declarations. Type III environmental declarations"

ORGANIZATION		CONTACT INFORMATION
ABB Stotz-Kontakt Gm	bH	pia.denninghoff@de.abb.com
ADDRESS		WEBSITE
Eppelheimer Str. 82, 69	123 Heidelberg	https://new.abb.com/products/2CDG510029R0011
STATUS	SECURITY LEVEL	REGISTRATION NUMBER REV. LANG. PAGE
Approved	Public	ABBG-00277-V01.01-EN 1 en 1/11




ABB is committed to continually promoting and embedding sustainability across its operations and value chain, aspiring to become a role model for others to follow. With its ABB Purpose, ABB is focusing on reducing harmful emissions, preserving natural resources and championing ethical and humane behavior.

€ ¥ E E

General Information

Reference product	One Blind Actuator: BA-M-8.230.1.1 Blind Act,8f,230V (2CDG510029R0011)
Description of the product	The free@home Blind Actuator are modular installation devices (MDRC) in proM design, with 8 mutually independent outputs. They are designed for installation in electrical distribution boards and small housings with a 35 mm mounting rail. The outputs can be used individually via ABB / Busch- free@home for controlling shutters, blind drives or skylights (230 V AC). Scene function and forced operations (e.g., from a weather Sensor) are possible.
Functional unit	For controlling 8 independent blind or roller shutter drives. The bus can be connected via enclosed terminal block. The device has a degree of protection IP20. The reference for service life of the product is 10 years.
Other products covered	BA-M-8.230.1.11 BlindAct,8f,230V (2CDG510029R0021)

STATUS	SECURITY LEVEL	REGISTRATION NUMBER	REV.	LANG.	PAGE
Approved	Public	ABBG-00277-V01.01-EN	1	en	2/11
© Copyright 2022 ABB. All rights rese	erved.				

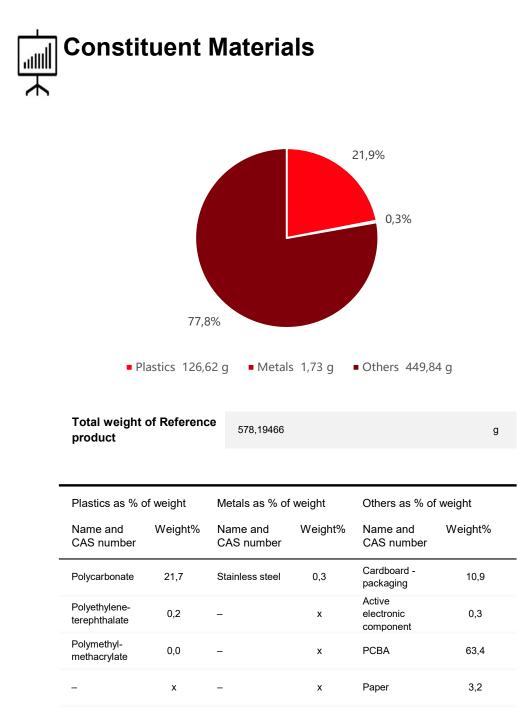

The product is in conformity with the provisions of RoHS directive 2011/65/EU, covering 2015/863(EU), REACH regulation No 1907/2006 and national legislation.

STATUS	SECURITY LEVEL	REGISTRATION NUMBER	REV.	LANG.	PAGE
Approved	Public	ABBG-00277-V01.01-EN	1	en	3/11

Additional Environmental Information

Manufacturing	The PCBA is manufactured at the Hornberg production site, while final assembly of all components into the Switch/shutter actuator happens at Lüdenscheid. No recycled material content is assumed. All components are transported by lorry from the supplier to these manufacturing sites. The electricity mix on the both manufacturing sites are largely renewable from Scandinavian hydropower and rooftop solar power (80% on Ludenscheid and 100% on Hornberg). Instead of hydropower, a German electricity market mix was modelled to avoid double counting of renewable energy. The remaining power and heating demand is met by combustion of natural gas, for which all CO2 emissions are compensated through ClimatePartner. Nevertheless, this compensation is not accounted for in the model of this EPD. Production waste is assumed to be transported by lorry (100 km by default in the PCR) and treated by recycling. Specific one-year data from 2022 on manufacturing site level was collected and allocated to the product by economic partitioning following the requirements of ISO 14044.
Distribution	The transport scenario is estimated based on the distance to the capital city of the countries it is sold to, according to the sales data for 2022.
Installation	Installation is done manually, without using energy or other auxiliary materials. For treatment of packaging waste, the scenario set by the PSR is followed.
Use	The reference product is on stand-by during 95% of the time with and energy consumption of 0,15W, and is in active mode with a maximum energy consumption of 0,25 W for the remaining 5% of the time. With a reference lifetime of 10 years and 8760 hours per year, this results in a power consumption of 13,58 kWh over the lifetime.
End of life	The standard scenario set in the PCR is considered, with parameters listed in Appendix D and a transport distance of 1000 km.
Benefits and loads beyond the system boundaries	Steel has a recovery rate of 80% according to the PCR. The Module D formula from the PCR was used to calculate the benefits of steel. Other materials were not included here, due to a material recovery rate of 0 or lack of recycling in real life scenarios.

STATUS	SECURITY LEVEL	REGISTRATION NUMBER	REV.	LANG.	PAGE				
Approved	Public	ABBG-00277-V01.01-EN	1	en	4/11				
© Copyright 2022 ABB. All rights res	© Copyright 2022 ABB. All rights reserved.								


Environmental Impacts

Reference lifetime	10 years
Product category	Other equipment
Installation elements	Not applicable
Use scenario	Active product
Geographical representativeness	DACH+ (Germany, Austria, Switzerland), Europe, MEA (Middle East and Africa) and Asia
Technological representativeness	Materials and process data are specific for the production of the Blind actuator
Software and database used	SimaPro version 9.5.0.1, Ecoinvent 3.9.1
Energy model used	
Manufacturing	Electricity, high voltage {DE} market for Cut-off, U Electricity, low voltage {DE} electricity production, photovoltaic, 3kWp slanted-roof installation, single-Si, panel, mounted Cut- off, U Natural gas, high pressure {DE} market for Cut-off, S
Manufacturing	Electricity, low voltage {DE} electricity production, photovoltaic, 3kWp slanted-roof installation, single-Si, panel, mounted Cut- off, U

TATUS	SECURITY LEVEL	REGISTRATION NUMBER	REV.	LANG.	PAGE
oproved	Public	ABBG-00277-V01.01-EN	1	en	5/11
oproved Copyright 2022 ABB. All I	1. 2002	ABBG-00277-V01.01-EN	1	en	5/

Not applicable

End of life

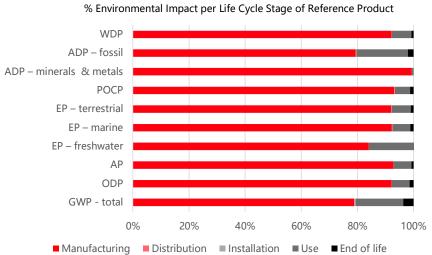

Common base of mandatory indicators

Indicator	Unit	Total	Manu- facturing	Distri- bution	Installation	Use	End of life	Bene- fits
GWP-total	kg CO ₂ eq.	3,80E+01	3,00E+01	8,31E-02	1,02E-01	6,44E+00	1,41E+00	-3,29E-0
GWP-fossil	kg CO ₂ eq.	3,69E+01	2,96E+01	8,30E-02	4,02E-03	5,87E+00	1,34E+00	-4,52E-0
GWP-biogenic	kg CO ₂ eq.	1,01E+00	2,91E-01	6,62E-05	9,83E-02	5,51E-01	7,48E-02	1,36E-0
GWP-luluc	kg CO ₂ eq.	6,64E-02	5,61E-02	3,73E-05	2,27E-06	1,01E-02	1,79E-04	-8,79E-0
GWP-fossil = Globa GWP-biogenic = Gl GWP-luluc = Globa	obal Warming	Potential bio	ogenic	e change				
ODP	kg CFC-11 eq.	1,12E-06	1,03E-06	1,76E-09	1,30E-10	7,07E-08	1,57E-08	-1,42E-0
ODP = Depletion po	otential of the s	stratospheric	ozone layer					
AP	H+ eq.	2,87E-01	2,66E-01	2,52E-04	2,42E-05	1,82E-02	2,08E-03	-2,52E-0
AP = Acidification p	otential, Accur	nulated Exce	eedance					
EP-freshwater	kg P eq.	5,39E-03	4,53E-03	6,36E-07	8,13E-08	8,51E-04	7,65E-06	-3,81E-0
		-,	.,	0,00E 01	0,10E 00	0,012 01	.,	
EP-marine	kg N eq.	4,38E-02	4,04E-02	8,52E-05	9,80E-06	2,78E-03	5,02E-04	-1,38E-0
EP-terrestrial	kg N eq. mol N eq.	4,38E-02 5,15E-01	4,04E-02 4,74E-01	8,52E-05 9,10E-04	9,80E-06 1,01E-04	2,78E-03 3,48E-02		
	kg N eq. mol N eq. trophication pot hication poten rophication pot	4,38E-02 5,15E-01 otential, fractitial, fraction	4,04E-02 4,74E-01 ion of nutrients of nutrients rea	8,52E-05 9,10E-04 reaching freshw ching marine en	9,80E-06 1,01E-04 ater end compart	2,78E-03 3,48E-02	5,02E-04	-7,50E-0
EP-terrestrial EP-freshwater = Eu EP-marine = Eutrop EP-terrestrial = Eutr	kg N eq. mol N eq. trophication pot hication poten cophication pot kg NMVOC eq.	4,38E-02 5,15E-01 otential, fraction tential, Accur 1,86E-01	4,04E-02 4,74E-01 ion of nutrients of nutrients rea nulated Exceed 1,73E-01	8,52E-05 9,10E-04 reaching freshw ching marine en jance	9,80E-06 1,01E-04 ater end compart d compartment	2,78E-03 3,48E-02 ment	5,02E-04 5,13E-03	-7,50E-0
EP-terrestrial EP-freshwater = Eu EP-marine = Eutrop EP-terrestrial = Eutro POCP	kg N eq. mol N eq. trophication pot hication poten cophication pot kg NMVOC eq.	4,38E-02 5,15E-01 otential, fraction tential, Accur 1,86E-01	4,04E-02 4,74E-01 ion of nutrients of nutrients rea nulated Exceed 1,73E-01	8,52E-05 9,10E-04 reaching freshw ching marine en jance	9,80E-06 1,01E-04 ater end compart d compartment	2,78E-03 3,48E-02 ment	5,02E-04 5,13E-03	-1,38E-0 -7,50E-0 -2,01E-0 -3,16E-0
EP-terrestrial EP-freshwater = Eur EP-marine = Eutrop EP-terrestrial = Eutrop POCP POCP = Formation ADP-minerals	kg N eq. mol N eq. trophication poten rophication poten rophication poten kg NMVOC eq. potential of tro	4,38E-02 5,15E-01 otential, fract tial, fraction ential, Accur 1,86E-01	4,04E-02 4,74E-01 ion of nutrients of nutrients rea nulated Exceed 1,73E-01 zone	8,52E-05 9,10E-04 reaching freshw ching marine en dance 3,78E-04	9,80E-06 1,01E-04 ater end compart d compartment 2,82E-05	2,78E-03 3,48E-02 ment 1,01E-02	5,02E-04 5,13E-03 2,31E-03	-7,50E-C -2,01E-C -3,16E-C
EP-terrestrial EP-freshwater = Eu EP-marine = Eutrop EP-terrestrial = Eutro POCP POCP = Formation ADP-minerals & metals	kg N eq. mol N eq. trophication poten rophication poten rophication poten rophication pot kg NMVOC eq. potential of tro kg Sb eq. MJ ttals = Abiotic	4,38E-02 5,15E-01 otential, fraction ential, fraction 1,86E-01 opospheric oz 1,13E-02 4,92E+02 depletion pot	4,04E-02 4,74E-01 ion of nutrients of nutrients rea mulated Exceed 1,73E-01 zone 1,12E-02 3,91E+02 tential for non-fit	8,52E-05 9,10E-04 reaching freshw ching marine en dance 3,78E-04 2,58E-07 1,14E+00	9,80E-06 1,01E-04 ater end compart d compartment 2,82E-05 1,00E-08	2,78E-03 3,48E-02 ment 1,01E-02 6,48E-05	5,02E-04 5,13E-03 2,31E-03 1,25E-06	-7,50E-C -2,01E-C -3,16E-C
EP-terrestrial EP-freshwater = Eu EP-marine = Eutrop EP-terrestrial = Eutrop POCP POCP = Formation ADP-minerals & metals ADP-fossil ADP-minerals & me	kg N eq. mol N eq. trophication poten rophication poten rophication poten rophication pot kg NMVOC eq. potential of tro kg Sb eq. MJ ttals = Abiotic	4,38E-02 5,15E-01 otential, fraction ential, Accur 1,86E-01 opospheric 02 1,13E-02 4,92E+02 depletion pot fossil resource	4,04E-02 4,74E-01 ion of nutrients of nutrients rea mulated Exceed 1,73E-01 zone 1,12E-02 3,91E+02 tential for non-fit	8,52E-05 9,10E-04 reaching freshw ching marine en dance 3,78E-04 2,58E-07 1,14E+00	9,80E-06 1,01E-04 ater end compart d compartment 2,82E-05 1,00E-08	2,78E-03 3,48E-02 ment 1,01E-02 6,48E-05	5,02E-04 5,13E-03 2,31E-03 1,25E-06	-7,50E-C -2,01E-C -3,16E-C -5,93E-C
EP-terrestrial EP-freshwater = Eu EP-marine = Eutrop EP-terrestrial = Eutro POCP POCP = Formation ADP-minerals & metals ADP-fossil ADP-fossil = Abiotic	kg N eq. mol N eq. trophication poten rophication poten rophication poten kg NMVOC eq. potential of tro kg Sb eq. MJ tals = Abiotic - c depletion for m ³ eq. depr.	4,38E-02 5,15E-01 otential, fraction ential, fraction ential, Accur 1,86E-01 1,86E-01 1,13E-02 4,92E+02 depletion pot fossil resour 7,72E+00	4,04E-02 4,74E-01 ion of nutrients rea mulated Exceed 1,73E-01 zone 1,12E-02 3,91E+02 tential for non-fic ces potential	8,52E-05 9,10E-04 reaching freshw ching marine en Jance 3,78E-04 2,58E-07 1,14E+00 osssil resources	9,80E-06 1,01E-04 ater end compart d compartment 2,82E-05 1,00E-08 4,12E-02	2,78E-03 3,48E-02 ment 1,01E-02 6,48E-05 9,03E+01	5,02E-04 5,13E-03 2,31E-03 1,25E-06 9,97E+00	-7,50E-0 -2,01E-0 -3,16E-0 -5,93E-0

© Copyright 2022 ABB. All rights reserved.

Common base of mandatory indicators

Inventory flows indicator - Resource use indicators

Indicator	Unit	Total	Manu- facturing	Distri- bution	Installation	Use	End of life	Bene- fits
PERE	MJ	7,10E+01	4,56E+01	1,99E-02	5,45E-03	2,53E+01	1,02E-01	-5,09E-02
PERM	MJ	9,49E-01	9,49E-01	0,00E+00	0,00E+00	0,00E+00	0,00E+00	-4,22E-01
PERT	MJ	7,19E+01	4,65E+01	1,99E-02	5,45E-03	2,53E+01	1,02E-01	-4,73E-01
PENRE	MJ	4,92E+02	3,91E+02	1,14E+00	4,12E-02	9,03E+01	9,97E+00	-5,92E-01
PENRM	MJ	1,40E-01	1,40E-01	0,00E+00	0,00E+00	0,00E+00	0,00E+00	0,00E+00
PENRT	MJ	4,92E+02	3,91E+02	1,14E+00	4,12E-02	9,03E+01	9,97E+00	-5,92E-01

PERE = Use of renewable primary energy excluding renewable primary energy resources used as raw materials

PERM = Use of renewable primary energy resources used as raw materials

PERT = Total Use of renewable primary energy resources

PENRE = Use of non-renewable primary energy excluding non-renewable primary energy resources used as raw materials

PENRM = Use of non-renewable primary energy resources used as raw materials

PENRT = Total Use of non-renewable primary energy resources

Inventory flows indicator - Indicators describing the use of secondary materials, water, and energy resources

Indicator	Unit	Total	Manu- facturing	Distri- bution	Installation	Use	End of life	Bene- fits
SM	kg	0,00E+00	0,00E+00	0,00E+00	0,00E+00	0,00E+00	0,00E+00	0,00E+00
RSF	MJ	0,00E+00	0,00E+00	0,00E+00	0,00E+00	0,00E+00	0,00E+00	0,00E+00
NRSF	MJ	0,00E+00	0,00E+00	0,00E+00	0,00E+00	0,00E+00	0,00E+00	0,00E+00
FW	m³	2,98E-01	2,48E-01	1,64E-04	8,35E-05	4,81E-02	1,83E-03	-8,35E-04
SM = Use of seco RSF = Use of ren	· · · · · · · · · · · · · · · · · · ·							

NRSF = Use of non-renewable secondary fuels

FW = Use of net fresh water

Inventory flows indicator - Waste category indicators

Indicator	Unit	Total	Manu- facturing	Distri- bution	Installation	Use	End of life	Bene- fits
Hazardous waste disposed	kg	6,97E-03	5,43E-03	0,00E+00	0,00E+00	0,00E+00	1,54E-03	0,00E+00
Non- hazardous waste disposed	kg	2,83E-01	1,26E-01	0,00E+00	1,13E-02	0,00E+00	1,46E-01	0,00E+00
Radioactive waste disposed	kg	0,00E+00	0,00E+00	0,00E+00	0,00E+00	0,00E+00	0,00E+00	0,00E+00

STATUS	SECURITY LEVEL	REGISTRATION NUMBER	REV.	LANG.	PAGE
Approved	Public	ABBG-00277-V01.01-EN	1	en	7/11
© Copyright 2022 ABB. All rights res	erved.				

Common base of mandatory indicators

Inventory flows indicator – Output flow indicators

Indicator	Unit	Total	Manu- facturing	Distri- bution	Installation	Use	End of life	Bene- fits
Components for re- use	kg	0,00E+00	0,00E+00	0,00E+00	0,00E+00	0,00E+00	0,00E+00	0,00E+00
Materials for recycling	kg	8,41E-01	7,88E-01	0,00E+00	5,15E-02	0,00E+00	1,34E-03	0,00E+00
Materials for energy recovery	kg	0,00E+00	0,00E+00	0,00E+00	0,00E+00	0,00E+00	0,00E+00	0,00E+00
Exported energy	MJ	0,00E+00	0,00E+00	0,00E+00	0,00E+00	0,00E+00	0,00E+00	0,00E+00

Inventory flow indicator – other indicators

Indicator	Unit	Total	Manu- facturing	Distri- bution	Installation	Use	End of life	Bene- fits
Biogenic carbon content of the product	kg of C	0,00E+00	-7,10E-03	0,00E+00	0,00E+00	0,00E+00	7,10E-03	0,00E+00
Biogenic carbon content of the associated packaging	kg of C	0,00E+00	-2,85E-02	0,00E+00	2,85E-02	0,00E+00	0,00E+00	0,00E+00

	ATUS	SECURITY LEVEL	REGISTRATION NUMBER	REV.	LANG.	PAGE
Approved Public ABBG-00277-V01.01-EN 1 en 8/1	proved	Public	ABBG-00277-V01.01-EN		1 en	8/11

Optional indicators

Environmental indicators

Indicator	Unit	Total	Manu- facturing	Distri- bution	Installation	Use	End of life	Bene- fits
Total use of primary energy during the life cycle	MJ	5,64E+02	4,37E+02	1,16E+00	4,67E-02	1,16E+02	1,01E+01	-1,06E+00
Emissions of fine particles	incidence of diseases	1,82E-06	1,70E-06	5,50E-09	2,59E-10	7,84E-08	2,66E-08	-3,10E-09
lonizing radiation, human health	kBq U235 eq.	1,64E+00	1,24E+00	6,68E-04	6,35E-05	3,93E-01	3,06E-03	-1,84E-03
Ecotoxicity (fresh water)	CTUe	7,41E+02	6,87E+02	6,10E-01	1,24E-01	1,12E+01	4,29E+01	-4,47E-01
Human toxicity, car-cinogenic effects	CTUh	5,57E-08	5,18E-08	3,39E-11	6,26E-12	2,18E-09	1,64E-09	-7,06E-11
Human toxicity, non- carcinogenic effects	incidence of diseases	1,53E-06	1,41E-06	9,96E-10	2,63E-10	1,04E-07	1,38E-08	-6,57E-10
Impact related to land use/soil quality		2,23E+02	1,99E+02	5,83E-01	3,25E-02	2,16E+01	1,96E+00	-2,12E+00

Other indicators

Indicator	Unit	Total	Manu- facturing	Distri- bution	Installation	Use	End of life	Bene- fits
Photochemical oxidation	kg C2H4 eq	2,82E-02	2,73E-02	5,79E-06	7,13E-07	7,92E-04	1,03E-04	-1,18E-05
Acidification	kg SO2 eq	2,35E-01	2,19E-01	1,01E-04	1,77E-05	1,50E-02	1,67E-03	-1,82E-04
Eutrophication	kg PO4 eq	3,42E-02	3,02E-02	1,69E-05	5,23E-06	3,77E-03	2,21E-04	-7,54E-05

STATUS	SECURITY LEVEL	REGISTRATION NUMBER	REV.	LANG.	PAGE
Approved	Public	ABBG-00277-V01.01-EN	1	en	9/11

Environmental Impact Indicator Glossary

Impact indicators

Indicator	Description	Distri- bution
Global warming potential (GWP) - total	Indicator of potential global warming caused by emissions to air contributing to the greenhouse effect. The total global warming potential (GWP-total) is the sum of three sub-categories of climate change. GWP-total = GWP-fossil + GWP-biogenic + GWP- land use and land use change	kg CO₂ eq.
Ozone depletion (ODP)	Emissions to air that contribute to the destruction of the stratospheric ozone layer	kg CFC-11 eq.
Acidification of soil and water (A)	Acidification of soils and water caused by the release of certain gases to the atmosphere, such as nitrogen oxides and sulphur oxides	H+ eq.
Eutrophication (E)	Indicator of the contribution to eutrophication of water by the enrichment of the aquatic ecosystem with nutritional elements, e.g. industrial or domestic effluents, agriculture, etc. This indicator is divided to three: freshwater, marine and terrestrial.	kg P eq., kg N eq., mole N eq.
Photochemical ozone creation (POCP)	Indicator of emissions of gases that affect the creation of photochemical ozone in the lower atmosphere (smog) because of the rays of the sun.	kg NMVOC eq.
Depletion of abiotic resources – elements (ADPe)	Indicator of the depletion of natural non-fossil resources	kg Sb eq.
Depletion of abiotic resources – fossil fuels (ADPf)	The use of non-renewable fossil resources in an unsustainable way (e.g. from material to waste)	MJ (lower heating value)
Water Deprivation potential (WDP)	Deprivation-weighted water consumption. Assesses the potential of water deprivation, to either humans or ecosystems, building on the assumption that the less water remaining available per area, the more likely another user will be deprived.	m³ eq. depr.

Resource use indicators

Indicator	Description	Distri- bution
Total use of primary energy	Total use of non-renewable primary energy resources (primary energy and primary energy resources used as raw materials) + Total use of renewable primary energy re-sources (primary energy and primary energy resources used as raw materials)	MJ (lower heating value)

SECURITY LEVEL	REGISTRATION NUMBER	REV.	LANG.	PAGE
Public	ABBG-00277-V01.01-EN	1	en	10/11

Registration number: ABBG-00277-V01.01-EN	Drafting Rules: PCR-ed4-EN-2021 09 06
	Supplemented by: PSR-0005-ed3-EN-2023 06 06
Verifier accreditation number: VH44	Information and reference documents: www.pep-ecopassport.org
Date of issue: 23/05/2024	Validity period: 5 years
Independent verification of the declaration and data, in com	pliance with ISO 14025: 2006
Internal: O External: O	
The PCR review was conducted by a panel of experts chaired t	by Julie Orgelet (DDemain)
PEP are compliant with XP C08-100-1:2016 and EN 50693:201 The elements of the present PEP cannot be compared with ele	
Document in compliance with ISO 14025: 2006 "Environmenta environmental declarations"	al labels and declarations. Type III

STATUS	SECURITY LEVEL	REGISTRATION NUMBER	REV.	LANG.	PAGE
Approved	Public	ABBG-00277-V01.01-EN	1	en	11/11