

AIR CONDITIONER (2-way Air Discharge Cassette Type)

Auxiliary fresh air flange

Model: TCB-FF151US-E

Thank you for purchasing the "Auxiliary fresh air flange" of TOSHIBA Air Conditioner. Before starting the installation work, please read this manual carefully and install the product properly.

CAUTION

Wear protective gloves and safety work clothing during installation.

1 ACCESSORIES

Name		Q'ty	Name		Q'ty
Auxiliary fresh air flange (ø150mm)		1	Screw (4 x 12mm)		4
Seal heat insulator A		2	Seal heat insulator B		2

2 Arrange a flexible duct (locally procured). It is necessary to install auxiliary fresh air flange.


3 INSTALLATION PROCEDURE

- Using the knockout of the indoor unit, as a marker, cut off the steel plate with the heat insulator (styrol) with cutting pliers or cutter.


NOTE

When cutting off the styrol inside, be careful not to insert the cutter blade deeper than 30mm. (Damage to the indoor unit inside can cause malfunction.)

Wear safety globes to carry out these works. Do not attempt with bare hands.

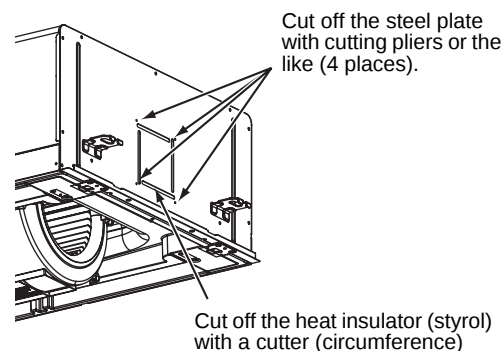

- A gap between the styrol and steel plate may cause a trouble such as condensation. Be sure to attach the attached heat insulator A first with it aligned to the screw hole, and then attach seal heat insulator B, according to the following figure.

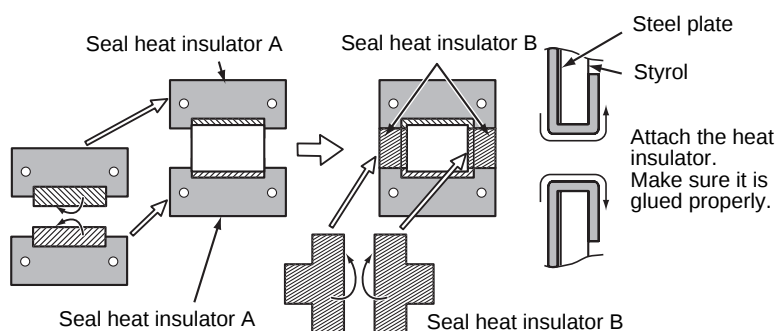

- Install the auxiliary fresh air flange to the indoor unit with attached 4 fixing screws.