

TOSHIBA

Leading Innovation >>>

E17-342



Engineering Data Book

Air to Water Heat Pump



Hydro Unit

- | | |
|-----------------|------------------|
| HWS-455XWHM3-E | HWS-P805XWHM3-E |
| HWS-805XWHM3-E | HWS-P805XWHT6-E |
| HWS-805XWHT6-E | HWS-P805XWHT9-E |
| HWS-805XWHT9-E | HWS-P1105XWHM3-E |
| HWS-1405XWHM3-E | HWS-P1105XWHT6-E |
| HWS-1405XWHT6-E | HWS-P1105XWHT9-E |
| HWS-1405XWHT9-E | |



Outdoor Unit

- | | |
|--------------|---------------|
| HWS-455H-E | HWS-1605H8-E |
| HWS-805H-E | HWS-1105H8R-E |
| HWS-1105H-E | HWS-1405H8R-E |
| HWS-1405H-E | HWS-1605H8R-E |
| HWS-1105H8-E | HWS-P805HR-E |
| HWS-1405H8-E | HWS-P1105HR-E |



Hot Water Cylinder

- | |
|-----------------|
| HWS-1501CSHM3-E |
| HWS-2101CSHM3-E |
| HWS-3001CSHM3-E |

Contents

1. INTRODUCTION	2
2. SYSTEM OVERVIEW	6
2-1. System Combination	7
2-2. Hydro Unit	8
2-3. Outdoor Unit	9
2-4. Hot Water Cylinder	10
2-5. Options	10
3. SYSTEM SPECIFICATION	11
4. HYDRO UNIT	14
4-1. Specification	15
4-2. Dimension	22
4-3. Piping Diagram	24
4-4. Wiring Diagram	26
4-5. Capacity Tables	33
4-6. Part Load Tables	78
4-7. Q-H characteristics of hydro unit	150
4-8. Options	152
5. OUTDOOR UNIT	154
5-1. Specification	155
5-2. Dimension	161
5-3. Piping Diagram	164
5-4. Wiring Diagram	166
5-5. Sound Data	172
5-6. Operation Range	174
6. HOT WATER CYLINDER	177
6-1. Specification	178
6-2. Dimension	179
6-3. Piping Diagram	180
6-4. Wiring Diagram	182

1. INTRODUCTION




TOSHIBA AIRCONDITIONING
Advancing the **eco**-evolution

Air to water Heat Pump System

- World-leading energy efficiency — COP of 4.77*
- Comfortable heating and hot water supply
- Versatile installation and operation * 11 kW model

Welcome Estia to your home!
Air-to-water Heat Pump System

Introducing Toshiba's super-efficient space heating and hot water supply system for homes and businesses. Estia represents breakthrough thinking in intelligent heat pump and inverter technologies, by efficiently transferring ambient thermal heat from outside air to heat water indoors. Based on Toshiba's proven light commercial air conditioning system, the Super Digital Inverter, this innovative unit features DC twin rotary compressor, DC inverter and R410A refrigerant, providing the highest coefficient of performance (COP) in its class. This means more power from less energy consumption, and the ideal ecological and economical solution for your home.

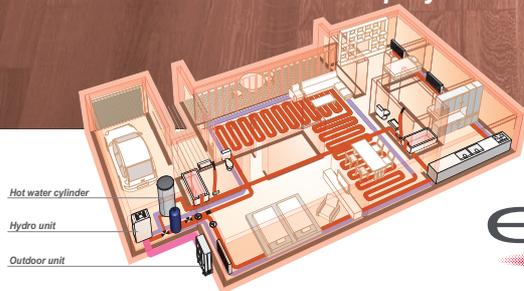

Advantages

World-leading energy efficiency - COP of 4.88*

With its best in class COP performance, Estía air to water heat pump system delivers more heating power with less energy consumption.

Estía uses high quality components and material which contribute to the overall savings in energy consumption.

With the Toshiba advanced inverter, Estía air to water heat pump system only delivers the heating capacity required; thus consuming only the necessary electricity.

The hot water temperature is also optimized thanks to Toshiba advanced control depending on the outside air temperature. The milder outside, the air-to-water systems automatically produces lower water temperature to anticipate decreased needs of space heating. The same control logic allows to anticipate as well increasing heating needs when weather conditions become extreme; this overall temperature management gives the best conditions of comfort.

All this saving has a positive impact on the personal electricity bill and the whole community by reducing the CO₂ emissions in the atmosphere.



*11kW model

Easy to install

Quick and easy to install. The hydro module unit can be placed safely in the most suitable place within the house.

There's no need for chimney or underground captors which require additional works on site.

The compact outdoor unit can be placed anywhere outside the house or on a balcony, thanks to extensive piping options.



Environment conscious

The use of Toshiba Estía heat pump contribute to the reduction of global CO₂ emissions in the atmosphere and limit the use of fossil fuels or other non-renewable energy primary sources.

Whenever required for maintenance purpose, all the R410A refrigerant (non ozone depleting) can be completely sucked back to the outdoor unit through the powerful embedded Toshiba "pump down" operation.



One system, multiple solutions

Estía heat pump systems can be used in combination with different types of emitters: existing heating low temperature radiators, floor heating or fan coil units.



The right temperature at the right time


It can produce water at different temperatures for several applications simultaneously.

Toshiba Estía air to water heat pump system operates smoothly both with low outdoor air temperature down to -20 °C in winter and up to 43 °C in the summer season. The system has a unique anti-ice build-up protection embedded.



One system, full combination flexibility

For new houses or refurbishment Estia heat pump offers a variety of combinations, some examples are shown below:

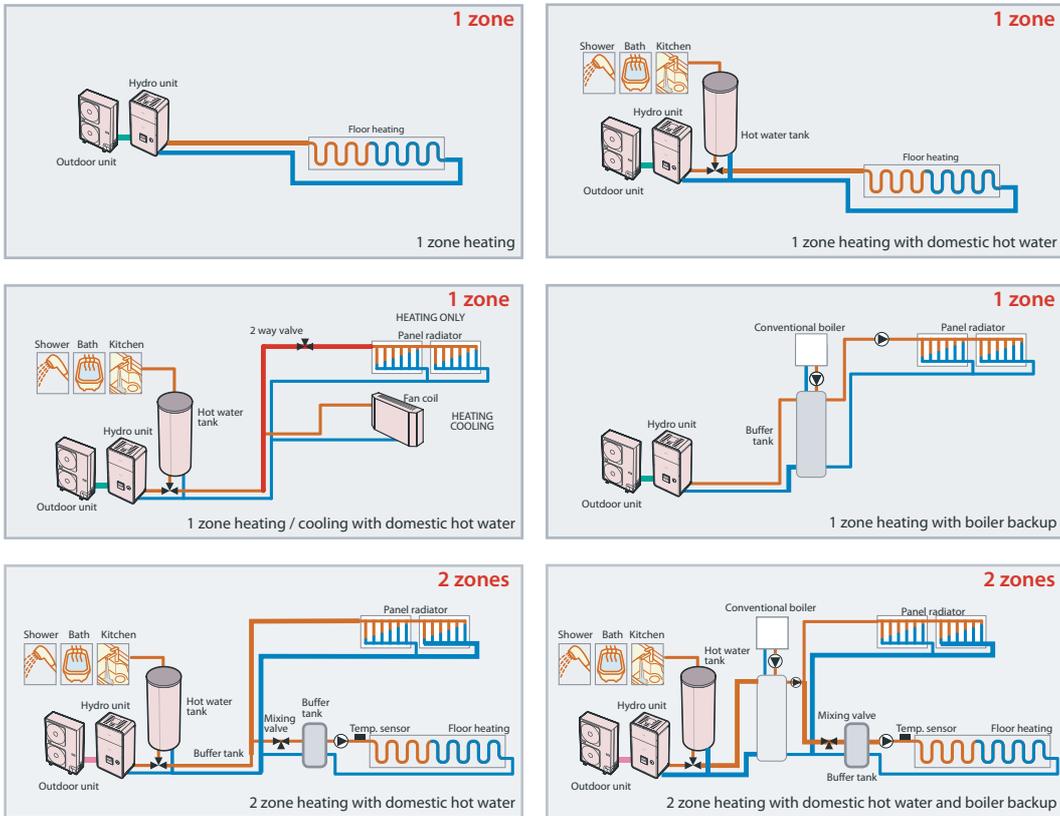

In existing dwellings already equipped with traditional gas or fuel boilers, Toshiba Estia air to water heat pump system can be combined with the existing heating system to cover exclusively and in an optimized way all the heating needs, all year round. Then, the boiler is only used as a back-up source during some extreme weather days of the winter.

The intelligent Toshiba control balances the energy source in the most efficient way.



2. SYSTEM OVERVIEW

2-1. System Combination

Combination

Standard type

Hydro Unit	Outdoor Unit										Backup heater
	HWS-455H-E	HWS-805H-E	HWS-1105H-E	HWS-1405H-E	HWS-1105H8-E	HWS-1405H8-E	HWS-1605H8-E	HWS-1105H8R-E	HWS-1405H8R-E	HWS-1605H8R-E	
HWS-455XWHM3-E	○	-	-	-	-	-	-	-	-	-	~, 3 kW
HWS-805XWHM3-E	-	○	-	-	-	-	-	-	-	-	~, 3 kW
HWS-805XWHT6-E	-	○	-	-	-	-	-	-	-	-	3N~, 6 kW
HWS-805XWHT9-E	-	○	-	-	-	-	-	-	-	-	3N~, 9 kW
HWS-1405XWHM3-E	-	-	○	○	○	○	○	○	○	○	~, 3 kW
HWS-1405XWHT6-E	-	-	○	○	○	○	○	○	○	○	3N~, 6 kW
HWS-1405XWHT9-E	-	-	○	○	○	○	○	○	○	○	3N~, 9 kW
220-230 V model					3 phase model			3 phase with Cord Heater			

		Hot water cylinder		
		HWS-1501 CSHM3-E	HWS-2101 CSHM3-E	HWS-3001 CSHM3-E
Hydro unit	HWS-455XWHM3-E			
	HWS-805XWHM3-E			
	HWS-805XWHT6-E			
	HWS-805XWHT9-E		●	
	HWS-1405XWHM3-E			
	HWS-1405XWHT6-E			
	HWS-1405XWHT9-E			

Powerful type

Hydro Unit	Outdoor Unit		Backup heater
	HWS-P805HR-E	HWS-P1105HR-E	
HWS-P805XWHM3-E	●	-	~, 3 kW
HWS-P805XWHT6-E	●	-	3N~, 6 kW
HWS-P805XWHT9-E	●	-	3N~, 9 kW
HWS-P1105XWHM3-E	-	●	~, 3 kW
HWS-P1105XWHT6-E	-	●	3N~, 6 kW
HWS-P1105XWHT9-E	-	●	3N~, 9 kW
Single phase model			

		Hot water cylinder		
		HWS-1501 CSHM3-E	HWS-2101 CSHM3-E	HWS-3001 CSHM3-E
Hydro unit	HWS-P805XWHM3-E			
	HWS-P805XWHT6-E			
	HWS-P805XWHT9-E			
	HWS-P1105XWHM3-E		●	
	HWS-P1105XWHT6-E			
	HWS-P1105XWHT9-E			

2-2. Hydro Unit

Standard type

4.5 kW model

Hydro Unit		HWS-455XWHM3-E
Back up heater capacity	(kW)	3.0
Power supply	for back up heater	220-230 V ~ 50 Hz
	for hot water cylinder heater (option)	220-230 V ~ 50 Hz
Leaving water temperature	Heating (°C)	20-55
	Cooling (°C)	7-25

8 kW model

Hydro Unit		HWS-805XWHM3-E	HWS-805XWHT6-E	HWS-805XWHT9-E
Back up heater capacity	(kW)	3.0	6.0	9.0
Power supply	for back up heater	220-230 V ~ 50 Hz	380-400 V 3N~ 50 Hz	380-400 V 3N~ 50 Hz
	for hot water cylinder heater (option)	220-230 V ~ 50 Hz		
Leaving water temperature	Heating (°C)	20-55		
	Cooling (°C)	7-25		

11 kW, 14 kW, 16 kW model

Hydro Unit		HWS-1405XWHM3-E	HWS-1405XWHT6-E	HWS-1405XWHT9-E
Back up heater capacity	(kW)	3.0	6.0	9.0
Power supply	for back up heater	220-230 V ~ 50 Hz	380-400 V 3N~ 50 Hz	380-400 V 3N~ 50 Hz
	for hot water cylinder heater (option)	220-230 V ~ 50 Hz		
Leaving water temperature	Heating (°C)	20-55		
	Cooling (°C)	7-25		

Powerful type

80 kW model

Hydro Unit		HWS-P805XWHM3-E	HWS-P805XWHT6-E	HWS-P805XWHT9-E
Back up heater capacity	(kW)	3.0	6.0	9.0
Power supply	for back up heater	220-230 V ~ 50 Hz	380-400 V 3N~ 50 Hz	380-400 V 3N~ 50 Hz
	for hot water cylinder heater (option)	220-230 V ~ 50 Hz		
Leaving water temperature	Heating (°C)	20-60		
	Cooling (°C)	7-25		

112 kW model

Hydro Unit		HWS-P1105XWHM3-E	HWS-P1105XWHT6-E	HWS-P1105XWHT9-E
Back up heater capacity	(kW)	3.0	6.0	9.0
Power supply	for back up heater	220-230 V ~ 50 Hz	380-400 V 3N~ 50 Hz	380-400 V 3N~ 50 Hz
	for hot water cylinder heater (option)	220-230 V ~ 50 Hz		
Leaving water temperature	Heating (°C)	20-60		
	Cooling (°C)	7-25		

2-3. Outdoor Unit

Standard type

Single Phase model

Outdoor unit		HWS-455H-E	HWS-805H-E	HWS-1105H-E	HWS-1405H-E
Power supply		220-230 V ~ 50 Hz			
Type		INVERTER			
Function		Heating & Cooling			
Heating	Capacity (kW)	4.5	8.0	11.2	14.0
	Input (kW)	0.92	1.79	2.30	3.11
	COP (W/W)	4.90	4.46	4.88	4.50
Cooling	Capacity (kW)	4.5	6.0	10.0	11.0
	Input (kW)	1.46	1.94	3.26	3.81
	EER (W/W)	3.08	3.10	3.07	2.89
Refrigerant		R410A			
Dimension	HxWxD (mm)	630x800x300	890x900x320	1,340x900x320	

3 Phase model

Outdoor unit		with Cord heater					
		HWS-1105H8-E	HWS-1405H8-E	HWS-1605H8-E	HWS-1105H8R-E	HWS-1405H8R-E	HWS-1605H8R-E
Power supply		380-400 V 3N~ 50 Hz					
Type		INVERTER					
Function		Heating & Cooling					
Heating	Capacity (kW)	11.2	14.0	16.0	11.2	14.0	16.0
	Input (kW)	2.34	3.16	3.72	2.34	3.16	3.72
	COP	4.80	4.44	4.30	4.80	4.44	4.30
Cooling	Capacity (kW)	10.0	11.0	13.0	10.0	11.0	13.0
	Input (kW)	3.26	3.81	4.80	3.26	3.81	4.80
	EER	3.07	2.89	2.71	3.07	2.89	2.71
Refrigerant		R410A					
Dimension	HxWxD (mm)	1,340x900x320					
Cord heater (W)		-			75		

Powerful type

Single Phase model

Outdoor unit		HWS-P805HR-E	HWS-P1105HR-E
Power supply		220-230 V ~ 50 Hz	
Type		INVERTER	
Function		Heating & Cooling	
Heating	Capacity (kW)	8.0	11.2
	Input (kW)	1.68	2.30
	COP (W/W)	4.76	4.88
Cooling	Capacity (kW)	6.0	10.0
	Input (kW)	1.64	3.33
	EER (W/W)	3.66	3.00
Refrigerant		R410A	
Dimension	HxWxD (mm)	1,340x900x320	

2-4. Hot Water Cylinder

Hot water cylinder (option)		HWS-1501CSHM3-E	HWS-2101CSHM3-E	HWS-3001CSHM3-E
Water volume	litres	150	210	300
Max water temperature	(°C)	75		
Electric heater	(kW)	2.75 (230 V ~)		
Height	(mm)	1,090	1,474	2,040
Diameter	(mm)	550		
Material		Stainless steel		

2-5. Options

No.	Part name	Model name	Application	Remarks
1	External output board	TCB-PCIN3E	Boiler-linked output, Alarm output	Up to two boards (according to applications)
			Defrost signal output, compressor operation signal output	
2	External input board	TCB-PCMO3E	Cooling/heating thermostat input	Up to two boards (according to applications)
			Forced-stop signal input	
3	Second Remote Controller	HWS-AMS54E	Wired Remote Controller for Room air temperature control	

3. SYSTEM SPECIFICATION

Standard type

Outdoor unit			HWS-455H-E	HWS-805H-E	HWS-1105H-E	HWS-1405H-E
Hydro unit			HWS-455XWH**-E	HWS-805XWH**-E	HWS-1105XWH**-E	HWS-1405XWH**-E
Rated Heating condition LWT=35°C dT=5deg TO=7°C	Capacity	kW	4.5	8.0	11.2	14.0
	Input	kW	0.92	1.79	2.30	3.11
	COP	W/W	4.90	4.46	4.88	4.50
	Rated water flow rate	ℓ/min	12.90	22.90	32.10	40.10
Rated Cooling condition LWT=7°C dT=5deg TO=35°C	Capacity	kW	4.5	6.0	10.0	11.0
	Input	kW	1.46	1.94	3.26	3.81
	EER	W/W	3.08	3.10	3.07	2.89
	Rated water flow rate	ℓ/min	12.90	17.20	28.90	31.50
Power supply			1~ 230V 50Hz			
Maximum current		A	11.10	19.20	22.80	22.80

Outdoor unit			HWS-1105H8-E	HWS-1405H8-E	HWS-1605H8-E
Hydro unit			HWS-1105XWH**-E	HWS-1405XWH**-E	HWS-1605XWH**-E
Rated Heating condition LWT=35°C dT=5deg TO=7°C	Capacity	kW	11.2	14.0	16.0
	Input	kW	2.34	3.16	3.72
	COP	W/W	4.80	4.44	4.30
	Rated water flow rate	ℓ/min	32.10	40.10	45.80
Rated Cooling condition LWT=7°C dT=5deg TO=35°C	Capacity	kW	10.0	11.0	13.0
	Input	kW	3.26	3.81	4.80
	EER	W/W	3.07	2.89	2.71
	Rated water flow rate	ℓ/min	28.90	31.50	37.30
Power supply			3N~ 380-400V 50Hz		
Maximum current		A	14.60	14.60	14.60

* Rated condition capacity and power input are the data at rated compressor operating frequency.

* Power input does not include water pump power.

* Capacity and power input are measured in accordance with EN14511.

TO : Outdoor temperature (°C)

LWT : Leaving water temperature (°C)

dT : Delta temperature (deg)

Leaving water temperature - Return water temperature (Heating)

Return water temperature - Leaving water temperature (Cooling)

Powerful type

Outdoor unit			HWS-P805HR-E	HWS-P1105HR-E
Hydro unit			HWS-805XWH**-E	HWS-1405XWH**-E
Rated Heating condition 1 LWT=35°C dT=5deg	Capacity	kW	8.0	11.20
	Power input	kW	1.79	2.30
	COP	W/W	4.46	4.88
	Rated water flow	ℓ/min	22.90	32.10
Rated Cooling condition 1 LWT=7°C dT=5deg	Capacity	kW	6.0	10.0
	Power input	kW	1.94	3.26
	EER	W/W	3.10	3.07
	Rated water flow rate	ℓ/min	17.20	28.90
Power supply			1~ 230V 50Hz	
Maximum current		A	22.80	22.80

* Rated condition capacity and power input are the data at rated compressor operating frequency.

* Power input does not include water pump power.

* Capacity and power input are measured in accordance with EN14511.

LWT : Leaving water temperature (°C)

dT : Delta temperature (deg)

Leaving water temperature - return water temperature (Heating)

Return water temperature - leaving water temperature (Cooling)

4. HYDRO UNIT

4-1. Specification

4-1-1. Hydro unit specifications

Standard type

Hydro unit			HWS-455XWHM3-E	HWS-805XWHM3-E	HWS-805XWHT6-E	HWS-805XWHT9-E
Back up heater	back up heater	kW	3.0	3.0	6.0	9.0
	Power supply		1 ~ 220-230V 50Hz	1 ~ 220-230V 50Hz	3N~ 380-400V 50Hz	3N~ 380-400V 50Hz
	Maximum current	A	13.00	13	13 (13A*2P)	13 (13A*3P)
Hot water cylinder heater*	Power supply		1 ~ 220-230V 50Hz			
	Maximum current	A	12.0			
Appearance	Color		Silky shade (Muncel 1Y8.5-0.5)			
	Material		PCM			
Outer dimension	Height	mm	925			
	Width	mm	525			
	Depth	mm	355			
Unit weight		kg	49			
Packing dimension	Height	mm	1070			
	Width	mm	608			
	Depth	mm	436			
Total weight	Unit and packing	kg	54			
Heat exchanger	Type		Brazed plate			
	Water volume	litres	0.67			
	Minimum flow rate	ℓ/min	13.0			
Water pump	Power input	W	48			
	Delivery head	m	6.3			
Expansion vessel	Volume	litres	12			
	Initial pressure	MPa (bar)	0.1 (1)			
Pressure relief valve	Operating pressure	MPa (bar)	0.3 (3)			
Sound pressure level		dBA	27			
Operation water temp.	Heating	°C	20~55			
	Cooling	°C	7~25			
Water pipe	Outlet	mm	34.92			
	Inlet	mm	34.92			
Refrigerant pipe	Gas	mm	15.9			
	Liquid	mm	9.5			
Drain port		mm	16.0 inner diameter for drain hose			
Note			* The electric heater, incorporated in the hot water cylinder, requires separate supply to hydro unit.			

Hydro unit			HWS-1405XWHM3-E	HWS-1405XWHM6-E	HWS-1405XWHM9-E
Back up heater	back up heater	kW	3.0	6.0	9.0
	Power supply		1 ~ 220-230V 50Hz	3N~ 380-400V 50Hz	3N~ 380-400V 50Hz
	Maximum current	A	13	13 (13A*2P)	13 (13A*3P)
Hot water cylinder heater*	Power supply		1 ~ 220-230V 50Hz		
	Maximum current	A	12.0		
Appearance	Color		Silky shade (Muncel 1Y8.5-0.5)		
	Material		PCM		
Outer dimension	Height	mm	925		
	Width	mm	525		
	Depth	mm	355		
Unit weight		kg	54		
Packing dimension	Height	mm	1070		
	Width	mm	608		
	Depth	mm	436		
Total weight	Unit and packing	kg	58		
Heat exchanger	Type		Brazed plate		
	Water volume	litres	1.18		
	Minimum flow rate	ℓ/min	17.5		
Water pump	Power input	W	87		
	Delivery head	m	8.8		
Expansion vessel	Volume	litres	12		
	Initial pressure	MPa (bar)	0.1 (1)		
Pressure relief valve	Operating pressure	MPa (bar)	0.3 (3)		
Sound pressure level		dBA	29		
Operation water temp.	Heating	°C	20~55		
	Cooling	°C	7~25		
Water pipe	Outlet	mm	34.92		
	Inlet	mm	34.92		
Refrigerant pipe	Gas	mm	15.9		
	Liquid	mm	9.5		
Drain port		mm	16.0 inner diameter for drain hose		
Note			* The electric heater, incorporated in the hot water cylinder, requires separate supply to hydro unit.		

Powerful type

Hydro unit			HWS-P805XWHM3-E	HWS-P805XWHT6-E	HWS-P805XWHT9-E
Back up heater	back up heater	kW	3.0	6.0	9.0
	Power supply		1 ~ 220-230V 50Hz	3N~ 380-400V 50Hz	3N~ 380-400V 50Hz
	Maximum current	A	13	13 (13A*2P)	13 (13A*3P)
Hot water cylinder heater*	Power supply		1 ~ 220-230V 50Hz		
	Maximum current	A	12.0		
Appearance	Color		Silky shade (Muncel 1Y8.5-0.5)		
	Material		PCM		
Outer dimension	Height	mm	925		
	Width	mm	525		
	Depth	mm	355		
Unit weight		kg	49		
Packing dimension	Height	mm	1070		
	Width	mm	608		
	Depth	mm	436		
Total weight	Unit and packing	kg	53		
Heat exchanger	Type		Brazen plate		
	Water volume	litres	0.67		
	Minimum flow rate	ℓ/min	13		
Water pump	Power input	W	48		
	Delivery head	m	6.3		
Expansion vessel	Volume	litres	12		
	Initial pressure	MPa(bar)	0.1 (1)		
Pressure relief valve	Operating pressure	MPa(bar)	0.3 (3)		
Sound pressure level		dBA	27		
Operation water temp.	Heating	°C	20~60		
	Cooling	°C	7~25		
Water pipe	Outlet	mm	34.92		
	Inlet	mm	34.92		
Refrigerant pipe	Gas	mm	15.9		
	Liquid	mm	9.5		
Drain port		mm	16.0 inner diameter for drain hose		
Note			* The electric heater, incorporated in the hot water cylinder, requires separate supply to hydro unit.		

Hydro unit			HWS-P1105XWHM3-E	HWS-P1105XWHT6-E	HWS-P1105XWHT9-E
Back up heater	back up heater	kW	3.0	6.0	9.0
	Power supply		1 ~ 220-230V 50Hz	3N~ 380-400V 50Hz	3N~ 380-400V 50Hz
	Maximum current	A	13	13 (13A*2P)	13 (13A*3P)
Hot water cylinder heater*	Power supply		1 ~ 220-230V 50Hz		
	Maximum current	A	12.0		
Appearance	Color		Silky shade (Muncel 1Y8.5-0.5)		
	Material		PCM		
Outer dimension	Height	mm	925		
	Width	mm	525		
	Depth	mm	355		
Unit weight		kg	52		
Packing dimension	Height	mm	1070		
	Width	mm	608		
	Depth	mm	436		
Total weight	Unit and packing	kg	56		
Heat exchanger	Type		Brazen plate		
	Water volume	litres	1.18		
	Minimum flow rate	ℓ/min	17.5		
Water pump	Power input	W	87		
	Delivery head	m	8.8		
Expansion vessel	Volume	litres	12		
	Initial pressure	MPa(bar)	0.1 (1)		
Pressure relief valve	Operating pressure	MPa(bar)	0.3 (3)		
Sound pressure level		dBA	29		
Operation water temp.	Heating	°C	20~60		
	Cooling	°C	7~25		
Water pipe	Outlet	mm	34.92		
	Inlet	mm	34.92		
Refrigerant pipe	Gas	mm	15.9		
	Liquid	mm	9.5		
Drain port		mm	16.0 inner diameter for drain hose		
Note			* The electric heater, incorporated in the hot water cylinder, requires separate supply to hydro unit.		

4-1-2. Power Wiring specifications

Standard type

Description		Model name HWS-	POWER SUPPLY	Maximum current	Installation fuse rating	Power Cable	Connection destination	
Outdoor unit power	Power input	1405H-E	220-230 V ~ 50 Hz	22.8A	25A	2.5 mm ² or more	Ⓐ, Ⓑ	—
		1105H-E	220-230 V ~ 50 Hz	22.8A	25A	2.5 mm ² or more		
		805H-E	220-230 V ~ 50 Hz	19.2A	20A	2.5 mm ² or more		
		455H-E	220-230 V ~ 50 Hz	11.1A	15A	2.5 mm ² or more		
		1605H8-E 1605H8R-E	380-400V 3N~ 50Hz	14.6A	16A	2.5 mm ² or more	Ⓐ ¹ , Ⓐ ² , Ⓐ ³ , Ⓑ	—
		1405H8-E 1405H8R-E	380-400V 3N~ 50Hz	14.6A	16A	2.5 mm ² or more		
		1105H8-E 1105H8R-E	380-400V 3N~ 50Hz	13A	16A	2.5 mm ² or more		
Hydro inlet heater power	Power input for backup heater	1405XWHM3-E	220-230V ~ 50Hz	13A	16A	1.5 mm ² or more	Ⓐ, Ⓑ	TB02
		1405XWHT6-E	380-400V 3N~ 50Hz	13A(13A x 2P)	16A	1.5 mm ² or more	Ⓐ ¹ , Ⓐ ² ,	
		1405XWHT9-E	380-400V 3N~ 50Hz	13A(13A x 3P)	16A	1.5 mm ² or more	Ⓐ ³ , Ⓑ	
		805XWHM3-E	220-230V ~ 50Hz	13A	16A	1.5 mm ² or more	Ⓐ, Ⓑ	
		805XWHT6-E	380-400V 3N~ 50Hz	13A(13A x 2P)	16A	1.5 mm ² or more	Ⓐ ¹ , Ⓐ ² ,	
		805XWHT9-E	380-400V 3N~ 50Hz	13A(13A x 3P)	16A	1.5 mm ² or more	Ⓐ ³ , Ⓑ	
		455XWHM3-E	220-230V ~ 50Hz	13A	16A	1.5 mm ² or more	Ⓐ, Ⓑ	
Appearance	Power input for cylinder heater		220-230V ~ 50Hz	12A	16A	1.5 mm ² or more	Ⓐ, Ⓑ	TB03
Outdoor-Hydro unit	Connection	—	—	—	1.5 mm ² or more	①, ②, ③	TB01	
Hydro -Cylinder	Connection	—	—	—	1.5 mm ² or more	①, ②	TB03	

Powerful type

Description		Model name HWS-	POWER SUPPLY	Maximum current	Installation fuse rating	Power Cable	Connection destination		
Outdoor unit power	Power input	P1105HR-E	220-230 V ~ 50 Hz	22.8A	25A	2.5 mm ² or more	Ⓐ, Ⓑ	—	
		P805HR-E	220-230 V ~ 50 Hz	22.8A	25A	2.5 mm ² or more			
Hydro inlet heater power	Power input for backup heater	P1105XWHM3-E	220-230V ~ 50Hz	13A	16A	1.5 mm ² or more	Ⓐ, Ⓑ	TB02	
		P1105XWHT6-E	380-400V 3N~ 50Hz	13A(13A x 2P)	16A	1.5 mm ² or more			Ⓐ, Ⓑ, Ⓒ, Ⓓ
		P1105XWHT9-E	380-400V 3N~ 50Hz	13A(13A x 3P)	16A	1.5 mm ² or more			
		P805XWHM3-E	220-230V ~ 50Hz	13A	16A	1.5 mm ² or more			Ⓐ, Ⓑ, Ⓒ, Ⓓ
		P805XWHT6-E	380-400V 3N~ 50Hz	13A(13A x 2P)	16A	1.5 mm ² or more			
		P805XWHT9-E	380-400V 3N~ 50Hz	13A(13A x 3P)	16A	1.5 mm ² or more			
		Power input for cylinder heater		220-230V ~ 50Hz	12A	16A	1.5 mm ² or more		Ⓐ, Ⓑ
Outdoor-Hydro unit		Connection	—	—	—	1.5 mm ² or more	Ⓐ, Ⓑ, Ⓒ	—	
Hydro -Cylinder		Connection	—	—	—	1.5 mm ² or more	Ⓐ, Ⓑ	TB03	

4-1-3. External Device specifications

	Power	Maximum current	Type
Motorized 3-way valve (for hot water)	AC 230 V	100 mA	Spring return type Note: 3-wire SPST and SPDT type can be used by changing the DPSW 13-1.
Motorized 2-way valve (for cooling)	AC 230 V	100 mA	Spring return type (normally open)
Motorized mixing valve type 1 (for 2-zone)	AC 230 V	100 mA	60 sec 90°. SPDT type Note: 3 wire SPST or SPDT valves, with drive times between 30 and 240 seconds, can be used. Valve drive time can be changed using function code 0C.

4-1-4. External Device Wiring specifications

Description	Line spec	Maximum current	Maximum length	Cable size	Connection destination
3-way valve control	2 line or 3 line	100 mA	12 m	1.0 mm ² or more	⑦, ⑧, ⑨ (TB05)
2-way valve control	2 line	100 mA	12 m	1.0 mm ² or more	③, ④ (TB05)
Mixing valve control	3 line	100 mA	12 m	1.0 mm ² or more	①, ②, ③ or ②, ③, ④ (TB04)
2-zone thermo sensor	2 line	100 mA	5 m	1.0 mm ² or more	①, ② (TB06)
Cylinder thermo sensor	2+GND(shield wire)	100 mA	5 m	1.0 mm ² or more	①, ② (TB06)
Second remote controller		50 mA	50 m	1.0 mm ² or more	①, ② (TB07)
Group control (total)		50 mA	50 m	1.0 mm ² or more	①, ② (TB07)
Open protocol interface		50 mA	50 m	1.0 mm ² or more	①, ② (TB07)

4-1-5. External Output specifications


Description	Output	Maximum current	Max voltage	Maximum length	Connection
External pump	AC230V	1 A	–	12 m	
External boost heater	AC230V	1 A	–	12 m	Output as required when outdoor air temperature is -20°C or less
Boiler control	Non-voltage contacts	0.5 A	AC230 V	12 m	Output as required when outdoor air temperature is -10°C or less (output trigger temperature can be changed using FC23)
		1 A	DC24 V	12 m	
ALARM Output	Non-voltage contacts	0.5 A	AC230 V	12 m	
		1 A	DC24 V	12 m	
Compressor Operation Output	Non-voltage contacts	0.5 A	AC230 V	12 m	
		1 A	DC24 V	12 m	
Defrost Output	Non-voltage contacts	0.5 A	AC230 V	12 m	
		1 A	DC24 V	12 m	

4-1-6. External Input specifications

Description	Input	Maximum length
Emergency stop control	Non-voltage	12 m
Cooling thermostat input	Non-voltage	12 m
Heating thermostat input	Non-voltage	12 m

4-2. Dimension


▼Hydro unit

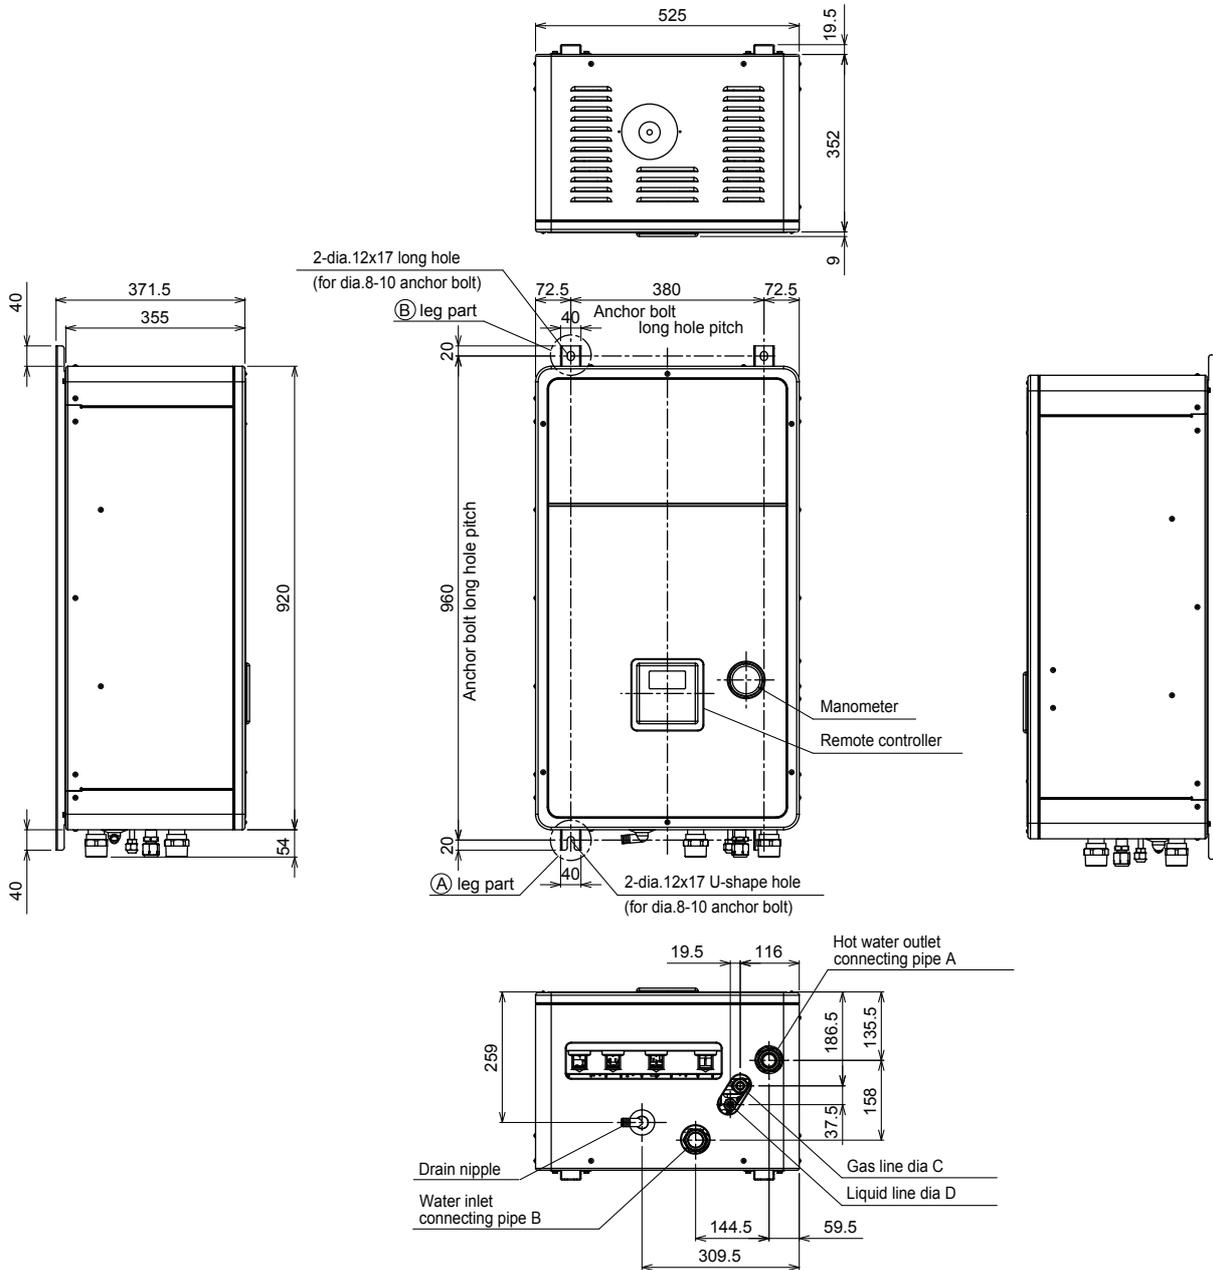

	HWS-455XWHM3-E	HWS-805XWHM3-E/HWS-805XWHT*-E HWS-1405XWHM3-E/HWS-1405XWHT*-E	HWS-P805XWHM3-E/HWS-P805XWHT*-E HWS-P1105XWHM3-E/HWS-P1105XWHT*-E
A	1	1 1/4"	1 1/4"
B	1	1 1/4"	1 1/4"
C	12.7	15.88	15.88
D	6.35	9.52	9.52


▼External output board (TCB-PCIN3E)

Size (mm) : H22 x L73 x W79
 Weight (g) : 57

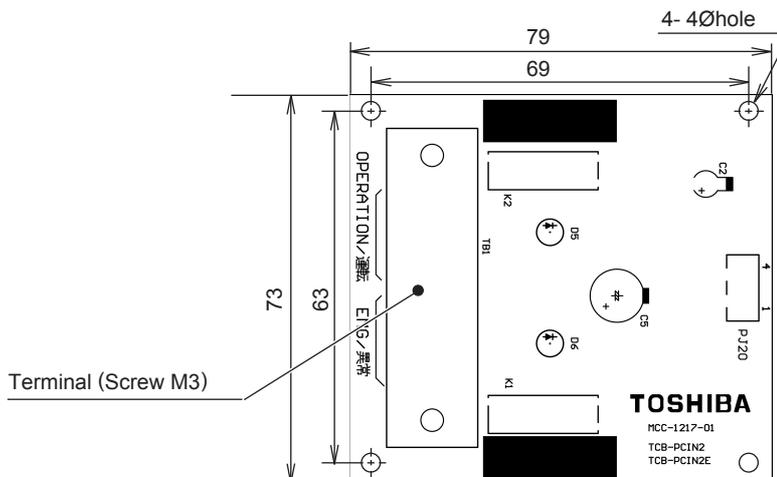


▼External input board (TCB-PCMO3E)

Size (mm) : H18 x L55.5 x W60
 Weight (g) : 20

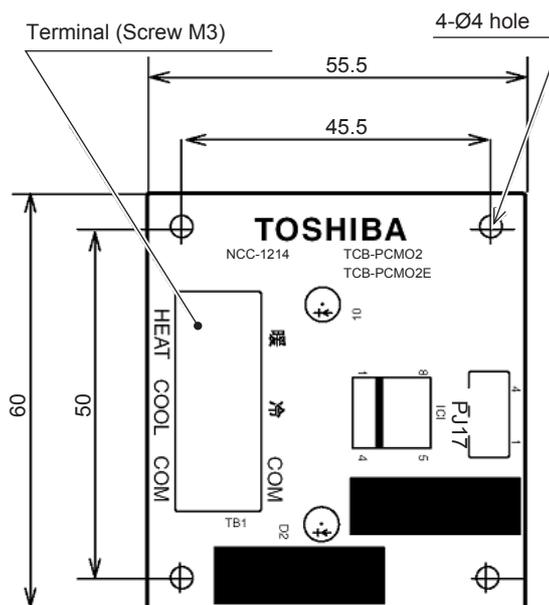


4-3. Piping Diagram

Water system diagram

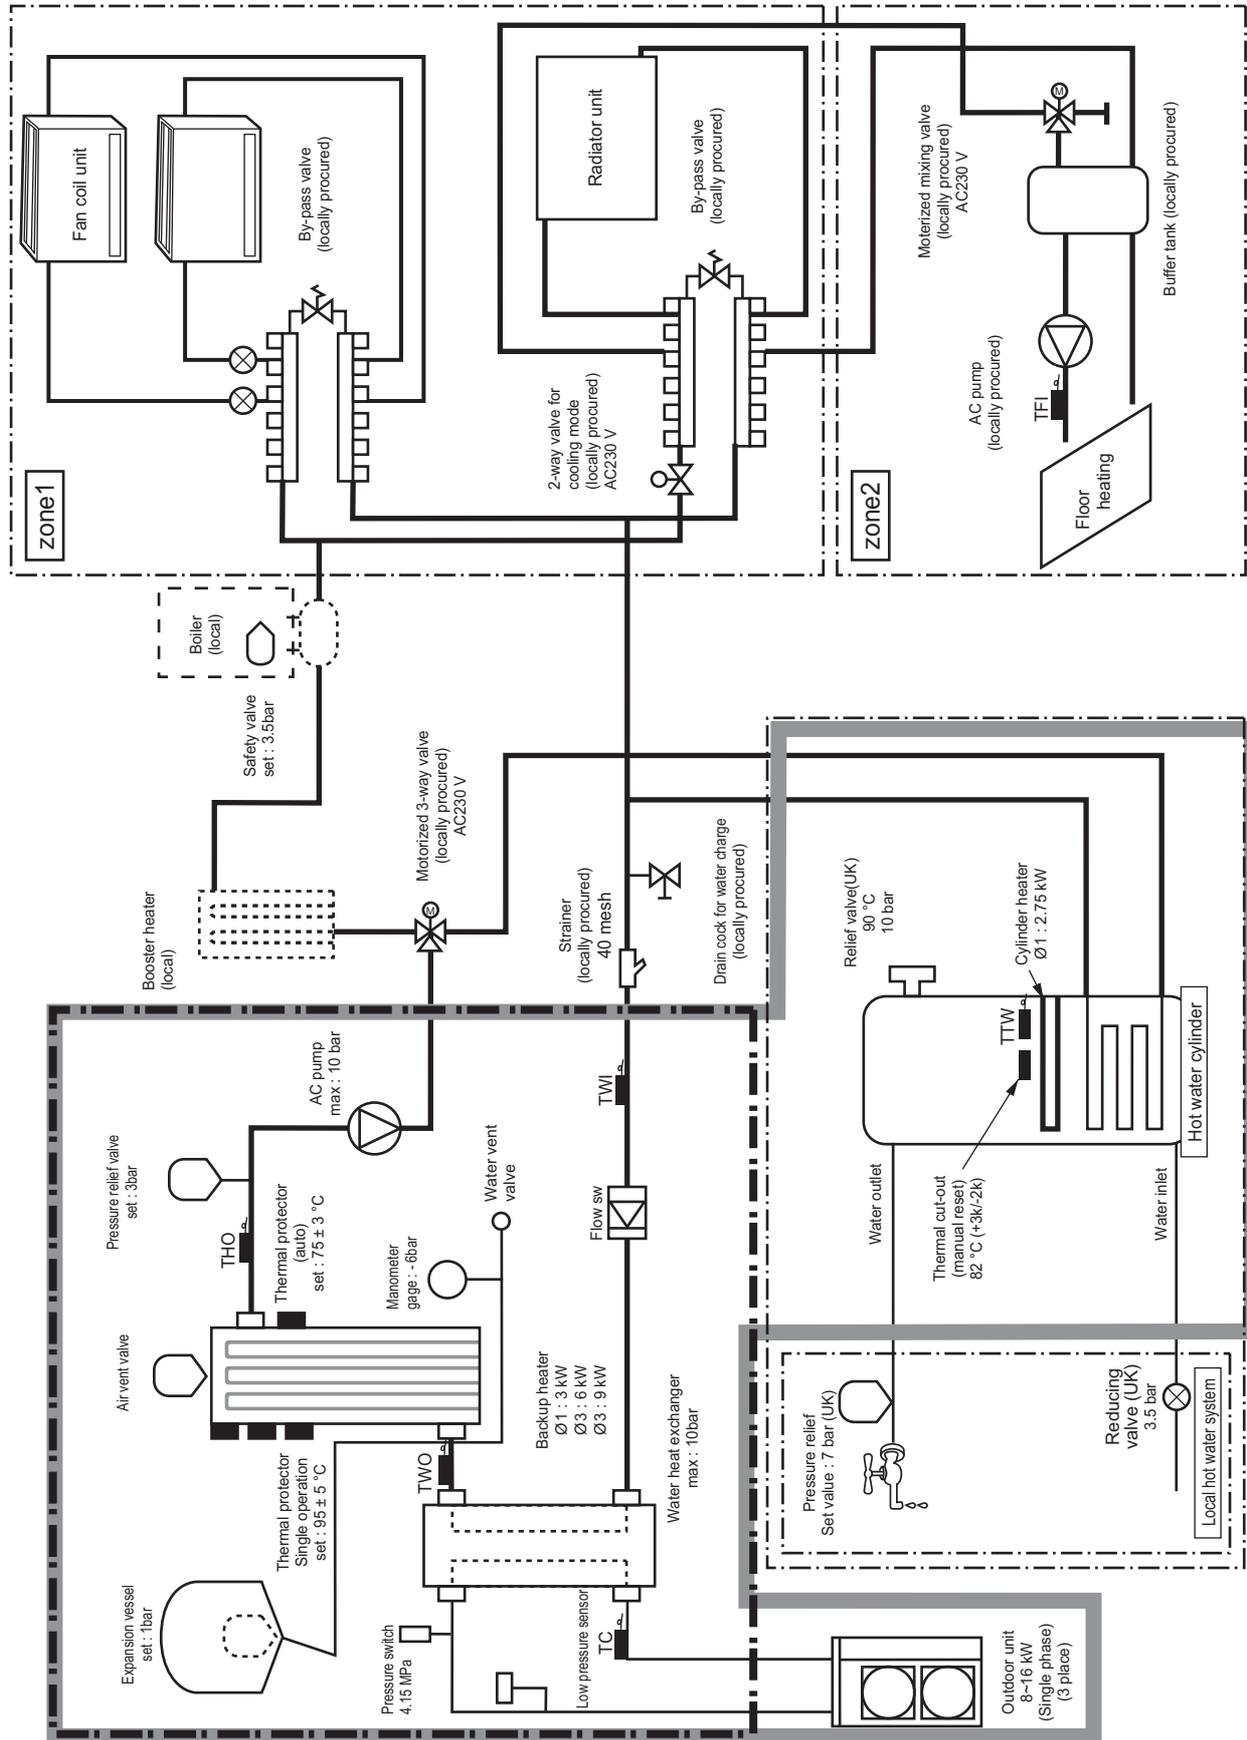


Refrigeration cycle system diagram

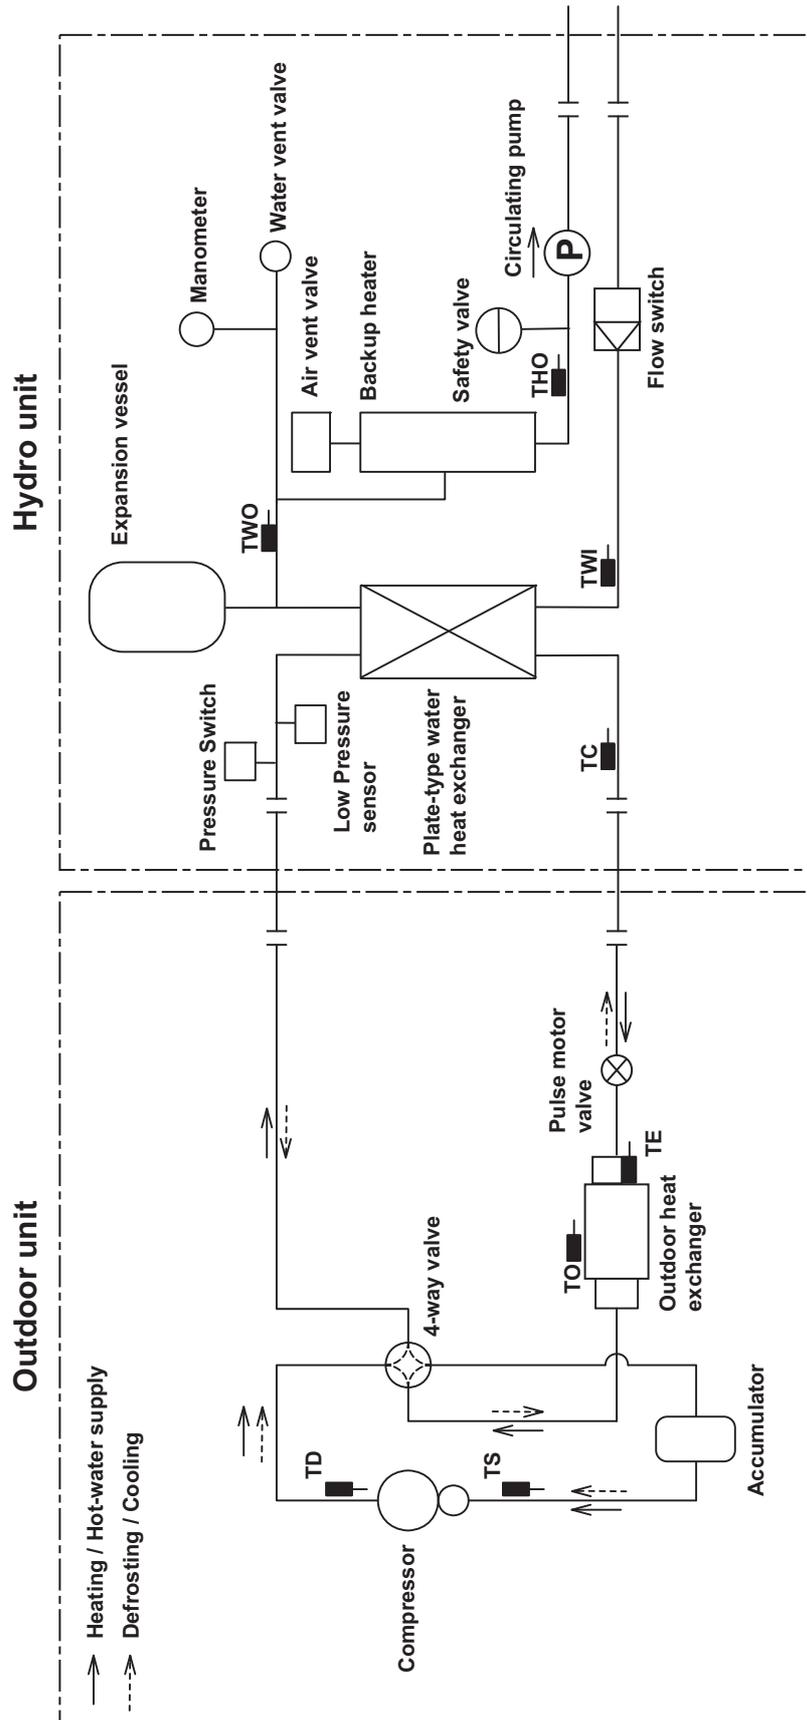

4-4. Wiring Diagram

4-4-1. Hydro unit

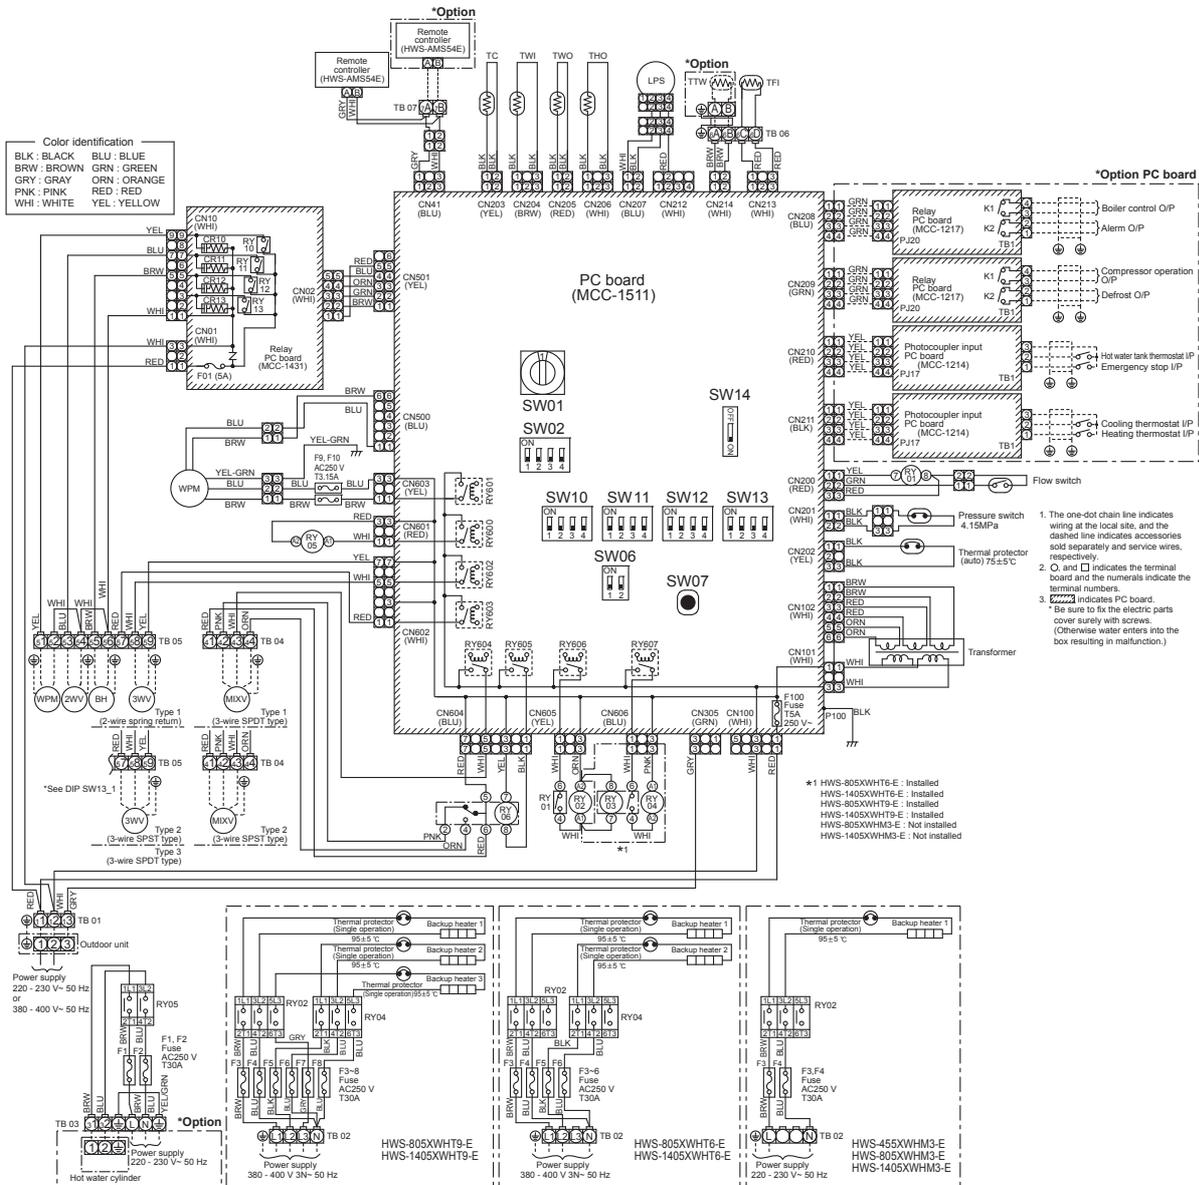

Symbol	Parts name	Symbol	Parts name
WPM	Water pump motor	TC	Water heat exchanger temperature sensor
3WV	3-way valve (locally procured)	TWI	Water inlet temperature sensor
2WV	2-way valve (locally procured)	TWO	Water outlet temperature sensor
MIXV	Mixing valve (locally procured)	THO	Heater outlet temperature sensor
BH	Booster heater	TTW	Hot water cylinder temperature sensor
RY01~RY06	Relay01~Relay06	TFI	Floor heating inlet temperature sensor
LPS	Low pressure sensor	TB	Terminal block
Backup heater1, 2, 3	Heater AC230V, 3kW		

1. The one-dot chain line indicates wiring at the local site, and the dashed line indicates accessories sold separately and service wires, respectively.
 2. ○, and □ indicates the terminal board and the numbers indicate the terminal numbers.
 3. ▨ indicates P.C. board.
- * Be sure to fix the electric parts cover surely with screws. (Otherwise water enters into the box resulting in malfunction.)


Self-diagnosis by remote controller

Black code	Check code	Cause	Supposed defective parts
	F04	Disconnection or short circuit	TD sensor
	F05	Disconnection or short circuit	TE sensor
	F06	Disconnection or short circuit	TO sensor
	F07	Disconnection or short circuit	TS sensor
	F08	Disconnection or short circuit	TH sensor
	F09	Disconnection or short circuit	PH sensor
	F10	Disconnection or short circuit	PD sensor
	H01	Comp. brake, down	Compressor case thermo
	H02	PC board, overheat	PC board
	H03	PC board, overheat	PC board
	H04	Over heating error	Compressor case thermo
	L01	None specially setting in outdoor unit	Check the model name
	L02	None specially setting in outdoor unit	Check the model name
	L03	Overheat of discharge temp.	Outdoor unit
	L04	Overheat of discharge temp.	Outdoor unit
	L05	Overheat of discharge temp.	Outdoor unit
	L06	Overheat of discharge temp.	Outdoor unit
	L07	Valve error	Valve (230V ±10%)
	L08	Valve error	Valve (230V ±10%)
	L09	Valve error	Valve (230V ±10%)
	L10	Valve error	Valve (230V ±10%)
	L11	Valve error	Valve (230V ±10%)
	L12	Valve error	Valve (230V ±10%)
	L13	Valve error	Valve (230V ±10%)
	L14	Valve error	Valve (230V ±10%)
	L15	Valve error	Valve (230V ±10%)
	L16	Valve error	Valve (230V ±10%)
	L17	Valve error	Valve (230V ±10%)
	L18	Valve error	Valve (230V ±10%)
	L19	Valve error	Valve (230V ±10%)
	L20	Valve error	Valve (230V ±10%)
	L21	Valve error	Valve (230V ±10%)
	L22	Valve error	Valve (230V ±10%)
	L23	Valve error	Valve (230V ±10%)
	L24	Valve error	Valve (230V ±10%)
	L25	Valve error	Valve (230V ±10%)
	L26	Valve error	Valve (230V ±10%)
	L27	Valve error	Valve (230V ±10%)
	L28	Valve error	Valve (230V ±10%)
	L29	Valve error	Valve (230V ±10%)
	L30	Valve error	Valve (230V ±10%)
	L31	Valve error	Valve (230V ±10%)
	L32	Valve error	Valve (230V ±10%)
	L33	Valve error	Valve (230V ±10%)
	L34	Valve error	Valve (230V ±10%)
	L35	Valve error	Valve (230V ±10%)
	L36	Valve error	Valve (230V ±10%)
	L37	Valve error	Valve (230V ±10%)
	L38	Valve error	Valve (230V ±10%)
	L39	Valve error	Valve (230V ±10%)
	L40	Valve error	Valve (230V ±10%)
	L41	Valve error	Valve (230V ±10%)
	L42	Valve error	Valve (230V ±10%)
	L43	Valve error	Valve (230V ±10%)
	L44	Valve error	Valve (230V ±10%)
	L45	Valve error	Valve (230V ±10%)
	L46	Valve error	Valve (230V ±10%)
	L47	Valve error	Valve (230V ±10%)
	L48	Valve error	Valve (230V ±10%)
	L49	Valve error	Valve (230V ±10%)
	L50	Valve error	Valve (230V ±10%)
	L51	Valve error	Valve (230V ±10%)
	L52	Valve error	Valve (230V ±10%)
	L53	Valve error	Valve (230V ±10%)
	L54	Valve error	Valve (230V ±10%)
	L55	Valve error	Valve (230V ±10%)
	L56	Valve error	Valve (230V ±10%)
	L57	Valve error	Valve (230V ±10%)
	L58	Valve error	Valve (230V ±10%)
	L59	Valve error	Valve (230V ±10%)
	L60	Valve error	Valve (230V ±10%)
	L61	Valve error	Valve (230V ±10%)
	L62	Valve error	Valve (230V ±10%)
	L63	Valve error	Valve (230V ±10%)
	L64	Valve error	Valve (230V ±10%)
	L65	Valve error	Valve (230V ±10%)
	L66	Valve error	Valve (230V ±10%)
	L67	Valve error	Valve (230V ±10%)
	L68	Valve error	Valve (230V ±10%)
	L69	Valve error	Valve (230V ±10%)
	L70	Valve error	Valve (230V ±10%)
	L71	Valve error	Valve (230V ±10%)
	L72	Valve error	Valve (230V ±10%)
	L73	Valve error	Valve (230V ±10%)
	L74	Valve error	Valve (230V ±10%)
	L75	Valve error	Valve (230V ±10%)
	L76	Valve error	Valve (230V ±10%)
	L77	Valve error	Valve (230V ±10%)
	L78	Valve error	Valve (230V ±10%)
	L79	Valve error	Valve (230V ±10%)
	L80	Valve error	Valve (230V ±10%)
	L81	Valve error	Valve (230V ±10%)
	L82	Valve error	Valve (230V ±10%)
	L83	Valve error	Valve (230V ±10%)
	L84	Valve error	Valve (230V ±10%)
	L85	Valve error	Valve (230V ±10%)
	L86	Valve error	Valve (230V ±10%)
	L87	Valve error	Valve (230V ±10%)
	L88	Valve error	Valve (230V ±10%)
	L89	Valve error	Valve (230V ±10%)
	L90	Valve error	Valve (230V ±10%)
	L91	Valve error	Valve (230V ±10%)
	L92	Valve error	Valve (230V ±10%)
	L93	Valve error	Valve (230V ±10%)
	L94	Valve error	Valve (230V ±10%)
	L95	Valve error	Valve (230V ±10%)
	L96	Valve error	Valve (230V ±10%)
	L97	Valve error	Valve (230V ±10%)
	L98	Valve error	Valve (230V ±10%)
	L99	Valve error	Valve (230V ±10%)
	L100	Valve error	Valve (230V ±10%)



DIP Switch Setting

Switch	Description	Default setting	Switch mode
SW10	1. HP pump operation for hot water	HP synchronized	OFF ON Continuous run
	2. Interlocking of P.W. with internal pump	Interlocking of P.W. with internal pump	OFF ON Interlocking with the external pump
	3. HP pump interval running	Stop	OFF ON Interval running
	4. Interlocking of water cooler heater	Enabled	OFF ON Not energized
SW11	1. Energizing booster heater	Energized	OFF ON Not energized
	2. HA water supply operation	Provided	OFF ON Not provided
	3. Zone 2 operation	Not provided	OFF ON Provided
	4. 3-way 3WV type setting	SPST type, serial terminal	OFF ON SPDT type
SW12	1. Interlocking with boiler	Not provided	OFF ON Provided
	2. Backup for power interruption	Provided	OFF ON Not provided
	3. Backup for power interruption	Provided	OFF ON Not provided
SW13	1. Scaler metal location	Heating site after 2.WV	OFF ON Before 3.WV
	2. External thermostat for indoor unit	Not provided	OFF ON Provided
	3. External thermostat for indoor unit	Not provided	OFF ON Provided
	4. External thermostat for indoor unit	Not provided	OFF ON Provided

- *1 HWS-P80SXWHTE-E : Installed
- *2 HWS-P80SXWHTE-E : Installed
- *3 HWS-P105XWHTR : Installed
- *4 HWS-P105XWHTR : Installed
- *5 HWS-P105XWHTR : Installed
- *6 HWS-P105XWHTR : Installed
- *7 HWS-P105XWHTR : Installed
- *8 HWS-P105XWHTR : Installed
- *9 HWS-P105XWHTR : Installed
- *10 HWS-P105XWHTR : Installed
- *11 HWS-P105XWHTR : Installed
- *12 HWS-P105XWHTR : Installed
- *13 HWS-P105XWHTR : Installed
- *14 HWS-P105XWHTR : Installed
- *15 HWS-P105XWHTR : Installed
- *16 HWS-P105XWHTR : Installed
- *17 HWS-P105XWHTR : Installed
- *18 HWS-P105XWHTR : Installed
- *19 HWS-P105XWHTR : Installed
- *20 HWS-P105XWHTR : Installed
- *21 HWS-P105XWHTR : Installed
- *22 HWS-P105XWHTR : Installed
- *23 HWS-P105XWHTR : Installed
- *24 HWS-P105XWHTR : Installed
- *25 HWS-P105XWHTR : Installed
- *26 HWS-P105XWHTR : Installed
- *27 HWS-P105XWHTR : Installed
- *28 HWS-P105XWHTR : Installed
- *29 HWS-P105XWHTR : Installed
- *30 HWS-P105XWHTR : Installed
- *31 HWS-P105XWHTR : Installed
- *32 HWS-P105XWHTR : Installed
- *33 HWS-P105XWHTR : Installed
- *34 HWS-P105XWHTR : Installed
- *35 HWS-P105XWHTR : Installed
- *36 HWS-P105XWHTR : Installed
- *37 HWS-P105XWHTR : Installed
- *38 HWS-P105XWHTR : Installed
- *39 HWS-P105XWHTR : Installed
- *40 HWS-P105XWHTR : Installed
- *41 HWS-P105XWHTR : Installed
- *42 HWS-P105XWHTR : Installed
- *43 HWS-P105XWHTR : Installed
- *44 HWS-P105XWHTR : Installed
- *45 HWS-P105XWHTR : Installed
- *46 HWS-P105XWHTR : Installed
- *47 HWS-P105XWHTR : Installed
- *48 HWS-P105XWHTR : Installed
- *49 HWS-P105XWHTR : Installed
- *50 HWS-P105XWHTR : Installed
- *51 HWS-P105XWHTR : Installed
- *52 HWS-P105XWHTR : Installed
- *53 HWS-P105XWHTR : Installed
- *54 HWS-P105XWHTR : Installed
- *55 HWS-P105XWHTR : Installed
- *56 HWS-P105XWHTR : Installed
- *57 HWS-P105XWHTR : Installed
- *58 HWS-P105XWHTR : Installed
- *59 HWS-P105XWHTR : Installed
- *60 HWS-P105XWHTR : Installed
- *61 HWS-P105XWHTR : Installed
- *62 HWS-P105XWHTR : Installed
- *63 HWS-P105XWHTR : Installed
- *64 HWS-P105XWHTR : Installed
- *65 HWS-P105XWHTR : Installed
- *66 HWS-P105XWHTR : Installed
- *67 HWS-P105XWHTR : Installed
- *68 HWS-P105XWHTR : Installed
- *69 HWS-P105XWHTR : Installed
- *70 HWS-P105XWHTR : Installed
- *71 HWS-P105XWHTR : Installed
- *72 HWS-P105XWHTR : Installed
- *73 HWS-P105XWHTR : Installed
- *74 HWS-P105XWHTR : Installed
- *75 HWS-P105XWHTR : Installed
- *76 HWS-P105XWHTR : Installed
- *77 HWS-P105XWHTR : Installed
- *78 HWS-P105XWHTR : Installed
- *79 HWS-P105XWHTR : Installed
- *80 HWS-P105XWHTR : Installed
- *81 HWS-P105XWHTR : Installed
- *82 HWS-P105XWHTR : Installed
- *83 HWS-P105XWHTR : Installed
- *84 HWS-P105XWHTR : Installed
- *85 HWS-P105XWHTR : Installed
- *86 HWS-P105XWHTR : Installed
- *87 HWS-P105XWHTR : Installed
- *88 HWS-P105XWHTR : Installed
- *89 HWS-P105XWHTR : Installed
- *90 HWS-P105XWHTR : Installed
- *91 HWS-P105XWHTR : Installed
- *92 HWS-P105XWHTR : Installed
- *93 HWS-P105XWHTR : Installed
- *94 HWS-P105XWHTR : Installed
- *95 HWS-P105XWHTR : Installed
- *96 HWS-P105XWHTR : Installed
- *97 HWS-P105XWHTR : Installed
- *98 HWS-P105XWHTR : Installed
- *99 HWS-P105XWHTR : Installed
- *100 HWS-P105XWHTR : Installed

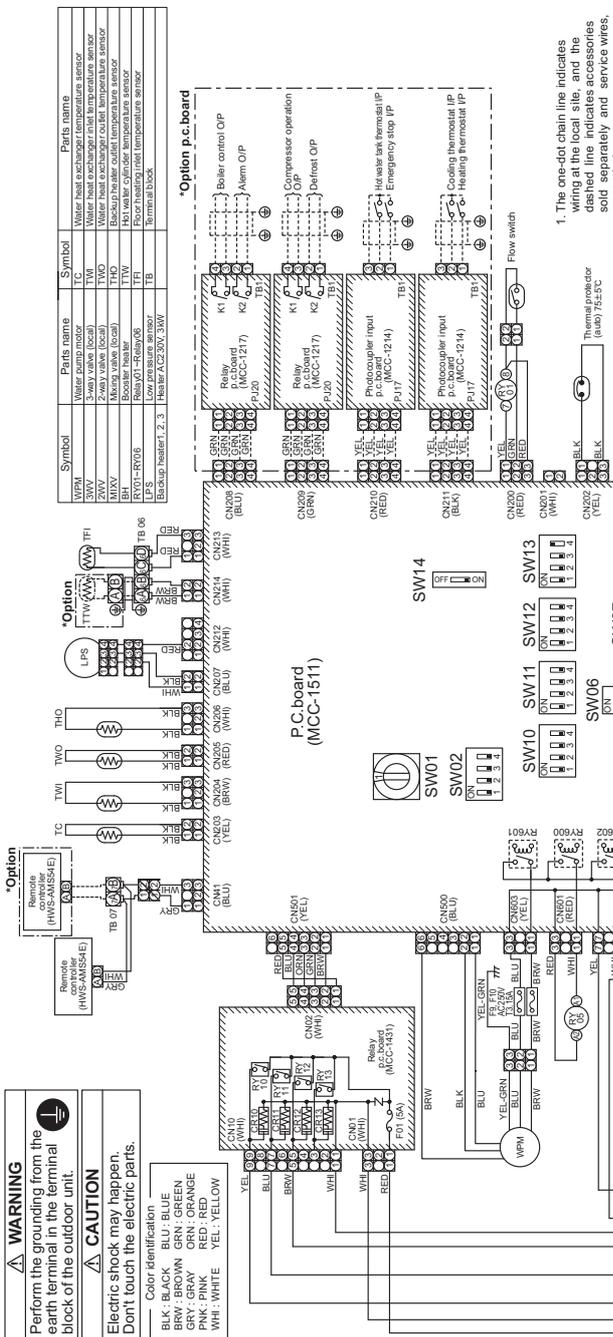


- The one-dot chain line indicates wiring at the local site, and the dashed line indicates accessories solid separately and service wires.
 - and □ indicates the terminal board and the numerals indicate the terminal numbers.
 - indicates P.C. board.
- Be sure to fix the electric parts cover surely with screws. (Otherwise water enters into the box resulting in malfunction.)

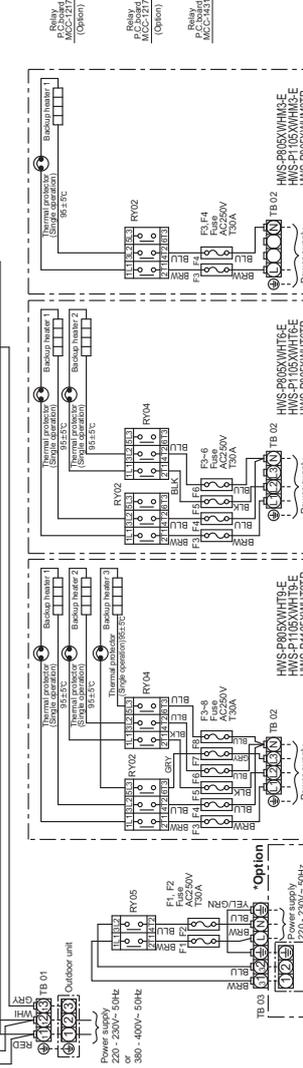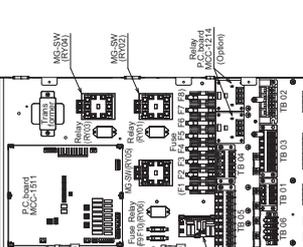


4-4-2. Power line



Electrical connection to hydro unit

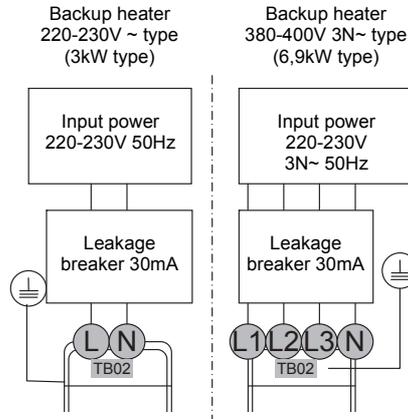

Outdoor unit to hydro unit electrical connection

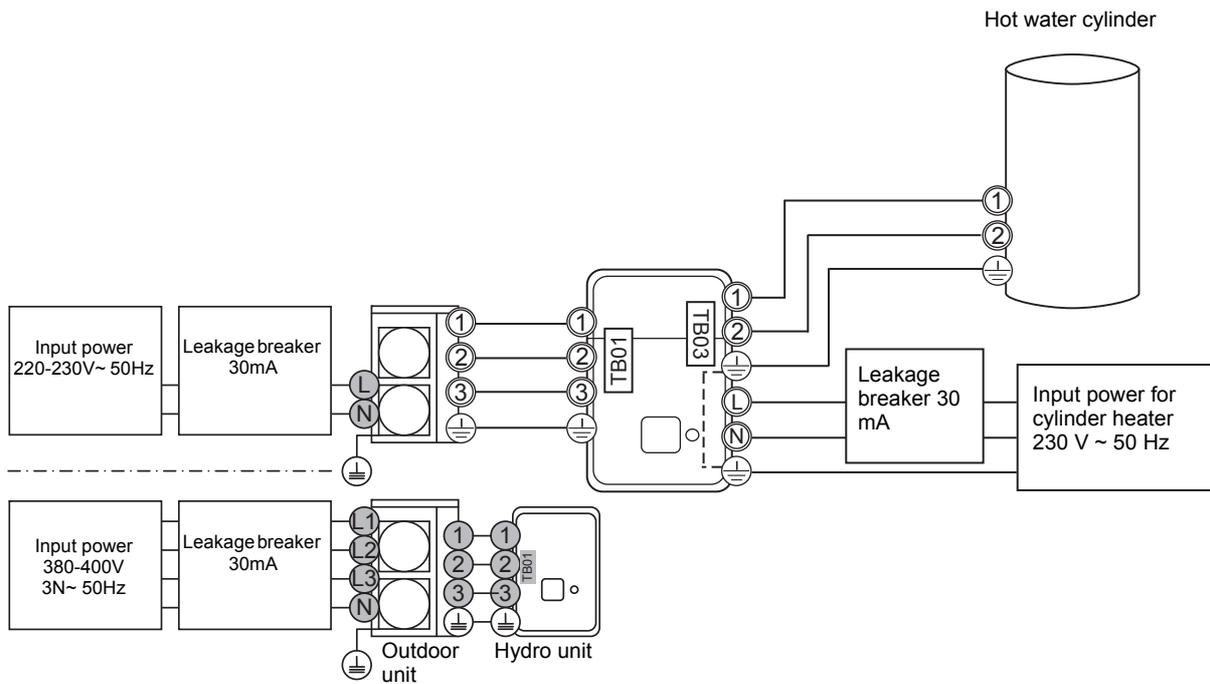


4-4-3. Control line

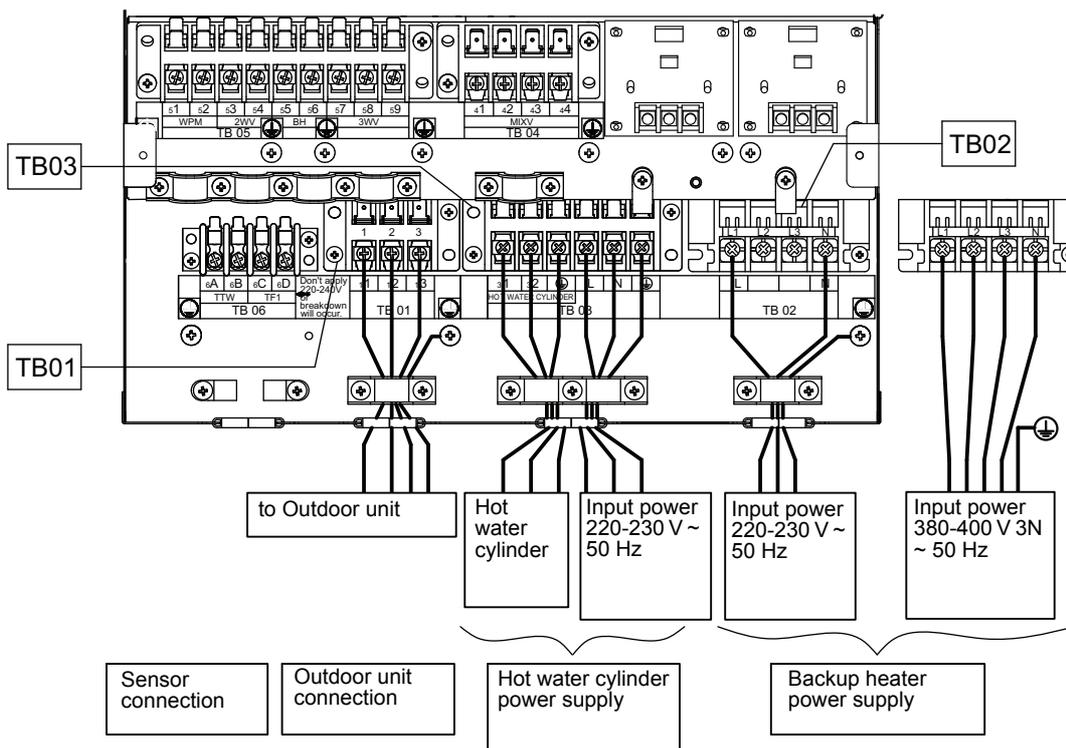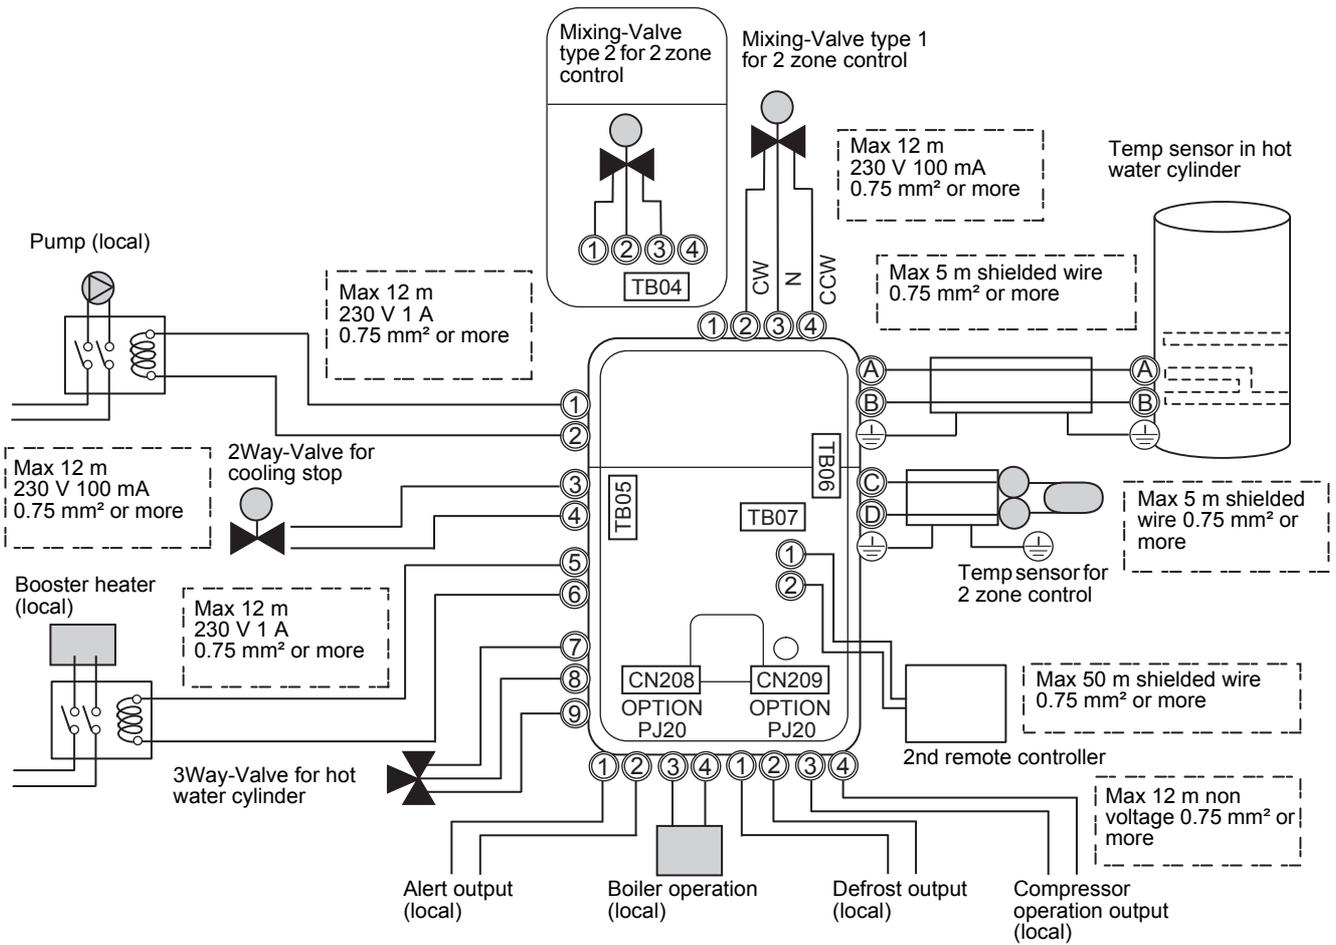


4-4-4. External Device

Electrical connection for external booster heater

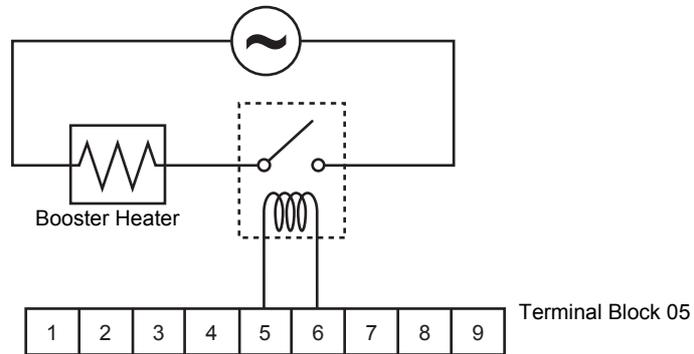

Electrical connection for external additional pumps

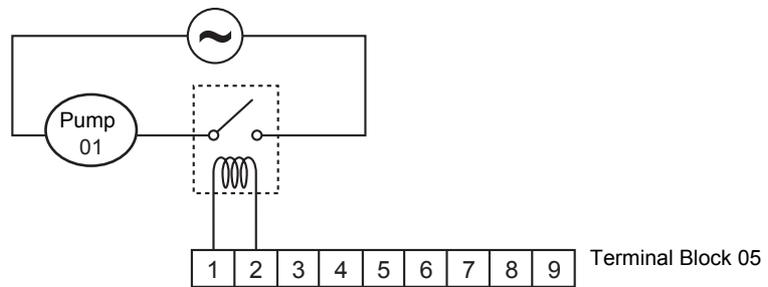

3-way valve (diverter) connection

Required Valve Specification:

Electrical Specification: 230 V; 50 Hz; <100 mA


Valve Diameters: Port A, Port B: Ø 1 1/4"

Return Mechanism: 3 types of 3-way valve (diverter) can be used.


Set the 3-way valve in use with the DIP switch SW13-1 on the Hydro Unit board.

		SW13-1
Type 1	2-wire spring return	OFF
Type 2	3-wire SPST	OFF
Type 3	3-wire SPDT	ON


Type 1: SPRING RETURN

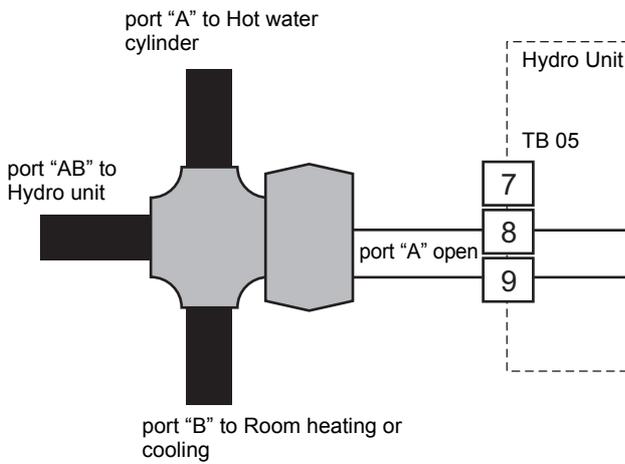

Type 2: SPST

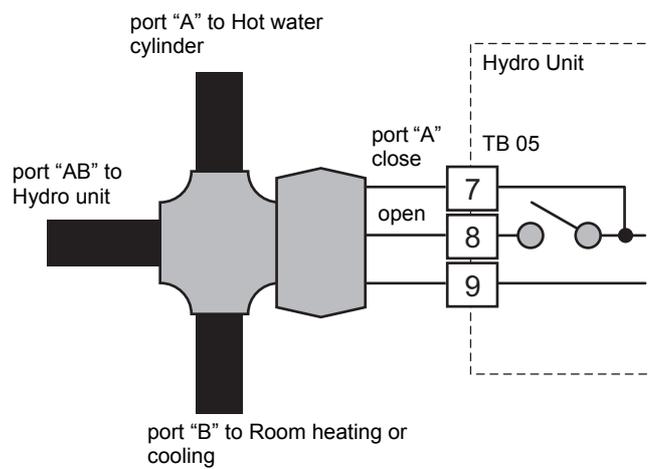

Type 3: SPDT

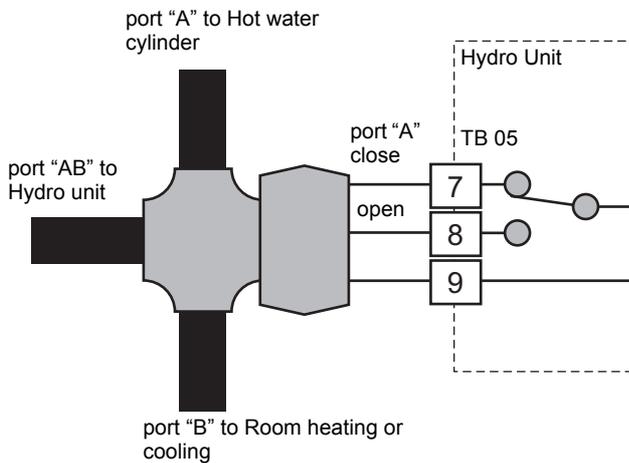

3-way mixing valve connection


Required Actuator Specification

Electrical Specification: 230 V; 50 Hz; <100 mA


The 3-way mixing valve is used to achieve the temperature differential needed in a 2-zone heating system.

- Connect the 3-way mixing valve to terminals 2, 3 and 4 on Terminal Block 04 (for Type 1 mixing valve) or on terminals 1, 2 and 3 on Terminal Block 04 (for Type 2 mixing valve).
- Connect the 3-way mixing valve in accordance with the diagrams below:-


Type 1: SPDT

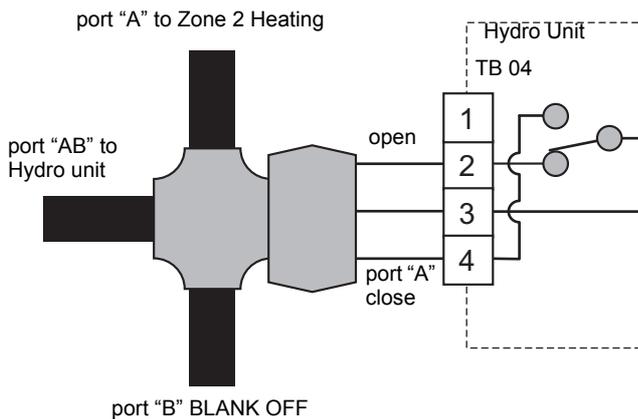


Type 2: SPST

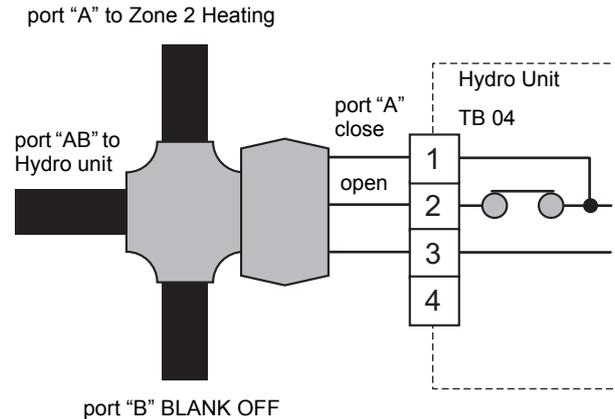

Hot water cylinder connection (optional)

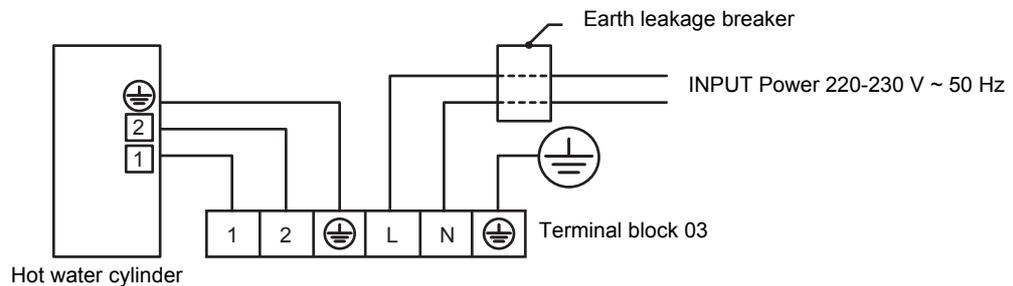

Hot water cylinder electrical box connections

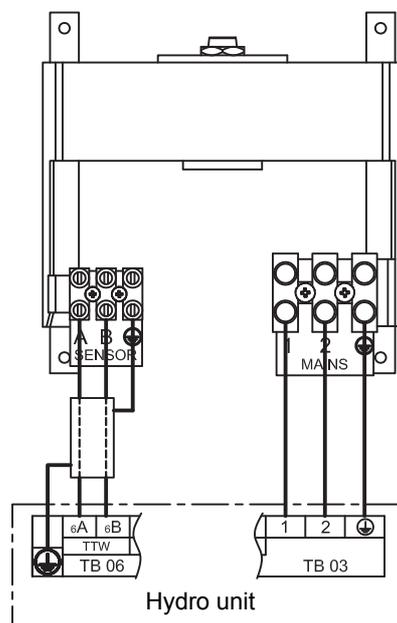

4-5. Capacity Tables

▼Outdoor unit **HWS-455H-E**
 Hydro unit **HWS-455XWH**-E**

Rated heating capacity and power input

Rated condition LWT=35°C dT=5deg TO=7°C	Capacity	kW	4.5
	Power input	kW	0.92
	COP	W/W	4.90
	Rated water flow rate	ℓ/min	12.9

* Rated heating capacity and power input are the data at rated compressor operating frequency.

* Power input does not include water pump power.

* Heating capacity and power input are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C)

LWT : Leaving water temperature (°C)

dT : Delta temperature (deg)

Leaving water temperature - return water temperature

Average heating capacity and power input

Capacity (kW)		LWT (°C)					
		30	35	40	45	50	55
TO (°C)	-20	1.60	1.63	—	—	—	—
	-15	3.10	3.14	3.18	—	—	—
	-7	4.12	4.18	4.24	4.29	4.24	—
	-2	4.40	4.62	4.84	5.05	4.85	4.69
	2	4.63	4.97	5.31	5.66	5.34	5.09
	7	6.75	6.83	6.62	6.42	6.33	6.25
	10	7.82	7.40	7.15	6.89	6.74	6.36
	12	8.13	7.78	7.49	7.21	7.15	6.75
	15	8.59	8.36	8.02	7.86	7.57	7.14
20	9.57	9.53	8.99	8.90	8.38	7.56	

Power input (kW)		LWT (°C)					
		30	35	40	45	50	55
TO (°C)	-20	0.74	0.84	—	—	—	—
	-15	1.12	1.28	1.44	—	—	—
	-7	1.22	1.39	1.56	1.73	1.89	—
	-2	1.21	1.40	1.59	1.78	1.94	2.10
	2	1.21	1.41	1.62	1.82	1.95	2.09
	7	1.45	1.56	1.79	1.87	2.04	2.21
	10	1.43	1.55	1.78	1.91	2.14	2.22
	12	1.42	1.55	1.78	1.94	2.17	2.22
	15	1.40	1.55	1.78	1.99	2.18	2.22
20	1.38	1.54	1.78	1.99	2.05	2.05	

COP		LWT (°C)					
		30	35	40	45	50	55
TO (°C)	-20	2.16	1.94	—	—	—	—
	-15	2.77	2.45	2.21	—	—	—
	-7	3.38	3.01	2.72	2.48	2.24	—
	-2	3.64	3.30	3.04	2.84	2.50	2.23
	2	3.83	3.52	3.28	3.11	2.74	2.44
	7	4.66	4.38	3.70	3.43	3.10	2.83
	10	5.47	4.77	4.02	3.61	3.15	2.86
	12	5.73	5.02	4.21	3.72	3.29	3.04
	15	6.14	5.39	4.51	3.95	3.47	3.22
20	6.93	6.19	5.05	4.47	4.09	3.69	

* Heating capacity and power input are include defrost cycle data.

* Heating capacity and power input are shown at maximum compressor operating frequency.

* Power input does not include water pump power.

* Heating capacity and power input are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C)

LWT : Leaving water temperature (°C)

Heating peak capacity and power input

Capacity (kW)		LWT (°C)					
		30	35	40	45	50	55
TO (°C)	-20	1.97	1.94	—	—	—	—
	-15	3.66	3.61	3.56	—	—	—
	-7	4.54	4.48	4.42	4.37	4.31	—
	-2	5.60	5.43	5.26	5.10	4.93	4.77
	2	6.45	6.19	5.94	5.68	5.43	5.18
	7	7.36	6.83	6.62	6.42	6.33	6.25
	10	7.82	7.40	7.15	6.89	6.74	6.36
	12	8.13	7.78	7.49	7.21	7.15	6.75
	15	8.59	8.36	8.02	7.86	7.57	7.14
20	9.57	9.53	8.99	8.90	8.38	7.56	

Power input (kW)		LWT (°C)					
		30	35	40	45	50	55
TO (°C)	-20	0.76	0.85	—	—	—	—
	-15	1.21	1.35	1.50	—	—	—
	-7	1.28	1.43	1.58	1.74	1.89	—
	-2	1.31	1.47	1.63	1.78	1.94	2.10
	2	1.42	1.55	1.69	1.82	1.96	2.09
	7	1.44	1.56	1.79	1.87	2.04	2.21
	10	1.43	1.55	1.78	1.91	2.14	2.22
	12	1.42	1.55	1.78	1.94	2.17	2.22
	15	1.40	1.55	1.78	1.99	2.18	2.22
20	1.38	1.54	1.78	1.99	2.05	2.05	

COP		LWT (°C)					
		30	35	40	45	50	55
TO (°C)	-20	2.59	2.28	—	—	—	—
	-15	3.02	2.67	2.37	—	—	—
	-7	3.55	3.13	2.80	2.51	2.28	—
	-2	4.27	3.69	3.23	2.87	2.54	2.27
	2	4.54	3.99	3.51	3.12	2.77	2.48
	7	5.11	4.38	3.70	3.43	3.10	2.83
	10	5.47	4.77	4.02	3.61	3.15	2.86
	12	5.73	5.02	4.21	3.72	3.29	3.04
	15	6.14	5.39	4.51	3.95	3.47	3.22
20	6.93	6.19	5.05	4.47	4.09	3.69	

* Heating capacity and power input are shown peak value during operation.

* Heating capacity and power input are shown at maximum compressor operating frequency

* Power input does not include water pump power.

TO : Outdoor temperature (DB°C)

LWT : Leaving water temperature (°C)

▼Outdoor unit **HWS-455H-E**
 Hydro unit **HWS-455XWH**-E**

Rated cooling capacity and power input

Rated condition 1 LWT=7°C dT=5deg TO=35°C	Capacity	kW	4.5
	Power input	kW	1.46
	EER	W/W	4.90
	Rated water flow rate	ℓ/min	12.9

* Rated cooling capacity and power input are the data at rated compressor operating frequency

* Power input does not include water pump power.

* Cooling capacity and power input are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C)

LWT : Leaving water temperature (°C)

dT : Delta temperature (deg)

Return water temperature - leaving water temperature

Cooling capacity and power input

Capacity (kW)		LWT (°C)				
		7	10	13	15	18
TO (°C)	20	5.98	6.43	7.09	7.26	7.55
	27	5.61	6.01	6.53	6.73	7.06
	30	5.45	5.83	6.29	6.51	6.84
	35	5.18	5.54	5.89	6.13	6.49
	40	3.83	4.19	4.55	4.79	5.15
	43	3.27	3.79	4.13	4.39	4.78

Power input (kW)		LWT (°C)				
		7	10	13	15	18
TO (°C)	20	1.43	1.47	1.52	1.53	1.56
	27	1.59	1.62	1.66	1.67	1.70
	30	1.66	1.69	1.72	1.74	1.76
	35	1.78	1.80	1.82	1.84	1.86
	40	1.49	1.48	1.46	1.46	1.44
	43	1.44	1.45	1.44	1.46	1.48

COP		LWT (°C)				
		7	10	13	15	18
TO (°C)	20	4.18	4.37	4.66	4.75	4.84
	27	3.53	3.71	3.93	4.03	4.15
	30	3.28	3.45	3.66	3.74	3.89
	35	2.91	3.08	3.24	3.33	3.49
	40	2.57	2.83	3.12	3.28	3.58
	43	2.27	2.61	2.87	3.01	3.23

* Cooling capacity and power input are shown at maximum compressor operating frequency.

* Power input does not include water pump power.

* Cooling capacity and power input are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C)

LWT : Leaving water temperature (°C)

▼Outdoor unit **HWS-805H-E**
 Hydro unit **HWS-805XWH**-E**

Rated heating capacity and power input

Rated condition LWT=35°C dT=5deg TO=7°C	Capacity	kW	8.0
	Power input	kW	1.79
	COP	W/W	4.46
	Rated water flow rate	ℓ/min	22.9

* Rated heating capacity and power input are the data at rated compressor operating frequency.

* Power input does not include water pump power.

* Heating capacity and power input are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C)

LWT : Leaving water temperature (°C)

dT : Delta temperature (deg)

Leaving water temperature - return water temperature

Average heating capacity and power input

Capacity (kW)		LWT (°C)					
		30	35	40	45	50	55
TO (°C)	-20	3.71	3.61	3.57	—	—	—
	-15	4.40	4.28	4.23	4.13	—	—
	-7	5.15	5.00	4.91	4.82	4.73	—
	-2	5.88	5.76	5.69	5.63	5.56	5.43
	2	6.48	6.37	6.35	6.34	6.33	6.24
	7	8.75	8.52	8.32	8.13	7.93	7.70
	10	9.28	9.01	8.76	8.50	8.24	8.11
	12	9.81	9.52	9.25	8.99	8.72	8.67
	15	10.33	10.01	9.73	9.46	9.18	9.03
20	11.73	11.32	11.03	10.75	10.46	10.22	

Power input (kW)		LWT (°C)					
		30	35	40	45	50	55
TO (°C)	-20	1.42	1.52	1.76	—	—	—
	-15	1.49	1.60	1.85	2.12	—	—
	-7	1.73	1.85	2.15	2.45	2.75	—
	-2	1.76	1.89	2.20	2.51	2.82	3.10
	2	1.77	1.91	2.22	2.53	2.85	3.13
	7	1.82	2.01	2.21	2.42	2.62	2.81
	10	1.79	1.97	2.17	2.38	2.58	2.82
	12	1.78	1.96	2.16	2.36	2.56	2.83
	15	1.76	1.94	2.19	2.43	2.68	2.97
20	1.75	1.93	2.17	2.42	2.66	3.00	

COP		LWT (°C)					
		30	35	40	45	50	55
TO (°C)	-20	2.61	2.37	2.03	—	—	—
	-15	2.95	2.68	2.29	1.95	—	—
	-7	2.98	2.70	2.28	1.97	1.72	—
	-2	3.35	3.04	2.59	2.24	1.97	1.75
	2	3.67	3.34	2.86	2.50	2.22	2.00
	7	4.81	4.24	3.76	3.36	3.03	2.74
	10	5.18	4.57	4.03	3.58	3.20	2.87
	12	5.50	4.85	4.28	3.80	3.40	3.06
	15	5.88	5.16	4.45	3.88	3.42	3.04
20	6.71	5.87	5.08	4.45	3.93	3.41	

* Heating capacity and power input are include defrost cycle data.

* Heating capacity and power input are shown at maximum compressor operating frequency.

* Power input does not include water pump power.

* Heating capacity and power input are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C)

LWT : Leaving water temperature (°C)

Heating peak capacity and power input

Capacity (kW)		LWT (°C)					
		30	35	40	45	50	55
TO (°C)	-20	3.88	3.78	3.74	—	—	—
	-15	4.59	4.47	4.41	4.31	—	—
	-7	5.89	5.74	5.65	5.55	5.29	—
	-2	6.81	6.60	6.48	6.35	6.23	5.84
	2	7.70	7.46	7.34	7.23	7.01	6.77
	7	8.75	8.52	8.32	8.13	7.93	7.70
	10	9.28	9.01	8.76	8.50	8.24	8.11
	12	9.81	9.52	9.25	8.99	8.72	8.67
	15	10.33	10.01	9.73	9.46	9.18	9.03
20	11.73	11.32	11.03	10.75	10.46	10.22	

Power input (kW)		LWT (°C)					
		30	35	40	45	50	55
TO (°C)	-20	1.44	1.55	1.89	—	—	—
	-15	1.53	1.65	2.01	2.28	—	—
	-7	1.55	1.68	2.04	2.41	2.56	—
	-2	1.57	1.71	2.06	2.42	2.62	2.74
	2	1.56	1.71	2.05	2.38	2.62	2.76
	7	1.82	2.01	2.21	2.42	2.62	2.81
	10	1.79	1.97	2.17	2.38	2.58	2.82
	12	1.78	1.96	2.16	2.36	2.56	2.83
	15	1.76	1.94	2.19	2.43	2.68	2.97
20	1.75	1.93	2.17	2.42	2.66	3.00	

COP		LWT (°C)					
		30	35	40	45	50	55
TO (°C)	-20	2.68	2.44	1.98	—	—	—
	-15	3.00	2.71	2.20	1.89	—	—
	-7	3.79	3.41	2.76	2.30	2.07	—
	-2	4.34	3.86	3.15	2.63	2.38	2.13
	2	4.94	4.37	3.59	3.03	2.68	2.45
	7	4.81	4.24	3.76	3.36	3.03	2.74
	10	5.18	4.57	4.03	3.58	3.20	2.87
	12	5.50	4.85	4.28	3.80	3.40	3.06
	15	5.88	5.16	4.45	3.88	3.42	3.04
20	6.71	5.87	5.08	4.45	3.93	3.41	

* Heating capacity and power input are shown peak value during operation.
 * Heating capacity and power input are shown at maximum compressor operating frequency.
 * Power input does not include water pump power.

TO : Outdoor temperature (DB°C)
 LWT : Leaving water temperature (°C)

▼Outdoor unit **HWS-805H-E**
 Hydro unit **HWS-805XWH**-E**

Rated cooling capacity and power input

Rated condition LWT=7°C dT=5deg TO=35°C	Capacity	kW	6.0
	Power input	kW	2
	EER	W/W	3.10
	Rated water flow rate	ℓ/min	17.2

* Rated cooling capacity and power input are the data at rated compressor operating frequency.

* Power input does not include water pump power.

* Cooling capacity and power input are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C)

LWT : Leaving water temperature (°C)

dT : Delta temperature (deg)

Return water temperature - leaving water temperature

Cooling capacity and power input

Capacity (kW)		LWT (°C)				
		7	10	13	15	18
TO (°C)	20	7.34	7.91	8.49	8.95	9.64
	27	7.18	7.74	8.30	8.75	9.43
	30	7.11	7.67	8.23	8.67	9.34
	35	7.00	7.55	8.10	8.53	9.19
	40	6.41	6.91	7.42	7.82	8.42
	43	5.39	5.75	6.13	6.43	6.85

Power input (kW)		LWT (°C)				
		7	10	13	15	18
TO (°C)	20	1.65	1.68	1.71	1.73	1.77
	27	2.01	2.04	2.08	2.11	2.15
	30	2.16	2.20	2.24	2.27	2.32
	35	2.42	2.46	2.51	2.54	2.59
	40	2.62	2.66	2.71	2.74	2.80
	43	2.37	2.38	2.38	2.38	2.40

COP		LWT (°C)				
		7	10	13	15	18
TO (°C)	20	4.45	4.71	4.97	5.17	5.46
	27	3.57	3.79	3.99	4.15	4.38
	30	3.29	3.48	3.67	3.82	4.03
	35	2.89	3.06	3.23	3.36	3.55
	40	2.45	2.60	2.74	2.85	3.01
	43	2.27	2.42	2.58	2.71	2.85

* Cooling capacity and power input are shown at maximum compressor operating frequency.

* Power input does not include water pump power.

* Cooling capacity and power input are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C)

LWT : Leaving water temperature (°C)

Heating capacity and input specifications

▼Outdoor unit HWS-1105H-E
 Hydro unit HWS-1405XWH**-E

Rated heating capacity and power input

Rated condition LWT=35°C dT=5deg TO=7°C	Capacity	kW	11.2
	Power input	kW	2.30
	COP	W/W	4.88
	Rated water flow rate	ℓ/min	32.1

* Rated heating capacity and power input are the data at rated compressor operating frequency.

* Power input does not include water pump power.

* Heating capacity and power input are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C)
 LWT : Leaving water temperature (°C)
 dT : Delta temperature (deg)
 Leaving water temperature - return water temperature

Average heating capacity and power input

Capacity (kW)		LWT (°C)					
		30	35	40	45	50	55
TO (°C)	-20	5.42	5.25	5.10	4.94	—	—
	-15	6.79	6.57	6.38	6.19	—	—
	-7	8.31	8.04	7.81	7.58	7.35	—
	-2	9.79	9.48	9.21	8.94	8.67	7.62
	2	10.44	10.10	9.81	9.53	9.24	8.12
	7	15.12	14.63	14.12	13.62	13.11	10.98
	10	16.03	15.51	14.97	14.43	13.89	11.64
	12	16.95	16.24	15.68	15.12	14.55	12.19
	15	18.30	17.20	16.13	15.07	14.00	11.72
20	21.09	19.44	18.24	17.03	15.83	13.26	

Power input (kW)		LWT (°C)					
		30	35	40	45	50	55
TO (°C)	-20	2.34	2.52	2.91	3.31	—	—
	-15	2.44	2.62	3.03	3.44	—	—
	-7	2.68	2.89	3.34	3.79	4.23	—
	-2	2.64	2.84	3.29	3.73	4.17	4.13
	2	2.60	2.80	3.24	3.67	4.11	4.07
	7	3.00	3.24	3.50	3.76	4.02	3.99
	10	2.99	3.22	3.48	3.74	4.00	3.96
	12	2.98	3.20	3.47	3.73	3.99	3.95
	15	2.93	3.16	3.33	3.50	3.67	3.64
20	2.91	3.14	3.31	3.48	3.65	3.61	

COP		LWT (°C)					
		30	35	40	45	50	55
TO (°C)	-20	2.31	2.08	1.75	1.49	—	—
	-15	2.78	2.50	2.10	1.80	—	—
	-7	3.10	2.78	2.34	2.00	1.74	—
	-2	3.71	3.33	2.80	2.40	2.08	1.85
	2	4.01	3.60	3.03	2.59	2.25	1.99
	7	5.03	4.52	4.04	3.62	3.26	2.75
	10	5.37	4.82	4.31	3.86	3.48	2.94
	12	5.70	5.07	4.52	4.06	3.65	3.09
	15	6.24	5.45	4.85	4.31	3.82	3.22
20	7.25	6.20	5.51	4.90	4.34	3.67	

* Heating capacity and power input are include defrost cycle data.

* Heating capacity and power input are shown at maximum compressor operating frequency.

* Power input does not include water pump power.

* Heating capacity and power input are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C)

LWT : Leaving water temperature (°C)

Heating peak capacity and power input

Capacity (kW)		LWT (°C)					
		30	35	40	45	50	55
TO (°C)	-20	6.36	6.20	6.08	5.84	—	—
	-15	7.72	7.52	7.36	7.12	—	—
	-7	9.95	9.67	9.44	9.16	8.83	—
	-2	11.52	11.18	10.89	10.57	10.26	8.60
	2	12.84	12.42	12.07	11.72	11.38	9.53
	7	15.12	14.63	14.12	13.62	13.11	10.98
	10	16.03	15.51	14.97	14.43	13.89	11.64
	12	16.95	16.24	15.68	15.12	14.55	12.19
	15	18.30	17.20	16.13	15.07	14.00	11.72
20	21.09	19.44	18.24	17.03	15.83	13.26	

Power input (kW)		LWT (°C)					
		30	35	40	45	50	55
TO (°C)	-20	2.23	2.36	2.75	3.11	—	—
	-15	2.39	2.53	2.95	3.34	—	—
	-7	2.47	2.64	3.06	3.48	3.89	—
	-2	2.51	2.69	3.12	3.54	3.97	3.92
	2	2.51	2.71	3.13	3.56	3.98	3.95
	7	3.00	3.24	3.50	3.76	4.02	3.99
	10	2.99	3.22	3.48	3.74	4.00	3.96
	12	2.98	3.20	3.47	3.73	3.99	3.95
	15	2.93	3.16	3.33	3.50	3.67	3.64
20	2.91	3.14	3.31	3.48	3.65	3.61	

COP		LWT (°C)					
		30	35	40	45	50	55
TO (°C)	-20	2.85	2.63	2.21	1.88	—	—
	-15	3.24	2.97	2.49	2.13	—	—
	-7	4.03	3.66	3.09	2.63	2.27	—
	-2	4.59	4.15	3.49	2.98	2.59	2.19
	2	5.11	4.59	3.86	3.29	2.86	2.42
	7	5.03	4.52	4.04	3.62	3.26	2.75
	10	5.37	4.82	4.31	3.86	3.48	2.94
	12	5.70	5.07	4.52	4.06	3.65	3.09
	15	6.24	5.45	4.85	4.31	3.82	3.22
20	7.25	6.20	5.51	4.90	4.34	3.67	

* Heating capacity and power input are shown peak value during operation.

* Heating capacity and power input are shown at maximum compressor operating frequency.

* Power input does not include water pump power.

TO : Outdoor temperature (DB°C)

LWT : Leaving water temperature (°C)

Cooling capacity and input specifications

▼Outdoor unit HWS-1105H-E
 Hydro unit HWS-1405XWH**-E

Rated cooling capacity and power input

Rated condition 1 LWT=7°C dT=5deg TO=35°C	Capacity	kW	10.0
	Power input	kW	3.26
	EER	W/W	3.07
	Rated water flow rate	ℓ/min	28.7

* Rated cooling capacity and power input are the data at rated compressor operating frequency.

* Power input does not include water pump power.

* Cooling capacity and power input are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C)
 LWT : Leaving water temperature (°C)
 dT : Delta temperature (deg)
 Return water temperature - leaving water temperature

Cooling capacity and power input

Capacity (kW)		LWT (°C)				
		7	10	13	15	18
TO (°C)	20	11.14	12.04	12.95	13.67	14.75
	27	10.72	11.62	12.52	13.24	14.32
	30	10.54	11.44	12.34	13.05	14.13
	35	10.24	11.14	12.03	12.75	13.82
	40	9.18	9.98	10.78	11.42	12.38
	43	7.06	7.67	8.29	8.78	9.53

Power input (kW)		LWT (°C)				
		7	10	13	15	18
TO (°C)	20	2.15	2.16	2.17	2.17	2.19
	27	2.68	2.71	2.74	2.76	2.79
	30	2.91	2.95	2.98	3.01	3.05
	35	3.29	3.34	3.39	3.43	3.49
	40	3.57	3.57	3.58	3.62	3.69
	43	3.06	3.05	3.05	3.07	3.10

COP		LWT (°C)				
		7	10	13	15	18
TO (°C)	20	5.18	5.58	5.97	6.29	6.75
	27	4.00	4.29	4.57	4.80	5.12
	30	3.62	3.88	4.14	4.34	4.63
	35	3.11	3.33	3.55	3.72	3.96
	40	2.57	2.79	3.01	3.16	3.36
	43	2.30	2.51	2.72	2.86	3.07

* Cooling capacity and power input are shown at maximum compressor operating frequency.

* Power input does not include water pump power.

* Cooling capacity and power input are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C)

LWT : Leaving water temperature (°C)

Heating capacity and input specifications

▼Outdoor unit HWS-1405H-E
 Hydro unit HWS-1405XWH**-E

Rated heating capacity and power input

Rated condition 1 LWT=35°C dT=5deg TO=7°C	Capacity	kW	14.0
	Power input	kW	3.11
	COP	W/W	4.50
	Rated water flow rate	ℓ/min	40.1

* Rated heating capacity and power input are the data at rated compressor operating frequency.

* Power input does not include water pump power.

* Heating capacity and power input are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C)
 LWT : Leaving water temperature (°C)
 dT : Delta temperature (deg)
 Leaving water temperature - return water temperature

Average heating capacity and power input

Capacity (kW)		LWT (°C)					
		30	35	40	45	50	55
TO (°C)	-20	5.92	5.69	5.36	5.03	—	—
	-15	7.61	7.31	6.89	6.47	—	—
	-7	8.98	8.63	8.13	7.64	7.14	—
	-2	10.47	10.07	9.49	8.91	8.33	7.84
	2	11.08	10.65	10.04	9.43	8.81	8.30
	7	17.42	16.74	15.50	14.26	13.02	11.67
	10	18.29	17.58	16.28	14.97	13.67	12.26
	12	19.53	18.58	17.21	15.83	14.45	12.96
	15	20.96	19.56	17.68	15.80	13.92	12.48
20	23.26	21.29	19.24	17.20	15.15	13.58	

Power input (kW)		LWT (°C)					
		30	35	40	45	50	55
TO (°C)	-20	2.60	2.81	3.07	3.32	—	—
	-15	2.74	2.96	3.23	3.51	—	—
	-7	3.05	3.29	3.59	3.89	4.19	—
	-2	3.01	3.25	3.54	3.84	4.13	4.16
	2	2.96	3.20	3.49	3.78	4.07	4.10
	7	3.65	3.95	3.97	4.00	4.03	4.06
	10	3.66	3.95	3.97	4.00	4.03	4.06
	12	3.64	3.93	3.93	3.94	3.95	3.98
	15	3.62	3.90	3.89	3.88	3.87	3.89
20	3.42	3.68	3.67	3.65	3.64	3.66	

COP		LWT (°C)					
		30	35	40	45	50	55
TO (°C)	-20	2.27	2.02	1.75	1.52	—	—
	-15	2.77	2.47	2.13	1.85	—	—
	-7	2.94	2.62	2.26	1.96	1.70	—
	-2	3.48	3.10	2.68	2.32	2.02	1.88
	2	3.74	3.33	2.88	2.49	2.16	2.02
	7	4.77	4.24	3.90	3.56	3.23	2.87
	10	5.00	4.45	4.09	3.74	3.39	3.02
	12	5.36	4.73	4.38	4.02	3.66	3.26
	15	5.79	5.01	4.54	4.07	3.60	3.21
20	6.80	5.78	5.25	4.71	4.17	3.71	

- * Heating capacity and power input are include defrost cycle data.
- * Heating capacity and power input are shown at maximum operating frequency.
- * Power input does not include water pump power.
- * Heating capacity and power input are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C)
 LWT : Leaving water temperature (°C)

Heating peak capacity and power input

Capacity (kW)		LWT (°C)					
		30	35	40	45	50	55
TO (°C)	-20	6.56	6.36	6.04	5.64	—	—
	-15	8.62	8.34	7.90	7.37	—	—
	-7	11.19	10.79	10.21	9.59	8.93	—
	-2	12.98	12.50	11.80	11.09	10.37	8.88
	2	14.14	13.59	12.81	12.02	11.26	9.63
	7	17.42	16.74	15.50	14.26	13.02	11.67
	10	18.29	17.58	16.28	14.97	13.67	12.26
	12	19.53	18.58	17.21	15.83	14.45	12.96
	15	20.96	19.56	17.68	15.80	13.92	12.48
20	23.26	21.29	19.24	17.20	15.15	13.58	

Power input (kW)		LWT (°C)					
		30	35	40	45	50	55
TO (°C)	-20	2.51	2.65	2.92	3.15	—	—
	-15	2.66	2.83	3.11	3.36	—	—
	-7	2.83	3.03	3.32	3.59	3.87	—
	-2	2.89	3.11	3.40	3.69	3.98	4.00
	2	2.89	3.11	3.40	3.68	3.98	4.01
	7	3.65	3.95	3.97	4.00	4.03	4.06
	10	3.66	3.95	3.97	4.00	4.03	4.06
	12	3.64	3.93	3.93	3.94	3.95	3.98
	15	3.62	3.90	3.89	3.88	3.87	3.89
20	3.42	3.68	3.67	3.65	3.64	3.66	

COP		LWT (°C)					
		30	35	40	45	50	55
TO (°C)	-20	2.62	2.39	2.07	1.79	—	—
	-15	3.24	2.95	2.54	2.19	—	—
	-7	3.96	3.56	3.08	2.67	2.31	—
	-2	4.49	4.02	3.47	3.01	2.61	2.22
	2	4.89	4.36	3.77	3.27	2.83	2.40
	7	4.77	4.24	3.90	3.56	3.23	2.87
	10	5.00	4.45	4.09	3.74	3.39	3.02
	12	5.36	4.73	4.38	4.02	3.66	3.26
	15	5.79	5.01	4.54	4.07	3.60	3.21
20	6.80	5.78	5.25	4.71	4.17	3.71	

* Heating capacity and power input are shown peak value during operation.

* Heating capacity and power input are shown at maximum compressor operating frequency.

* Power input does not include water pump power.

TO : Outdoor temperature (DB°C)

LWT : Leaving water temperature (°C)

Cooling capacity and input specifications

▼Outdoor unit HWS-1405H-E
 Hydro unit HWS-1405XWH**-E

Rated cooling capacity and power input

Rated condition 1 LWT=7°C dT=5deg LWT=35°C	Capacity	kW	11.0
	Power input	kW	3.81
	EER	W/W	2.89
	Rated water flow rate	ℓ/min	31.5

* Rated cooling capacity and power input are the data at rated compressor operating frequency.

* Power input does not include water pump power.

* Cooling capacity and power input are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C)

LWT : Leaving water temperature (°C)

dT : Delta temperature (deg)

Return water temperature - Leaving water temperature

Cooling capacity and power input

Capacity (kW)		LWT (°C)				
		7	10	13	15	18
TO (°C)	20	13.29	14.40	15.50	16.38	17.71
	27	12.59	13.55	14.52	15.29	16.45
	30	12.28	13.19	14.09	14.82	15.90
	35	11.78	12.59	13.39	14.03	15.00
	40	9.46	10.10	10.75	11.26	12.05
	43	7.29	7.79	8.28	8.69	8.90

Power input (kW)		LWT (°C)				
		7	10	13	15	18
TO (°C)	20	2.88	2.88	2.88	2.88	2.88
	27	3.44	3.44	3.44	3.44	3.44
	30	3.67	3.67	3.67	3.67	3.67
	35	4.07	4.07	4.07	4.07	4.07
	40	3.83	3.76	3.70	3.71	3.68
	43	3.24	3.15	3.11	3.08	3.05

EER		LWT (°C)				
		7	10	13	15	18
TO (°C)	20	4.61	5.00	5.38	5.69	6.15
	27	3.66	3.94	4.23	4.45	4.79
	30	3.34	3.59	3.84	4.03	4.33
	35	2.89	3.09	3.29	3.45	3.69
	40	2.47	2.69	2.90	3.04	3.27
	43	2.25	2.47	2.67	2.82	2.91

* Cooling capacity and power input are shown at maximum compressor operating frequency.

* Power input does not include water pump power.

* Cooling capacity and power input are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C)

LWT : Leaving water temperature (°C)

Heating capacity and input specifications

▼Outdoor unit HWS-1105H8-E, HWS-1105H8R-E
 Hydro unit HWS-1405XWH**-E

Rated heating capacity and power input

Rated condition 1 LWT=35°C dT=5deg TO=7°C	Capacity	kW	11.2
	Power input	kW	2.34
	COP	W/W	4.80
	Rated water flow rate	ℓ/min	32.1

* Rated heating capacity and power input are the data at rated compressor operating frequency.

* Power input does not include water pump power.

* Heating capacity and power input are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C)

LWT : Leaving water temperature (°C)

dT : Delta temperature (deg)

Leaving water temperature - return water temperature

Average heating capacity and power input

Capacity (kW)		LWT (°C)					
		30	35	40	45	50	55
TO (°C)	-20	5.39	5.20	5.13	5.06	—	—
	-15	7.05	6.79	6.71	6.61	—	—
	-7	8.35	8.04	7.93	7.81	7.70	—
	-2	9.51	9.13	8.98	8.84	8.69	8.13
	2	11.15	10.46	10.13	9.81	9.48	8.86
	7	15.32	14.73	14.33	13.93	13.53	12.56
	10	16.36	15.73	15.37	15.02	14.66	13.85
	12	17.05	16.39	16.02	15.64	15.26	14.57
	15	17.90	17.21	16.76	16.30	15.85	15.03
20	20.04	19.27	18.83	18.38	17.94	16.85	

Power input (kW)		LWT (°C)					
		30	35	40	45	50	55
TO (°C)	-20	2.15	2.31	2.59	2.88	—	—
	-15	2.40	2.58	2.91	3.23	—	—
	-7	2.68	2.88	3.26	3.64	4.01	—
	-2	2.64	2.84	3.22	3.59	3.97	4.17
	2	2.70	2.90	3.24	3.59	3.93	4.13
	7	2.92	3.14	3.45	3.76	4.08	4.36
	10	2.92	3.14	3.46	3.79	4.12	4.43
	12	2.91	3.13	3.47	3.81	4.15	4.48
	15	2.90	3.11	3.47	3.82	4.17	4.48
20	2.88	3.10	3.46	3.83	4.20	4.55	

COP		LWT (°C)					
		30	35	40	45	50	55
TO (°C)	-20	2.51	2.25	1.98	1.76	—	—
	-15	2.94	2.63	2.31	2.04	—	—
	-7	3.11	2.79	2.43	2.15	1.92	—
	-2	3.60	3.21	2.79	2.46	2.19	1.95
	2	4.13	3.61	3.12	2.73	2.41	2.14
	7	5.24	4.69	4.15	3.70	3.32	2.88
	10	5.61	5.02	4.44	3.96	3.56	3.13
	12	5.85	5.23	4.61	4.10	3.68	3.25
	15	6.18	5.53	4.83	4.27	3.80	3.36
20	6.96	6.22	5.44	4.80	4.28	3.70	

* Heating capacity and power input are include defrost cycle data.

* Heating capacity and power input are shown at maximum compressor operating frequency.

* Power input does not include water pump power.

* Heating capacity and power input are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C)

LWT : Leaving water temperature (°C)

Heating peak capacity and power input

Capacity (kW)		LWT (°C)					
		30	35	40	45	50	55
TO (°C)	-20	6.38	6.12	6.01	5.90	—	—
	-15	7.60	7.29	7.16	7.03	—	—
	-7	9.90	9.50	9.33	9.17	8.92	—
	-2	11.30	10.86	10.69	10.52	10.22	9.44
	2	12.99	12.49	12.13	11.78	11.26	10.40
	7	15.32	14.73	14.33	13.93	13.53	12.56
	10	16.36	15.73	15.37	15.02	14.66	13.85
	12	17.05	16.39	16.02	15.64	15.26	14.57
	15	17.90	17.21	16.76	16.30	15.85	15.03
	20	20.04	19.27	18.83	18.38	17.94	16.85

Power input (kW)		LWT (°C)					
		30	35	40	45	50	55
TO (°C)	-20	1.91	2.06	2.37	2.69	—	—
	-15	2.21	2.38	2.74	3.11	—	—
	-7	2.37	2.55	2.94	3.34	3.73	—
	-2	2.42	2.60	3.00	3.42	3.82	4.06
	2	2.54	2.74	3.12	3.52	3.90	4.14
	7	2.92	3.14	3.45	3.76	4.08	4.36
	10	2.92	3.14	3.46	3.79	4.12	4.43
	12	2.91	3.13	3.47	3.81	4.15	4.48
	15	2.90	3.11	3.47	3.82	4.17	4.48
	20	2.88	3.10	3.46	3.83	4.20	4.55

COP		LWT (°C)					
		30	35	40	45	50	55
TO (°C)	-20	3.34	2.97	2.54	2.19	—	—
	-15	3.44	3.07	2.61	2.26	—	—
	-7	4.18	3.73	3.18	2.75	2.39	—
	-2	4.68	4.17	3.56	3.07	2.67	2.33
	2	5.12	4.56	3.89	3.35	2.89	2.51
	7	5.24	4.69	4.15	3.70	3.32	2.88
	10	5.61	5.02	4.44	3.96	3.56	3.13
	12	5.85	5.23	4.61	4.10	3.68	3.25
	15	6.18	5.53	4.83	4.27	3.80	3.36
	20	6.96	6.22	5.44	4.80	4.28	3.70

* Heating capacity and power input are shown peak value during operation.

* Heating capacity and power input are shown at maximum compressor operating frequency.

* Power input does not include water pump power.

TO : Outdoor temperature (DB°C)

LWT : Leaving water temperature (°C)

Cooling capacity and input specifications

▼Outdoor unit HWS-1105H8-E, HWS-1105H8R-E
 Hydro unit HWS-1405XWH**-E

Rated cooling capacity and power input

Rated condition 1 LWT=7°C dT=5deg TO=35°C	Capacity	kW	10.0
	Power input	kW	3.26
	EER	W/W	3.07
	Rated water flow rate	ℓ/min	28.7

* Rated cooling capacity and power input are the data at rated compressor operating frequency.

* Power input does not include water pump power.

* Cooling capacity and power input are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C)

LWT : Leaving water temperature (°C)

dT : Delta temperature (deg)

Return water temperature - leaving water temperature

Cooling capacity and power input

Capacity (kW)		LWT (°C)				
		7	10	13	15	18
TO (°C)	20	11.15	11.95	12.75	13.38	14.34
	27	10.69	11.46	12.24	12.86	13.78
	30	10.49	11.25	12.02	12.63	13.55
	35	10.16	10.91	11.66	12.25	13.15
	40	9.39	10.09	10.78	11.33	12.01
	43	8.93	9.59	10.25	10.78	11.33

Power input (kW)		LWT (°C)				
		7	10	13	15	18
TO (°C)	20	2.10	2.11	2.12	2.13	2.14
	27	2.60	2.62	2.65	2.67	2.70
	30	2.81	2.84	2.87	2.90	2.94
	35	3.17	3.21	3.25	3.29	3.34
	40	3.50	3.55	3.59	3.63	3.67
	43	3.70	3.75	3.80	3.84	3.87

COP		LWT (°C)				
		7	10	13	15	18
TO (°C)	20	5.32	5.67	6.02	6.29	6.70
	27	4.12	4.37	4.62	4.82	5.11
	30	3.73	3.96	4.18	4.36	4.61
	35	3.21	3.40	3.58	3.73	3.94
	40	2.68	2.84	3.00	3.12	3.27
	43	2.41	2.56	2.70	2.81	2.93

* Cooling capacity and power input are shown at maximum compressor operating frequency.

* Power input does not include water pump power.

* Cooling capacity and power input are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C)

LWT : Leaving water temperature (°C)

Heating capacity and input specifications

▼Outdoor unit HWS-1405H8-E, HWS-1405H8R-E
 Hydro unit HWS-1405XWH**-E

Rated heating capacity and power input

Rated condition 1 LWT=35°C dT=5deg TO=7°C	Capacity	kW	14.0
	Power input	kW	3.16
	COP	W/W	4.44
	Rated water flow rate	ℓ/min	40.1

* Rated heating capacity and power input are the data at rated compressor operating frequency.

* Power input does not include water pump power.

* Heating capacity and power input are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C)

LWT : Leaving water temperature (°C)

dT : Delta temperature (deg)

Leaving water temperature - return water temperature

Average heating capacity and power input

Capacity (kW)		LWT (°C)					
		30	35	40	45	50	55
TO (°C)	-20	5.79	5.59	5.48	5.36	—	—
	-15	7.58	7.30	7.15	7.00	—	—
	-7	8.98	8.64	8.46	8.27	8.09	—
	-2	10.22	9.81	9.59	9.36	9.13	8.53
	2	11.74	11.01	10.66	10.31	9.96	9.30
	7	16.35	15.77	15.42	15.07	14.72	13.64
	10	17.61	17.14	16.74	16.35	15.95	15.04
	12	18.37	17.86	17.50	17.14	16.77	15.81
	15	19.39	18.86	18.31	17.77	17.22	17.21
20	21.41	20.90	20.37	19.83	19.30	18.75	

Power input (kW)		LWT (°C)					
		30	35	40	45	50	55
TO (°C)	-20	2.39	2.51	2.81	3.11	—	—
	-15	2.66	2.80	3.15	3.49	—	—
	-7	2.97	3.14	3.53	3.93	4.32	—
	-2	2.92	3.09	3.48	3.88	4.27	4.49
	2	3.03	3.21	3.55	3.89	4.23	4.45
	7	3.29	3.55	3.89	4.24	4.58	4.86
	10	3.29	3.55	3.91	4.27	4.63	4.93
	12	3.29	3.55	3.91	4.29	4.67	4.98
	15	3.31	3.55	3.93	4.31	4.68	5.09
20	3.34	3.58	3.97	4.36	4.75	5.18	

COP		LWT (°C)					
		30	35	40	45	50	55
TO (°C)	-20	2.42	2.23	1.95	1.73	—	—
	-15	2.84	2.60	2.27	2.00	—	—
	-7	3.02	2.76	2.39	2.11	1.87	—
	-2	3.50	3.18	2.75	2.41	2.14	1.90
	2	3.88	3.44	3.00	2.65	2.35	2.09
	7	4.98	4.44	3.96	3.56	3.21	2.81
	10	5.36	4.83	4.29	3.83	3.44	3.05
	12	5.59	5.03	4.47	3.99	3.59	3.17
	15	5.86	5.31	4.66	4.13	3.68	3.38
20	6.41	5.83	5.13	4.55	4.06	3.62	

* Heating capacity and power input are include defrost cycle data.

* Heating capacity and power input are shown at maximum compressor operating frequency.

* Power input does not include water pump power.

* Heating capacity and power input are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C)

LWT : Leaving water temperature (°C)

Heating peak capacity and power input

Capacity (kW)		LWT (°C)					
		30	35	40	45	50	55
TO (°C)	-20	7.15	6.85	6.68	6.50	—	—
	-15	8.51	8.16	7.96	7.75	—	—
	-7	11.08	10.64	10.38	10.12	9.76	—
	-2	12.66	12.16	11.88	11.61	11.19	10.33
	2	14.25	13.70	13.30	12.90	12.33	11.39
	7	16.35	15.77	15.42	15.07	14.72	13.64
	10	17.61	17.14	16.74	16.35	15.95	15.04
	12	18.37	17.86	17.50	17.14	16.77	15.81
	15	19.39	18.86	18.31	17.77	17.22	17.21
20	21.41	20.90	20.37	19.83	19.30	18.75	

Power input (kW)		LWT (°C)					
		30	35	40	45	50	55
TO (°C)	-20	2.24	2.41	2.76	3.13	—	—
	-15	2.59	2.78	3.19	3.62	—	—
	-7	2.77	2.98	3.42	3.88	4.32	—
	-2	2.83	3.05	3.50	3.98	4.43	4.71
	2	3.01	3.25	3.67	4.11	4.52	4.80
	7	3.29	3.55	3.89	4.24	4.58	4.86
	10	3.29	3.55	3.91	4.27	4.63	4.93
	12	3.29	3.55	3.91	4.29	4.67	4.98
	15	3.31	3.55	3.93	4.31	4.68	5.09
20	3.34	3.58	3.97	4.36	4.75	5.18	

COP		LWT (°C)					
		30	35	40	45	50	55
TO (°C)	-20	3.19	2.85	2.42	—	—	—
	-15	3.29	2.94	2.49	2.14	—	—
	-7	4.00	3.57	3.03	2.61	2.26	—
	-2	4.48	3.99	3.39	2.92	2.53	2.20
	2	4.73	4.21	3.62	3.14	2.73	2.37
	7	4.98	4.44	3.96	3.56	3.21	2.81
	10	5.36	4.83	4.29	3.83	3.44	3.05
	12	5.59	5.03	4.47	4.00	3.59	3.17
	15	5.86	5.31	4.66	4.13	3.68	3.38
20	6.41	5.83	5.13	4.55	4.06	3.62	

* Heating capacity and power input are shown peak value during operation.

* Heating capacity and power input are shown at maximum compressor operating frequency.

* Power input does not include water pump power.

TO : Outdoor temperature (DB°C)

LWT : Leaving water temperature (°C)

Cooling capacity and input specifications

▼Outdoor unit HWS-1405H8-E, HWS-1405H8R-E
 Hydro unit HWS-1405XWH**-E

Rated cooling capacity and power input

Rated condition 1 LWT=7°C dT=5deg TO=35°C	Capacity	kW	11.0
	Power input	kW	3.81
	EER	W/W	2.89
	Rated water flow rate	ℓ/min	31.5

* Rated cooling capacity and power input are the data at rated compressor operating frequency.

* Power input does not include water pump power.

* Cooling capacity and power input are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C)

LWT : Leaving water temperature (°C)

dT : Delta temperature (deg)

Return water temperature - leaving water temperature

Cooling capacity and power input

Capacity (kW)		LWT (°C)				
		7	10	13	15	18
TO (°C)	20	13.27	14.18	15.10	15.83	16.92
	27	12.69	13.57	14.46	15.17	16.23
	30	12.44	13.31	14.19	14.88	15.93
	35	12.02	12.88	13.73	14.41	15.44
	40	11.27	12.07	12.87	13.38	14.18
	43	10.82	11.59	12.36	12.75	13.43

Power input (kW)		LWT (°C)				
		7	10	13	15	18
TO (°C)	20	2.82	2.82	2.82	2.82	2.82
	27	3.43	3.46	3.49	3.52	3.55
	30	3.70	3.74	3.78	3.82	3.87
	35	4.13	4.20	4.26	4.31	4.39
	40	4.58	4.65	4.72	4.75	4.80
	43	4.84	4.92	5.00	5.00	5.04

COP		LWT (°C)				
		7	10	13	15	18
TO (°C)	20	4.70	5.02	5.35	5.61	6.00
	27	3.69	3.92	4.14	4.31	4.57
	30	3.37	3.56	3.75	3.90	4.12
	35	2.91	3.07	3.22	3.34	3.52
	40	2.46	2.60	2.73	2.82	2.96
	43	2.23	2.35	2.47	2.55	2.67

* Cooling capacity and power input are shown at maximum compressor operating frequency.

* Power input does not include water pump power.

* Cooling capacity and power input are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C)

LWT : Leaving water temperature (°C)

Heating capacity and input specifications

▼Outdoor unit HWS-1605H8-E, HWS-1605H8R-E
 Hydro unit HWS-1405XWH**-E

Rated heating capacity and power input

Rated condition 1 LWT=35°C dT=5deg TO=7°C	Capacity	kW	16.0
	Power input	kW	3.72
	COP	W/W	4.30
	Rated water flow rate	ℓ/min	45.7

* Rated heating capacity and power input are the data at rated compressor operating frequency.

* Power input does not include water pump power.

* Heating capacity and power input are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C)

LWT : Leaving water temperature (°C)

dT : Delta temperature (deg)

Leaving water temperature - return water temperature

Average heating capacity and power input

Capacity (kW)		LWT (°C)					
		30	35	40	45	50	55
TO (°C)	-20	6.07	5.85	5.72	5.58	—	—
	-15	7.94	7.65	7.47	7.28	—	—
	-7	9.40	9.05	8.83	8.61	8.39	—
	-2	10.71	10.28	10.01	9.74	9.47	8.85
	2	12.38	11.61	11.18	10.76	10.33	9.65
	7	17.43	16.76	16.26	15.77	15.28	14.12
	10	18.63	17.92	17.47	17.01	16.56	15.57
	12	19.41	18.68	18.23	17.78	17.32	16.53
	15	20.63	19.82	19.30	18.78	18.27	17.23
20	23.10	22.08	21.54	21.01	20.47	19.13	

Power input (kW)		LWT (°C)					
		30	35	40	45	50	55
TO (°C)	-20	2.59	2.72	3.02	3.32	—	—
	-15	2.88	3.03	3.39	3.73	—	—
	-7	3.21	3.39	3.79	4.20	4.60	—
	-2	3.16	3.34	3.74	4.15	4.55	4.78
	2	3.27	3.46	3.81	4.16	4.51	4.74
	7	3.61	3.89	4.24	4.58	4.93	5.22
	10	3.61	3.89	4.25	4.62	4.98	5.30
	12	3.61	3.89	4.26	4.64	5.02	5.35
	15	3.63	3.90	4.30	4.70	5.10	5.46
20	3.66	3.93	4.34	4.76	5.17	5.55	

COP		LWT (°C)					
		30	35	40	45	50	55
TO (°C)	-20	2.35	2.15	1.89	1.68	—	—
	-15	2.75	2.52	2.21	1.95	—	—
	-7	2.93	2.67	2.33	2.05	1.82	—
	-2	3.39	3.08	2.67	2.35	2.08	1.85
	2	3.79	3.36	2.94	2.59	2.29	2.04
	7	4.83	4.30	3.84	3.44	3.10	2.70
	10	5.17	4.61	4.11	3.69	3.32	2.94
	12	5.38	4.80	4.28	3.83	3.45	3.09
	15	5.69	5.09	4.49	4.00	3.58	3.16
20	6.31	5.62	4.96	4.42	3.96	3.45	

* Heating capacity and power input are include defrost cycle data.

* Heating capacity and power input are shown at maximum operating frequency.

* Power input does not include water pump power.

* Heating capacity and power input are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C)

LWT : Leaving water temperature (°C)

Heating peak capacity and power input

Capacity (kW)		LWT (°C)					
		30	35	40	45	50	55
TO (°C)	-20	7.56	7.25	7.04	6.84	—	—
	-15	9.00	8.63	8.39	8.15	—	—
	-7	11.73	11.25	10.94	10.64	10.22	—
	-2	13.39	12.87	12.53	12.20	11.72	10.82
	2	15.17	14.59	14.09	13.60	12.91	11.93
	7	17.43	16.76	16.26	15.77	15.28	14.12
	10	18.63	17.92	17.47	17.01	16.56	15.57
	12	19.41	18.68	18.23	17.78	17.32	16.53
	15	20.63	19.82	19.30	18.78	18.27	17.23
20	23.10	22.08	21.54	21.01	20.47	19.13	

Power input (kW)		LWT (°C)					
		30	35	40	45	50	55
TO (°C)	-20	2.45	2.63	3.00	3.38	—	—
	-15	2.83	3.04	3.46	3.91	—	—
	-7	3.03	3.26	3.71	4.19	4.64	—
	-2	3.09	3.33	3.80	4.29	4.76	5.06
	2	3.28	3.54	3.98	4.43	4.86	5.16
	7	3.61	3.89	4.24	4.58	4.93	5.22
	10	3.61	3.89	4.25	4.61	4.98	5.30
	12	3.61	3.89	4.26	4.64	5.02	5.35
	15	3.63	3.90	4.30	4.70	5.10	5.46
20	3.66	3.93	4.34	4.76	5.17	5.55	

COP		LWT (°C)					
		30	35	40	45	50	55
TO (°C)	-20	3.09	2.76	2.35	2.02	—	—
	-15	3.19	2.84	2.42	2.09	—	—
	-7	3.87	3.46	2.95	2.54	2.20	—
	-2	4.34	3.87	3.30	2.84	2.46	2.14
	2	4.62	4.12	3.54	3.07	2.66	2.31
	7	4.83	4.30	3.84	3.44	3.10	2.70
	10	5.17	4.61	4.11	3.69	3.33	2.94
	12	5.38	4.81	4.28	3.83	3.45	3.09
	15	5.69	5.09	4.49	4.00	3.58	3.16
20	6.31	5.62	4.96	4.42	3.96	3.45	

* Heating capacity and power input are shown peak value during operation.

* Heating capacity and power input are shown at maximum compressor operating frequency.

* Power input does not include water pump power.

TO : Outdoor temperature (DB°C)

LWT : Leaving water temperature (°C)

Cooling capacity and input specifications

▼Outdoor unit HWS-1605H8-E, HWS-1605H8R-E
 Hydro unit HWS-1405XWH**-E

Rated cooling capacity and power input

Rated condition 1 LWT=7°C dT=5deg TO=35°C	Capacity	kW	13.0
	Power input	kW	4.80
	EER	W/W	2.71
	Rated water flow rate	ℓ/min	37.3

* Rated cooling capacity and power input are the data at rated compressor operating frequency.

* Power input does not include water pump power.

* Cooling capacity and power input are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C)

LWT : Leaving water temperature (°C)

dT : Delta temperature (deg)

Return water temperature - Leaving water temperature

Cooling capacity and power input

Capacity (kW)		LWT (°C)				
		7	10	13	15	18
TO (°C)	20	14.39	15.37	16.34	17.12	18.29
	27	13.67	14.60	15.54	16.28	17.40
	30	13.36	14.27	15.19	15.92	17.02
	35	12.84	13.73	14.62	15.33	16.39
	40	11.53	12.32	13.29	14.12	14.92
	43	10.72	11.53	12.49	13.33	14.24

Power input (kW)		LWT (°C)				
		7	10	13	15	18
TO (°C)	20	3.25	3.26	3.27	3.28	3.29
	27	3.89	3.94	3.99	4.02	4.08
	30	4.17	4.23	4.29	4.34	4.42
	35	4.63	4.72	4.81	4.88	4.98
	40	4.95	5.05	5.15	5.24	5.35
	43	5.16	5.28	5.42	5.51	5.68

EER		LWT (°C)				
		7	10	13	15	18
TO (°C)	20	4.43	4.71	5.00	5.22	5.56
	27	3.51	3.71	3.90	4.05	4.27
	30	3.20	3.37	3.54	3.67	3.85
	35	2.78	2.91	3.04	3.14	3.29
	40	2.33	2.44	2.58	2.69	2.79
	43	2.08	2.18	2.31	2.42	2.50

* Cooling capacity and power input are shown at maximum compressor operating frequency.

* Power input does not include water pump power.

* Cooling capacity and power input are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C)

LWT : Leaving water temperature (°C)

Heating capacity and input specifications

▼Outdoor unit HWS-HWS-P805HR-E
 Hydro unit HWS-HWS-P805XWH**-E

Rated heating capacity and power input

Rated condition 1 LWT=35°C dT=5deg TO=7°C	Capacity	kW	8.0
	Power input	kW	1.68
	COP	W/W	4.76
	Rated water flow rate	ℓ/min	22.90

* Rated heating capacity and power input are the data at rated compressor operating frequency.

* Power input does not include water pump power.

* Heating capacity and power input are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C)

LWT : Leaving water temperature (°C)

dT : Delta temperature (deg)

Leaving water temperature - return water temperature

Average heating capacity and power input

Capacity (kW)		LWT (°C)						
		30	35	40	45	50	55	60
TO (°C)	-25	4.71	4.62	4.19	—	—	—	—
	-20	6.04	5.94	5.49	5.04	—	—	—
	-15	7.37	7.26	6.79	6.31	5.84	—	—
	-7	9.50	9.38	8.87	8.36	7.84	7.33	—
	-2	10.97	10.69	10.03	9.36	8.70	8.04	7.37
	2	12.14	11.74	10.96	10.17	9.39	8.60	7.82
	7	15.20	13.87	15.46	14.00	12.54	11.08	9.62
	10	19.69	18.21	16.60	15.00	13.39	11.79	10.18
	12	20.61	19.06	17.36	15.66	13.96	12.26	—
	15	21.99	20.35	18.50	16.66	14.81	12.97	—
	20	24.29	22.49	20.41	18.32	16.24	14.15	—

Power input (kW)		LWT (°C)						
		30	35	40	45	50	55	60
TO (°C)	-25	2.82	2.94	3.06	—	—	—	—
	-20	3.06	3.17	3.29	3.44	—	—	—
	-15	3.23	3.33	3.45	3.59	3.77	—	—
	-7	3.43	3.52	3.62	3.75	3.90	4.09	—
	-2	3.43	3.54	3.62	3.70	3.81	3.95	4.11
	2	3.43	3.56	3.61	3.68	3.75	3.85	3.96
	7	3.64	3.74	4.22	4.20	4.17	4.13	4.08
	10	4.06	4.09	4.07	4.05	4.02	3.98	3.94
	12	3.97	4.00	3.98	3.96	3.93	3.90	—
	15	3.86	3.89	3.87	3.85	3.82	3.79	—
	20	3.71	3.74	3.73	3.70	3.68	3.65	—

COP		LWT (°C)						
		30	35	40	45	50	55	60
TO (°C)	-25	1.67	1.57	1.37	—	—	—	—
	-20	1.98	1.88	1.67	1.46	—	—	—
	-15	2.28	2.18	1.97	1.76	1.55	—	—
	-7	2.77	2.67	2.45	2.23	2.01	1.79	—
	-2	3.20	3.02	2.77	2.53	2.28	2.04	1.79
	2	3.54	3.30	3.03	2.77	2.50	2.24	1.97
	7	4.18	3.70	3.66	3.33	3.01	2.68	2.36
	10	4.85	4.45	4.08	3.71	3.33	2.96	2.59
	12	5.19	4.76	4.36	3.95	3.55	3.14	—
	15	5.70	5.23	4.78	4.33	3.87	3.42	—
	20	6.55	6.01	5.48	4.95	4.41	3.88	—

* Heating capacity and power input are include defrost cycle data.

* Heating capacity and power input are shown at maximum compressor operating frequency

* Power input does not include water pump power.

* Heating capacity and power input are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C) RH85%

LWT : Leaving water temperature (°C)

Heating peak capacity and power input

Capacity (kW)		LWT (°C)						
		30	35	40	45	50	55	60
TO (°C)	-25	6.81	6.18	5.79	—	—	—	—
	-20	8.35	7.77	7.25	6.72	—	—	—
	-15	9.89	9.37	8.71	8.04	7.38	—	—
	-7	12.35	11.92	11.04	10.16	9.28	8.40	—
	-2	14.45	13.74	12.65	11.56	10.48	9.39	8.30
	2	16.14	15.19	13.94	12.69	11.43	10.18	8.93
	7	18.31	16.92	15.46	14.00	12.54	11.08	9.62
	10	19.69	18.21	16.60	15.00	13.39	11.79	10.18
	12	20.61	19.06	17.36	15.66	13.96	12.26	—
	15	21.99	20.35	18.50	16.66	14.81	12.97	—
	20	24.29	22.49	20.41	18.32	16.24	14.15	—

Power input (kW)		LWT (°C)						
		30	35	40	45	50	55	60
TO (°C)	-25	3.43	3.40	3.53	—	—	—	—
	-20	3.68	3.66	3.76	3.88	—	—	—
	-15	3.87	3.85	3.93	4.02	4.13	—	—
	-7	4.11	4.08	4.12	4.17	4.23	4.32	—
	-2	4.16	4.22	4.22	4.23	4.24	4.26	4.28
	2	4.19	4.31	4.29	4.27	4.25	4.23	4.20
	7	4.22	4.25	4.22	4.20	4.17	4.13	4.08
	10	4.06	4.09	4.07	4.05	4.02	3.98	3.94
	12	3.97	4.00	3.98	3.96	3.93	3.90	—
	15	3.86	3.89	3.87	3.85	3.82	3.79	—
	20	3.71	3.74	3.73	3.70	3.68	3.65	—

COP		LWT (°C)						
		30	35	40	45	50	55	60
TO (°C)	-25	1.98	1.82	1.64	—	—	—	—
	-20	2.27	2.13	1.93	1.73	—	—	—
	-15	2.55	2.43	2.22	2.00	1.79	—	—
	-7	3.01	2.92	2.68	2.44	2.19	1.95	—
	-2	3.48	3.26	2.99	2.73	2.47	2.21	1.94
	2	3.85	3.53	3.25	2.97	2.69	2.41	2.13
	7	4.34	3.98	3.66	3.33	3.01	2.68	2.36
	10	4.85	4.45	4.08	3.71	3.33	2.96	2.59
	12	5.19	4.76	4.36	3.95	3.55	3.14	—
	15	5.70	5.23	4.78	4.33	3.87	3.42	—
	20	6.55	6.01	5.48	4.95	4.41	3.88	—

* Heating capacity and power input are shown peak value during operation
 * Heating capacity and power input are shown at maximum compressor operating frequency
 * Power input does not include water pump power.

TO : Outdoor temperature (DB°C) RH85%
 LWT : Leaving water temperature (°C)



Cooling capacity and input specifications

▼Outdoor unit HWS-P805HR-E
 Hydro unit HWS-P805XWH**-E

Rated cooling capacity and power input

Rated condition 1 LWT=7°C dT=5deg TO=35°C	Capacity	kW	6.0
	Power input	kW	1.64
	EER	W/W	3.66
	Rated water flow rate	ℓ/min	17.20

* Rated cooling capacity and power input are the data at rated compressor operating frequency.

* Power input does not include water pump power.

* Cooling capacity and power input are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C)
 LWT : Leaving water temperature (°C)
 dT : Delta temperature (deg)
 Return water temperature - Leaving water temperature

Cooling capacity and power input

Capacity (kW)		LWT (°C)				
		7	10	13	15	18
TO (°C)	20	7.82	8.41	8.99	8.99	8.99
	27	7.53	8.01	8.50	8.82	9.30
	30	7.41	7.96	8.51	8.88	9.43
	35	7.20	7.91	8.62	9.03	9.65
	40	6.50	7.14	7.77	8.20	8.84
	43	6.08	6.69	7.31	7.72	8.35

Power input (kW)		LWT (°C)				
		7	10	13	15	18
TO (°C)	20	1.30	1.30	1.29	1.29	1.29
	27	1.67	1.67	1.67	1.67	1.67
	30	1.83	1.83	1.83	1.83	1.83
	35	2.09	2.10	2.11	2.10	2.10
	40	2.31	2.33	2.35	2.36	2.37
	43	2.44	2.48	2.51	2.52	2.54

EER		LWT (°C)				
		7	10	13	15	18
TO (°C)	20	6.00	6.49	6.97	6.97	6.97
	27	4.81	5.09	5.38	5.57	5.86
	30	4.29	4.59	4.89	5.09	5.38
	35	3.44	3.77	4.09	4.29	4.59
	40	2.84	3.10	3.35	3.52	3.78
	43	2.49	2.70	2.91	3.06	3.29

* Cooling capacity and power input are the data at rated compressor operating frequency of rated condition 1

* Power input does not include water pump power.

* Cooling capacity and power input are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C)

LWT : Leaving water temperature (°C)

Heating capacity and input specifications

▼Outdoor unit HWS-P1105HR-E
 Hydro unit HWS-P1105XWH**-E

Rated heating capacity and power input

Rated condition 1 LWT=35°C dT=5deg TO=7°C	Capacity	kW	11.2
	Power input	kW	2.30
	COP	W/W	4.88
	Rated water flow rate	ℓ/min	32.10

* Rated heating capacity and power input are the data at rated compressor operating frequency.

* Power input does not include water pump power.

* Heating capacity and power input are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C)

LWT : Leaving water temperature (°C)

dT : Delta temperature (deg)

Leaving water temperature - return water temperature

Average heating capacity and power input

Capacity (kW)		LWT (°C)						
		30	35	40	45	50	55	60
TO (°C)	-25	6.23	5.95	5.11	—	—	—	—
	-20	7.21	7.00	6.24	5.47	—	—	—
	-15	8.20	8.06	7.36	6.67	5.98	—	—
	-7	9.77	9.74	9.16	8.59	8.01	7.44	—
	-2	11.13	10.97	10.34	9.71	9.08	8.45	7.82
	2	12.22	11.96	11.28	10.61	9.93	9.26	7.79
	7	14.87	14.32	16.39	14.74	13.08	11.43	9.77
	10	20.38	18.94	17.22	15.50	13.78	12.06	10.34
	12	21.21	19.54	17.78	16.01	14.25	12.49	—
	15	22.44	20.43	18.61	16.78	14.95	13.12	—
20	24.50	21.92	19.99	18.05	16.12	14.18	—	

Power input (kW)		LWT (°C)						
		30	35	40	45	50	55	60
TO (°C)	-25	3.61	3.68	3.62	—	—	—	—
	-20	3.63	3.69	3.68	3.67	—	—	—
	-15	3.64	3.69	3.72	3.75	3.80	—	—
	-7	3.66	3.69	3.76	3.84	3.94	4.06	—
	-2	3.62	3.65	3.72	3.80	3.89	4.01	4.15
	2	3.59	3.62	3.69	3.76	3.86	3.97	3.94
	7	3.50	3.72	4.26	4.23	4.18	4.12	4.05
	10	4.18	4.12	4.09	4.06	4.02	3.98	3.92
	12	4.07	4.01	3.99	3.97	3.94	3.90	—
	15	3.93	3.88	3.86	3.84	3.82	3.79	—
20	3.74	3.70	3.69	3.67	3.66	3.64	—	

COP		LWT (°C)						
		30	35	40	45	50	55	60
TO (°C)	-25	1.72	1.62	1.41	—	—	—	—
	-20	1.99	1.90	1.70	1.49	—	—	—
	-15	2.25	2.18	1.98	1.78	1.57	—	—
	-7	2.67	2.64	2.44	2.23	2.03	1.83	—
	-2	3.08	3.01	2.78	2.56	2.33	2.11	1.88
	2	3.40	3.30	3.06	2.82	2.57	2.33	1.98
	7	4.25	3.85	3.85	3.49	3.13	2.77	2.42
	10	4.88	4.60	4.21	3.82	3.42	3.03	2.64
	12	5.21	4.87	4.45	4.04	3.62	3.21	—
	15	5.71	5.27	4.82	4.37	3.92	3.47	—
20	6.55	5.93	5.42	4.91	4.41	3.90	—	

* Heating capacity and power input are include defrost cycle data.

* Heating capacity and power input are shown at maximum compressor operating frequency

* Power input does not include water pump power.

* Heating capacity and power input are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C) RH85%

LWT : Leaving water temperature (°C)

Heating peak capacity and power input

Capacity (kW)		LWT (°C)						
		30	35	40	45	50	55	60
TO (°C)	-25	8.36	7.81	7.15	—	—	—	—
	-20	9.82	9.19	8.42	7.64	—	—	—
	-15	12.78	11.23	9.68	8.13	6.58	—	—
	-7	13.62	12.79	11.70	10.61	9.51	8.42	—
	-2	15.41	14.39	13.17	11.95	10.73	9.51	8.29
	2	16.85	15.67	14.35	13.03	11.70	10.38	9.25
	7	19.15	18.05	16.39	14.74	13.08	11.43	9.77
	10	20.38	18.94	17.22	15.50	13.78	12.06	10.34
	12	21.21	19.54	17.78	16.01	14.25	12.49	—
	15	22.44	20.43	18.61	16.78	14.95	13.12	—
20	24.50	21.92	19.99	18.05	16.12	14.18	—	

Power input (kW)		LWT (°C)						
		30	35	40	45	50	55	60
TO (°C)	-25	4.30	4.32	4.31	—	—	—	—
	-20	4.34	4.33	4.32	4.31	—	—	—
	-15	4.34	4.34	4.33	4.32	4.31	—	—
	-7	4.40	4.35	4.34	4.33	4.31	4.30	—
	-2	4.37	4.35	4.33	4.31	4.29	4.26	4.23
	2	4.35	4.35	4.33	4.30	4.28	4.25	4.19
	7	4.37	4.29	4.26	4.23	4.18	4.12	4.05
	10	4.18	4.12	4.09	4.06	4.02	3.98	3.92
	12	4.07	4.01	3.99	3.97	3.94	3.90	—
	15	3.93	3.88	3.86	3.84	3.82	3.79	—
20	3.74	3.70	3.69	3.67	3.66	3.64	—	

COP		LWT (°C)						
		30	35	40	45	50	55	60
TO (°C)	-25	1.94	1.81	1.66	—	—	—	—
	-20	2.26	2.12	1.95	1.77	—	—	—
	-15	2.94	2.59	2.24	1.88	1.53	—	—
	-7	3.10	2.94	2.70	2.45	2.21	1.96	—
	-2	3.53	3.31	3.04	2.77	2.50	2.23	1.96
	2	3.87	3.61	3.32	3.03	2.74	2.45	2.21
	7	4.38	4.20	3.85	3.49	3.13	2.77	2.42
	10	4.88	4.60	4.21	3.82	3.42	3.03	2.64
	12	5.21	4.87	4.45	4.04	3.62	3.21	—
	15	5.71	5.27	4.82	4.37	3.92	3.47	—
20	6.55	5.93	5.42	4.91	4.41	3.90	—	

* Heating capacity and power input are shown peak value during operation

* Heating capacity and power input are shown at maximum compressor operating frequency

* Power input does not include water pump power.

TO : Outdoor temperature (DB°C) RH85%

LWT : Leaving water temperature (°C)

Cooling capacity and input specifications

▼Outdoor unit HWS-P1105HR-E
 Hydro unit HWS-P1105XWH**-E

Rated cooling capacity and power input

Rated condition 1 LWT=7°C dT=5deg TO=35°C	Capacity	kW	10.0
	Power input	kW	3.33
	EER	W/W	3.00
	Rated water flow rate	ℓ/min	28.90

* Rated cooling capacity and power input are the data at rated compressor operating frequency.

* Power input does not include water pump power.

* Cooling capacity and power input are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C)

LWT : Leaving water temperature (°C)

dT : Delta temperature (deg)

Return water temperature - Leaving water temperature

Cooling capacity and power input

Capacity (kW)		LWT (°C)				
		7	10	13	15	18
TO (°C)	20	11.21	12.05	12.89	13.38	14.12
	27	10.67	11.45	12.22	12.74	13.51
	30	10.44	11.21	11.97	12.48	13.25
	35	10.06	10.86	11.66	12.12	12.81
	40	8.75	9.23	9.70	10.01	10.49
	43	7.97	8.57	9.16	9.14	9.09

Power input (kW)		LWT (°C)				
		7	10	13	15	18
TO (°C)	20	2.07	2.07	2.08	2.07	2.07
	27	2.63	2.65	2.67	2.68	2.70
	30	2.87	2.89	2.92	2.94	2.97
	35	3.27	3.31	3.36	3.38	3.42
	40	3.49	3.40	3.31	3.25	3.16
	43	3.62	3.60	3.58	3.35	3.01

EER		LWT (°C)				
		7	10	13	15	18
TO (°C)	20	5.42	5.81	6.20	6.45	6.83
	27	4.33	4.62	4.91	5.10	5.40
	30	3.86	4.11	4.36	4.53	4.78
	35	3.08	3.27	3.47	3.58	3.75
	40	2.53	2.74	2.95	3.09	3.30
	43	2.20	2.38	2.56	2.75	3.02

* Cooling capacity and power input are the data at rated compressor operating frequency of rated condition 1

* Power input does not include water pump power.

* Cooling capacity and power input are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C)

LWT : Leaving water temperature (°C)

4-6. Part Load Tables

Specifications part load heating capacity and input(peak)LWT(°C) = 35°C

Outdoor unit HWS-455H-E
Hydro unit HWS-455XWH**-E

Capacity (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-20	1.94	1.75	1.55	1.36	1.16	0.97	0.78	0.58	0.55	0.55
	-15	3.61	3.25	2.89	2.53	2.17	1.81	1.44	1.08	1.02	1.02
	-7	4.48	4.03	3.58	3.14	2.69	2.24	1.79	1.34	1.26	1.26
	-2	5.43	4.89	4.35	3.80	3.26	2.72	2.17	1.63	1.53	1.53
	2	6.19	5.57	4.95	4.33	3.72	3.10	2.48	1.86	1.31	1.31
	7	6.83	6.14	5.46	4.78	4.10	3.41	2.73	2.05	1.37	1.03
	10	7.40	6.66	5.92	5.18	4.44	3.70	2.96	2.22	1.48	1.16
	12	7.78	7.01	6.23	5.45	4.67	3.89	3.11	2.34	1.56	1.25
	15	8.36	7.52	6.69	5.85	5.02	4.18	3.34	2.51	1.67	1.38
20	9.32	8.39	7.45	6.52	5.59	4.66	3.73	2.80	1.86	1.60	

Power input (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-20	0.85	0.77	0.68	0.60	0.51	0.43	0.34	0.29	0.29	0.29
	-15	1.35	1.22	1.08	0.95	0.81	0.68	0.54	0.46	0.46	0.46
	-7	1.43	1.29	1.14	1.00	0.86	0.72	0.57	0.49	0.49	0.49
	-2	1.47	1.32	1.18	1.03	0.88	0.73	0.59	0.50	0.50	0.50
	2	1.55	1.40	1.24	1.09	0.93	0.78	0.62	0.47	0.40	0.40
	7	1.56	1.40	1.24	1.09	0.93	0.78	0.62	0.47	0.31	0.28
	10	1.55	1.40	1.24	1.09	0.93	0.78	0.62	0.47	0.31	0.27
	12	1.55	1.40	1.24	1.09	0.93	0.78	0.62	0.47	0.31	0.26
	15	1.55	1.39	1.24	1.08	0.93	0.77	0.62	0.46	0.31	0.24
20	1.54	1.39	1.23	1.08	0.93	0.77	0.62	0.46	0.31	0.22	

COP		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-20	2.28	2.28	2.28	2.28	2.28	2.28	2.28	2.00	1.88	1.88
	-15	2.67	2.67	2.67	2.67	2.67	2.67	2.67	2.34	2.20	2.20
	-7	3.13	3.13	3.13	3.13	3.13	3.13	3.13	2.74	2.58	2.58
	-2	3.69	3.70	3.70	3.70	3.70	3.70	3.70	3.24	3.05	3.05
	2	3.99	3.99	3.99	3.99	3.99	3.99	3.99	3.99	3.24	3.24
	7	4.38	4.39	4.39	4.39	4.39	4.39	4.39	4.39	4.39	3.67
	10	4.77	4.77	4.77	4.77	4.77	4.77	4.77	4.77	4.77	4.35
	12	5.02	5.02	5.02	5.02	5.02	5.02	5.02	5.02	5.02	4.85
	15	5.39	5.40	5.40	5.40	5.40	5.40	5.40	5.40	5.40	5.65
20	6.05	6.04	6.04	6.04	6.04	6.04	6.04	6.04	6.04	7.22	

- * Heating capacity and power input are shown peak value during operation
- * Heating capacity and power input at 100% load are shown at maximum compressor operating frequency
- * Power input does not include water pump power.
- * Heating capacity and power input at 100% load are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C)
LWT : Leaving water temperature (°C)

Specifications part load heating capacity and input(peak)LWT(°C) = 45°C

Outdoor unit HWS-455H-E
 Hydro unit HWS-455XWH**-E

Capacity (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-20	—	—	—	—	—	—	—	—	—	—
	-15	—	—	—	—	—	—	—	—	—	—
	-7	4.37	3.93	3.49	3.06	2.62	2.18	1.75	1.31	1.11	1.11
	-2	5.10	4.59	4.08	3.57	3.06	2.55	2.04	1.53	1.30	1.30
	2	5.68	5.12	4.55	3.98	3.41	2.84	2.27	1.71	1.44	1.44
	7	6.42	5.77	5.13	4.49	3.85	3.21	2.57	1.92	1.63	1.63
	10	6.89	6.20	5.51	4.82	4.13	3.44	2.76	2.07	1.95	1.95
	12	7.21	6.48	5.76	5.04	4.32	3.60	2.88	2.16	2.16	2.16
	15	7.68	6.91	6.14	5.38	4.61	3.84	3.07	2.48	2.48	2.48
	20	8.70	7.83	6.96	6.09	5.22	4.35	3.48	3.02	3.02	3.02

Power input (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-20	—	—	—	—	—	—	—	—	—	—
	-15	—	—	—	—	—	—	—	—	—	—
	-7	1.74	1.56	1.39	1.22	1.04	0.87	0.69	0.58	0.58	0.58
	-2	1.78	1.61	1.43	1.25	1.07	0.89	0.71	0.54	0.36	0.59
	2	1.82	1.64	1.46	1.28	1.09	0.91	0.73	0.60	0.60	0.60
	7	1.87	1.68	1.50	1.31	1.12	0.93	0.75	0.62	0.62	0.62
	10	1.91	1.72	1.53	1.34	1.15	0.96	0.77	0.61	0.61	0.61
	12	1.94	1.75	1.55	1.36	1.17	0.97	0.78	0.60	0.60	0.60
	15	1.99	1.79	1.59	1.39	1.19	0.99	0.79	0.60	0.59	0.59
	20	1.99	1.79	1.59	1.39	1.19	0.99	0.80	0.60	0.58	0.58

COP		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-20	—	—	—	—	—	—	—	—	—	—
	-15	—	—	—	—	—	—	—	—	—	—
	-7	2.51	2.51	2.51	2.51	2.51	2.51	2.51	2.27	1.93	1.93
	-2	2.87	2.86	2.86	2.86	2.86	2.86	2.86	2.86	3.63	2.19
	2	3.12	3.12	3.12	3.12	3.12	3.12	3.12	2.82	2.39	2.39
	7	3.43	3.43	3.43	3.43	3.43	3.43	3.43	3.10	2.63	2.63
	10	3.61	3.60	3.60	3.60	3.60	3.60	3.60	3.39	3.20	3.20
	12	3.72	3.71	3.71	3.71	3.71	3.71	3.71	3.58	3.59	3.59
	15	3.86	3.87	3.87	3.87	3.87	3.87	3.87	4.17	4.19	4.19
	20	4.37	4.37	4.37	4.37	4.37	4.37	4.37	5.05	5.24	5.24

* Heating capacity and power input are shown peak value during operation
 * Heating capacity and power input at 100% load are shown at maximum compressor operating frequency
 * Power input does not include water pump power.
 * Heating capacity and power input at 100% load are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C)
 LWT : Leaving water temperature (°C)

Specifications part load heating capacity and input(peak)LWT(°C) = 55°C

Outdoor unit HWS-455H-E
 Hydro unit HWS-455XWH**-E

Capacity (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-20	—	—	—	—	—	—	—	—	—	—
	-15	—	—	—	—	—	—	—	—	—	—
	-7	—	—	—	—	—	—	—	—	—	—
	-2	4.77	—	—	—	—	—	—	—	—	—
	2	5.18	4.60	—	—	—	—	—	—	—	—
	7	6.25	5.62	5.00	4.62	4.62	4.62	4.62	4.62	4.62	4.62
	10	6.22	5.60	4.97	4.60	4.60	4.60	4.60	4.60	4.60	4.60
	12	6.60	5.94	5.28	4.88	4.88	4.88	4.88	4.88	4.88	4.88
	15	6.98	6.28	5.58	4.94	4.94	4.94	4.94	4.94	4.94	4.94
	20	7.39	6.66	5.92	5.18	4.97	4.97	4.97	4.97	4.97	4.97

Power input (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-20	—	—	—	—	—	—	—	—	—	—
	-15	—	—	—	—	—	—	—	—	—	—
	-7	—	—	—	—	—	—	—	—	—	—
	-2	2.10	—	—	—	—	—	—	—	—	—
	2	2.09	2.05	—	—	—	—	—	—	—	—
	7	2.21	1.99	1.77	1.63	1.63	1.63	1.63	1.63	1.63	1.63
	10	2.22	1.99	1.77	1.63	1.63	1.63	1.63	1.63	1.63	1.63
	12	2.22	2.00	1.78	1.64	1.64	1.64	1.64	1.64	1.64	1.64
	15	2.22	2.00	1.78	1.56	1.51	1.51	1.51	1.51	1.51	1.51
	20	2.05	1.85	1.64	1.44	1.30	1.30	1.30	1.30	1.30	1.30

COP		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-20	—	—	—	—	—	—	—	—	—	—
	-15	—	—	—	—	—	—	—	—	—	—
	-7	—	—	—	—	—	—	—	—	—	—
	-2	2.27	—	—	—	—	—	—	—	—	—
	2	2.48	2.24	—	—	—	—	—	—	—	—
	7	2.83	2.83	2.83	2.84	2.84	2.84	2.84	2.84	2.84	2.84
	10	2.80	2.81	2.81	2.82	2.82	2.82	2.82	2.82	2.82	2.82
	12	2.97	2.97	2.97	2.98	2.98	2.98	2.98	2.98	2.98	2.98
	15	3.14	3.14	3.14	3.17	3.26	3.26	3.26	3.26	3.26	3.26
	20	3.60	3.60	3.60	3.60	3.82	3.82	3.82	3.82	3.82	3.82

* Heating capacity and power input are shown peak value during operation
 * Heating capacity and power input at 100% load are shown at maximum compressor operating frequency
 * Power input does not include water pump power.
 * Heating capacity and power input at 100% load are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C)
 LWT : Leaving water temperature (°C)



Specifications Low noise operation

60.6Hz

Outdoor unit HWS-455H-E
Hydro unit HWS-455XWH**-E

Capacity (kW)		LWT (°C)		
		35	45	55
TO (°C)	-20	1.38	—	—
	-15	2.57	—	—
	-7	3.19	3.16	—
	-2	3.87	3.69	—
	2	4.41	4.12	—
	7	4.86	4.65	—
	10	5.27	4.99	—
	12	5.54	5.22	4.95
	15	5.95	5.56	5.29
20	6.63	6.30	5.87	

Power input (kW)		LWT (°C)		
		35	45	55
TO (°C)	-20	0.59	—	—
	-15	0.93	—	—
	-7	0.99	1.18	—
	-2	1.01	1.21	—
	2	1.07	1.24	—
	7	1.07	1.27	—
	10	1.07	1.30	—
	12	1.07	1.32	1.64
	15	1.07	1.35	1.65
20	1.06	1.35	1.65	

COP		LWT (°C)		
		35	45	55
TO (°C)	-20	2.34	—	—
	-15	2.76	—	—
	-7	3.22	2.68	—
	-2	3.83	3.05	—
	2	4.12	3.32	—
	7	4.54	3.66	—
	10	4.93	3.84	—
	12	5.18	3.95	3.02
	15	5.56	4.12	3.21
20	6.25	4.67	3.56	

* Heating capacity and power input are shown peak value during operation

* Heating capacity and power input at 100% load are shown at maximum compressor operating frequency

* Power input does not include water pump power.

TO : Outdoor temperature (DB°C)

LWT : Leaving water temperature (°C)

Specifications part load cooling capacity and input LWT(°C) = 7°C

Outdoor unit HWS-455H-E
 Hydro unit HWS-455XWH**-E

Capacity (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	5.98	5.39	4.79	4.19	3.59	2.99	2.39	1.80	1.20	1.08
	27	5.61	5.05	4.49	3.93	3.36	2.80	2.24	1.68	1.12	1.11
	30	5.45	4.90	4.36	3.81	3.27	2.72	2.18	1.63	1.12	1.12
	35	5.18	4.66	4.14	3.62	3.11	2.59	2.07	1.55	1.04	0.90
	40	3.83	3.45	3.06	2.68	2.30	1.91	1.53	1.15	0.77	0.67
	43	3.27	2.94	2.62	2.29	1.96	1.63	1.31	0.98	0.65	0.54

Power input (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	1.43	1.28	1.14	1.00	0.86	0.71	0.57	0.43	0.29	0.14
	27	1.59	1.43	1.27	1.11	0.95	0.79	0.64	0.48	0.32	0.25
	30	1.66	1.49	1.33	1.16	1.00	0.83	0.66	0.50	0.33	0.30
	35	1.78	1.60	1.42	1.24	1.07	0.89	0.71	0.53	0.36	0.36
	40	1.49	1.34	1.19	1.04	0.89	0.75	0.60	0.45	0.42	0.42
	43	1.44	1.30	1.16	1.01	0.87	0.72	0.58	0.46	0.46	0.46

COP		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	4.20	4.20	4.20	4.20	4.20	4.20	4.20	4.20	4.20	7.47
	27	3.53	3.53	3.53	3.53	3.53	3.53	3.53	3.53	3.53	4.39
	30	3.28	3.28	3.28	3.28	3.28	3.28	3.28	3.28	3.28	3.37
	35	2.91	2.91	2.91	2.91	2.91	2.91	2.91	2.91	2.91	2.91
	40	2.57	2.57	2.57	2.57	2.57	2.57	2.57	2.57	2.57	1.82
	43	2.26	2.26	2.26	2.26	2.26	2.26	2.26	2.26	2.15	1.43

* Cooling capacity and power input at 100% load are shown at maximum compressor operating frequency

* Power input does not include water pump power.

* Cooling capacity and power input at 100% load are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C)

LWT : Leaving water temperature (°C)

Specifications part load cooling capacity and input LWT(°C) = 13°C

Outdoor unit HWS-455H-E
 Hydro unit HWS-455XWH**-E

Capacity (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	7.09	6.38	5.67	4.96	4.25	3.54	2.84	2.13	1.42	0.71
	27	6.53	5.88	5.23	4.57	3.92	3.27	2.61	1.96	1.31	1.20
	30	6.29	5.66	5.03	4.41	3.78	3.15	2.52	1.89	1.49	1.49
	35	5.89	5.31	4.72	4.13	3.54	2.95	2.36	1.77	1.26	1.26
	40	4.55	4.10	3.64	3.19	2.73	2.28	1.82	1.37	1.03	1.03
	43	4.13	3.72	3.30	2.89	2.48	2.07	1.65	1.24	0.87	0.87

Power input (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	1.52	1.37	1.22	1.06	0.91	0.76	0.61	0.46	0.30	0.15
	27	1.66	1.50	1.33	1.16	1.00	0.83	0.66	0.50	0.33	0.22
	30	1.72	1.55	1.38	1.21	1.03	0.86	0.69	0.52	0.34	0.27
	35	1.82	1.64	1.46	1.28	1.09	0.91	0.73	0.55	0.34	0.34
	40	1.46	1.32	1.17	1.03	0.88	0.73	0.59	0.44	0.40	0.40
	43	1.44	1.30	1.15	1.01	0.86	0.72	0.58	0.44	0.44	0.44

COP		Load (%)										
		100	90	80	70	60	50	40	30	20	10	
TO (°C)	20	4.66	4.66	4.66	4.66	4.66	4.66	4.66	4.66	4.66	4.66	
	27	3.93	3.93	3.93	3.93	3.93	3.93	3.93	3.93	3.93	5.57	
	30	3.66	3.65	3.65	3.65	3.65	3.65	3.65	3.65	3.65	4.32	5.50
	35	3.24	3.23	3.23	3.23	3.23	3.23	3.23	3.23	3.23	3.74	3.74
	40	3.12	3.11	3.11	3.11	3.11	3.11	3.11	3.11	3.11	2.56	2.56
	43	2.87	2.87	2.87	2.87	2.87	2.87	2.87	2.87	2.80	1.96	1.96

* Cooling capacity and power input at 100% load are shown at maximum compressor operating frequency

* Power input does not include water pump power.

* Cooling capacity and power input at 100% load are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C)

LWT : Leaving water temperature (°C)

Specifications part load cooling capacity and input LWT(°C) = 18°C

Outdoor unit HWS-455H-E
 Hydro unit HWS-455XWH**-E

Capacity (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	7.55	6.79	6.04	5.28	4.53	3.77	3.02	2.26	1.51	1.03
	27	7.06	6.35	5.64	4.94	4.23	3.53	2.82	2.12	1.51	1.51
	30	6.84	6.16	5.48	4.79	4.11	3.42	2.74	2.05	1.72	1.72
	35	6.49	5.84	5.19	4.54	3.90	3.25	2.60	1.95	1.51	1.51
	40	5.15	4.64	4.12	3.61	3.09	2.58	2.06	1.55	1.31	1.31
	43	4.78	4.30	3.82	3.34	2.87	2.39	1.91	1.43	1.18	1.18

Power input (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	1.56	1.40	1.25	1.09	0.94	0.78	0.62	0.47	0.31	0.16
	27	1.70	1.53	1.36	1.19	1.02	0.85	0.68	0.51	0.34	0.18
	30	1.76	1.58	1.41	1.23	1.06	0.88	0.70	0.53	0.35	0.24
	35	1.86	1.67	1.49	1.30	1.12	0.93	0.74	0.56	0.37	0.31
	40	1.44	1.30	1.15	1.01	0.87	0.72	0.58	0.43	0.38	0.38
	43	1.48	1.33	1.18	1.03	0.89	0.74	0.59	0.44	0.42	0.42

COP		Load (%)										
		100	90	80	70	60	50	40	30	20	10	
TO (°C)	20	4.84	4.84	4.84	4.84	4.84	4.84	4.84	4.84	4.84	6.58	
	27	4.15	4.15	4.15	4.15	4.15	4.15	4.15	4.15	4.44	8.16	
	30	3.89	3.89	3.89	3.89	3.89	3.89	3.89	3.89	3.89	4.87	7.23
	35	3.49	3.49	3.49	3.49	3.49	3.49	3.49	3.49	3.49	4.06	4.89
	40	3.58	3.57	3.57	3.57	3.57	3.57	3.57	3.57	3.57	3.43	3.43
	43	3.23	3.23	3.23	3.23	3.23	3.23	3.23	3.23	3.23	2.79	2.79

* Cooling capacity and power input at 100% load are shown at maximum compressor operating frequency
 * Power input does not include water pump power.
 * Cooling capacity and power input at 100% load are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C)
 LWT : Leaving water temperature (°C)



Specifications Low noise operation

50.4Hz

Outdoor unit HWS-455H-E
 Hydro unit HWS-455XWH**-E

Capacity (kW)		LWT (°C)		
		7	13	18
TO (°C)	20	4.07	4.82	5.45
	27	3.71	4.49	5.14
	30	3.55	4.35	5.01
	35	3.29	4.11	4.79
	40	—	—	—
	43	—	—	—

Power input (kW)		LWT (°C)		
		7	13	18
TO (°C)	20	0.70	0.68	0.67
	27	0.82	0.82	0.82
	30	0.88	0.88	0.89
	35	0.97	0.98	0.99
	40	—	—	—
	43	—	—	—

COP		LWT (°C)		
		7	13	18
TO (°C)	20	5.81	7.09	8.13
	27	4.52	5.48	6.27
	30	4.03	4.94	5.63
	35	3.39	4.19	4.84
	40	—	—	—
	43	—	—	—

* Cooling capacity and power input at 100% load are shown at maximum compressor operating frequency

* Power input does not include water pump power.

TO : Outdoor temperature (DB°C)

LWT : Leaving water temperature (°C)

Specifications part load heating capacity and input LWT(°C) = 35°C

Outdoor unit HWS-805H-E
 Hydro unit HWS-805XWH**-E

Capacity (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-20	3.61	3.25	2.89	2.53	2.17	1.81	1.57	1.57	1.57	1.57
	-15	4.28	3.86	3.42	3.00	2.57	2.14	1.86	1.86	1.86	1.86
	-7	5.00	4.50	4.00	3.50	3.00	2.50	2.17	2.17	2.17	2.17
	-2	5.76	5.18	4.61	4.03	3.46	2.88	2.50	2.50	2.50	2.50
	2	6.37	5.74	5.09	4.46	3.82	3.19	2.55	2.22	2.22	2.22
	7	8.52	7.67	6.81	5.97	5.11	4.26	3.41	2.55	1.71	1.32
	10	9.01	8.11	7.21	6.31	5.41	4.51	3.61	2.71	1.80	1.39
	12	9.52	8.57	7.62	6.67	5.72	4.76	3.80	2.85	1.90	1.47
	15	10.01	9.01	8.01	7.01	6.00	5.00	4.00	3.00	2.00	1.55
	20	11.32	10.19	9.05	7.92	6.79	5.66	4.53	3.40	2.27	1.75

Power input (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-20	1.52	1.36	1.20	1.04	0.88	0.72	0.60	0.60	0.60	0.60
	-15	1.60	1.43	1.26	1.09	0.92	0.76	0.64	0.64	0.64	0.64
	-7	1.85	1.66	1.46	1.26	1.07	0.87	0.74	0.74	0.74	0.74
	-2	1.89	1.69	1.49	1.29	1.09	0.90	0.75	0.75	0.75	0.75
	2	1.91	1.71	1.51	1.31	1.11	0.90	0.69	0.59	0.59	0.59
	7	2.01	1.80	1.58	1.37	1.17	0.95	0.74	0.52	0.31	0.21
	10	1.97	1.77	1.56	1.35	1.14	0.93	0.72	0.52	0.30	0.20
	12	1.96	1.76	1.55	1.34	1.14	0.92	0.72	0.52	0.30	0.20
	15	1.94	1.74	1.53	1.33	1.12	0.91	0.71	0.51	0.30	0.20
	20	1.93	1.73	1.53	1.32	1.11	0.91	0.71	0.50	0.30	0.20

COP		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-20	2.37	2.39	2.40	2.44	2.47	2.52	2.60	2.60	2.60	2.60
	-15	2.68	2.70	2.72	2.75	2.78	2.83	2.91	2.91	2.91	2.91
	-7	2.70	2.71	2.75	2.77	2.80	2.87	2.95	2.95	2.95	2.95
	-2	3.04	3.07	3.09	3.13	3.18	3.22	3.32	3.32	3.32	3.32
	2	3.34	3.36	3.38	3.42	3.46	3.53	3.67	3.78	3.78	3.78
	7	4.24	4.27	4.30	4.36	4.39	4.48	4.62	4.87	5.50	6.18
	10	4.57	4.58	4.63	4.67	4.75	4.83	5.02	5.25	5.99	6.80
	12	4.85	4.87	4.93	4.97	5.02	5.16	5.29	5.54	6.31	7.18
	15	5.16	5.18	5.24	5.29	5.34	5.49	5.63	5.90	6.72	7.68
	20	5.87	5.89	5.93	6.02	6.09	6.21	6.38	6.81	7.61	8.66

* Heating capacity and power input are shown peak value during operation
 * Heating capacity and power input at 100% load are shown at maximum compressor operating frequency
 * Power input does not include water pump power.
 * Heating capacity and power input at 100% load are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C)
 LWT : Leaving water temperature (°C)



Specifications part load heating capacity and input LWT(°C) = 45°C

Outdoor unit HWS-805H-E
 Hydro unit HWS-805XWH**-E

Capacity (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-20	—	—	—	—	—	—	—	—	—	—
	-15	4.13	3.71	3.30	2.89	2.47	2.07	1.75	1.75	1.75	1.75
	-7	4.82	4.34	3.86	3.37	2.89	2.42	2.05	2.05	2.05	2.05
	-2	5.63	5.07	4.50	3.94	3.37	2.81	2.39	2.39	2.39	2.39
	2	6.34	5.71	5.08	4.43	3.80	3.17	2.54	2.15	2.15	2.15
	7	8.13	7.32	6.50	5.69	4.87	4.06	3.25	2.75	2.75	2.75
	10	8.50	7.65	6.79	5.95	5.09	4.25	3.40	2.87	2.87	2.87
	12	8.99	8.09	7.19	6.30	5.39	4.50	3.60	3.04	3.04	3.04
	15	9.46	8.51	7.56	6.62	5.68	4.73	3.78	3.20	3.20	3.20
	20	10.75	9.67	8.60	7.52	6.45	5.37	4.30	3.64	3.64	3.64

Power input (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-20	—	—	—	—	—	—	—	—	—	—
	-15	2.12	1.90	1.69	1.47	1.25	1.04	0.87	0.87	0.87	0.87
	-7	2.45	2.20	1.96	1.71	1.45	1.20	1.01	1.01	1.01	1.01
	-2	2.51	2.26	2.00	1.75	1.49	1.24	1.04	1.04	1.04	1.04
	2	2.53	2.28	2.02	1.76	1.50	1.25	0.98	0.83	0.83	0.83
	7	2.42	2.17	1.93	1.68	1.43	1.19	0.94	0.79	0.79	0.79
	10	2.38	2.13	1.89	1.65	1.40	1.17	0.92	0.78	0.78	0.78
	12	2.36	2.12	1.88	1.64	1.40	1.16	0.92	0.78	0.78	0.78
	15	2.43	2.18	1.94	1.69	1.44	1.19	0.95	0.80	0.80	0.80
	20	2.42	2.17	1.92	1.67	1.44	1.19	0.94	0.79	0.79	0.79

COP		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-20	—	—	—	—	—	—	—	—	—	—
	-15	1.95	1.96	1.96	1.97	1.98	1.98	2.00	2.00	2.00	2.00
	-7	1.97	1.97	1.97	1.97	1.99	2.01	2.02	2.02	2.02	2.02
	-2	2.24	2.25	2.25	2.26	2.26	2.28	2.30	2.30	2.30	2.30
	2	2.50	2.50	2.52	2.52	2.53	2.54	2.58	2.60	2.60	2.60
	7	3.36	3.37	3.38	3.39	3.40	3.42	3.45	3.50	3.50	3.50
	10	3.58	3.59	3.59	3.61	3.63	3.64	3.69	3.70	3.70	3.70
	12	3.80	3.82	3.82	3.84	3.84	3.89	3.90	3.92	3.92	3.92
	15	3.88	3.90	3.90	3.92	3.93	3.97	3.98	4.01	4.01	4.01
	20	4.45	4.46	4.47	4.49	4.49	4.52	4.57	4.59	4.59	4.59

- * Heating capacity and power input are shown peak value during operation
- * Heating capacity and power input at 100% load are shown at maximum compressor operating frequency
- * Power input does not include water pump power.
- * Heating capacity and power input at 100% load are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C)
 LWT : Leaving water temperature (°C)

Specifications part load heating capacity and input LWT(°C) = 55°C

Outdoor unit HWS-805H-E
 Hydro unit HWS-805XWH**-E

Capacity (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-20	—	—	—	—	—	—	—	—	—	—
	-15	—	—	—	—	—	—	—	—	—	—
	-7	—	—	—	—	—	—	—	—	—	—
	-2	5.43	4.89	4.34	3.80	3.26	2.98	2.98	2.98	2.98	2.98
	2	6.24	5.61	4.99	4.37	3.74	3.43	3.43	3.43	3.43	3.43
	7	7.70	6.92	6.16	5.39	4.62	4.23	4.23	4.23	4.23	4.23
	10	8.11	7.29	6.48	5.67	4.86	4.46	4.46	4.46	4.46	4.46
	12	8.67	7.80	6.94	6.07	5.20	4.77	4.77	4.77	4.77	4.77
	15	9.03	8.13	7.23	6.32	5.41	4.97	4.97	4.97	4.97	4.97
	20	10.22	9.20	8.17	7.16	6.14	5.62	5.62	5.62	5.62	5.62

Power input (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-20	—	—	—	—	—	—	—	—	—	—
	-15	—	—	—	—	—	—	—	—	—	—
	-7	—	—	—	—	—	—	—	—	—	—
	-2	3.10	2.80	2.50	2.20	1.91	1.75	1.75	1.75	1.75	1.75
	2	3.13	2.82	2.52	2.22	1.91	1.76	1.76	1.76	1.76	1.76
	7	2.81	2.54	2.27	1.99	1.73	1.59	1.59	1.59	1.59	1.59
	10	2.82	2.55	2.28	2.00	1.73	1.60	1.60	1.60	1.60	1.60
	12	2.83	2.56	2.28	2.01	1.74	1.60	1.60	1.60	1.60	1.60
	15	2.97	2.68	2.39	2.10	1.83	1.68	1.68	1.68	1.68	1.68
	20	3.00	2.71	2.42	2.14	1.84	1.69	1.69	1.69	1.69	1.69

COP		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-20	—	—	—	—	—	—	—	—	—	—
	-15	—	—	—	—	—	—	—	—	—	—
	-7	—	—	—	—	—	—	—	—	—	—
	-2	1.75	1.74	1.74	1.73	1.71	1.71	1.71	1.71	1.71	1.71
	2	2.00	1.99	1.98	1.97	1.96	1.94	1.94	1.94	1.94	1.94
	7	2.74	2.73	2.71	2.70	2.67	2.66	2.66	2.66	2.66	2.66
	10	2.87	2.87	2.84	2.83	2.81	2.79	2.79	2.79	2.79	2.79
	12	3.06	3.05	3.05	3.02	3.00	2.99	2.99	2.99	2.99	2.99
	15	3.04	3.03	3.02	3.00	2.97	2.95	2.95	2.95	2.95	2.95
	20	3.41	3.39	3.37	3.35	3.34	3.32	3.32	3.32	3.32	3.32

* Heating capacity and power input are shown peak value during operation
 * Heating capacity and power input at 100% load are shown at maximum compressor operating frequency
 * Power input does not include water pump power.
 * Heating capacity and power input at 100% load are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C)
 LWT : Leaving water temperature (°C)



Specifications Low noise operation

40.2Hz

Outdoor unit HWS-805H-E
 Hydro unit HWS-805XWH**-E

Capacity (kW)		LWT (°C)		
		35	45	55
TO (°C)	-20	2.08	—	—
	-15	2.47	2.36	—
	-7	2.89	2.75	—
	-2	3.33	3.21	2.99
	2	3.67	3.62	3.44
	7	4.92	4.64	4.24
	10	5.20	4.85	4.48
	12	5.49	5.13	4.79
	15	5.78	5.40	4.99
20	6.53	6.14	5.64	

Power input (kW)		LWT (°C)		
		35	45	55
TO (°C)	-20	0.84	—	—
	-15	0.88	1.19	—
	-7	1.02	1.38	—
	-2	1.05	1.41	1.76
	2	1.05	1.42	1.77
	7	1.11	1.36	1.60
	10	1.09	1.34	1.60
	12	1.09	1.33	1.61
	15	1.08	1.37	1.68
20	1.07	1.36	1.70	

COP		LWT (°C)		
		35	45	55
TO (°C)	-20	2.47	—	—
	-15	2.80	1.98	—
	-7	2.83	2.00	—
	-2	3.18	2.27	1.70
	2	3.48	2.54	1.94
	7	4.44	3.42	2.65
	10	4.78	3.63	2.80
	12	5.04	3.85	2.98
	15	5.37	3.93	2.97
20	6.13	4.52	3.31	

* Heating capacity and power input are shown peak value during operation

* Heating capacity and power input at 100% load are shown at maximum compressor operating frequency

* Power input does not include water pump power.

TO : Outdoor temperature (DB°C)

LWT : Leaving water temperature (°C)

Specifications part load cooling capacity and input LWT(°C) = 7°C

Outdoor unit HWS-805H-E
 Hydro unit HWS-805XWH**-E

Capacity (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	7.34	6.60	5.87	5.14	4.41	3.67	2.93	2.20	1.47	0.92
	27	7.18	6.46	5.75	5.02	4.31	3.59	2.90	2.90	2.90	2.90
	30	7.11	6.40	5.69	4.98	4.27	3.56	2.86	2.86	2.86	2.86
	35	7.00	6.30	5.60	4.90	4.20	3.50	2.82	2.82	2.82	2.82
	40	6.41	5.77	5.13	4.49	3.85	3.21	2.98	2.98	2.98	2.98
	43	5.39	4.85	4.32	3.77	3.23	2.70	2.51	2.51	2.51	2.51

Power input (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	1.65	1.50	1.34	1.20	1.04	0.89	0.73	0.58	0.43	0.32
	27	2.01	1.82	1.64	1.45	1.27	1.08	0.90	0.90	0.90	0.90
	30	2.16	1.96	1.76	1.56	1.37	1.16	0.97	0.97	0.97	0.97
	35	2.42	2.19	1.98	1.75	1.52	1.30	1.08	1.08	1.08	1.08
	40	2.62	2.38	2.13	1.89	1.65	1.41	1.32	1.32	1.32	1.32
	43	2.37	2.16	1.93	1.71	1.50	1.27	1.20	1.20	1.20	1.20

COP		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	4.45	4.42	4.38	4.29	4.23	4.14	4.00	3.82	3.38	2.87
	27	3.57	3.54	3.51	3.46	3.40	3.32	3.24	3.24	3.24	3.24
	30	3.29	3.27	3.23	3.19	3.13	3.06	2.96	2.96	2.96	2.96
	35	2.89	2.87	2.83	2.80	2.76	2.70	2.62	2.62	2.62	2.62
	40	2.45	2.43	2.41	2.38	2.33	2.27	2.26	2.26	2.26	2.26
	43	2.27	2.25	2.24	2.20	2.16	2.12	2.09	2.09	2.09	2.09

* Cooling capacity and power input at 100% load are shown at maximum compressor operating frequency

* Power input does not include water pump power.

* Cooling capacity and power input at 100% load are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C)

LWT : Leaving water temperature (°C)

Specifications part load cooling capacity and input LWT(°C) = 13°C

Outdoor unit HWS-805H-E
 Hydro unit HWS-805XWH**-E

Capacity (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	8.49	7.64	6.79	5.94	5.10	4.25	3.39	2.54	2.28	2.28
	27	8.30	7.47	6.64	5.81	4.98	4.16	4.16	4.16	4.16	4.16
	30	8.23	7.41	6.58	5.76	4.94	4.12	4.12	4.12	4.12	4.12
	35	8.10	7.28	6.47	5.67	4.86	4.06	4.06	4.06	4.06	4.06
	40	7.42	6.67	5.93	5.20	4.45	4.10	4.10	4.10	4.10	4.10
	43	6.13	5.52	4.90	4.29	3.67	3.39	3.39	3.39	3.39	3.39

Power input (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	1.71	1.52	1.34	1.16	0.98	0.79	0.61	0.42	0.37	0.37
	27	2.08	1.86	1.63	1.41	1.19	0.96	0.96	0.96	0.96	0.96
	30	2.24	2.00	1.76	1.52	1.28	1.05	1.05	1.05	1.05	1.05
	35	2.51	2.23	1.97	1.70	1.43	1.16	1.16	1.16	1.16	1.16
	40	2.71	2.41	2.13	1.83	1.55	1.41	1.41	1.41	1.41	1.41
	43	2.38	2.13	1.86	1.61	1.35	1.24	1.24	1.24	1.24	1.24

COP		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	4.97	5.02	5.08	5.11	5.21	5.36	5.59	6.03	6.16	6.16
	27	3.99	4.02	4.07	4.11	4.17	4.32	4.32	4.32	4.32	4.32
	30	3.67	3.70	3.73	3.78	3.84	3.94	3.94	3.94	3.94	3.94
	35	3.23	3.26	3.29	3.34	3.39	3.49	3.49	3.49	3.49	3.49
	40	2.74	2.77	2.79	2.84	2.88	2.91	2.91	2.91	2.91	2.91
	43	2.58	2.60	2.63	2.66	2.71	2.74	2.74	2.74	2.74	2.74

* Cooling capacity and power input at 100% load are shown at maximum compressor operating frequency

* Power input does not include water pump power.

* Cooling capacity and power input at 100% load are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C)

LWT : Leaving water temperature (°C)

Specifications part load cooling capacity and input LWT(°C) = 18°C

Outdoor unit HWS-805H-E
 Hydro unit HWS-805XWH**-E

Capacity (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	9.64	8.68	7.71	6.74	5.78	4.82	3.85	3.45	3.45	3.45
	27	9.43	8.49	7.54	6.60	5.66	5.30	5.30	5.30	5.30	5.30
	30	9.34	8.40	7.47	6.54	5.60	5.25	5.25	5.25	5.25	5.25
	35	9.19	8.27	7.35	6.44	5.52	5.17	5.17	5.17	5.17	5.17
	40	8.42	7.58	6.73	5.89	5.11	5.11	5.11	5.11	5.11	5.11
	43	6.85	6.16	5.48	4.79	4.16	4.16	4.16	4.16	4.16	4.16

Power input (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	1.77	1.63	1.41	1.19	0.98	0.75	0.53	0.44	0.44	0.44
	27	2.15	1.90	1.64	1.38	1.12	1.04	1.04	1.04	1.04	1.04
	30	2.32	2.04	1.77	1.49	1.21	1.11	1.11	1.11	1.11	1.11
	35	2.59	2.28	1.97	1.66	1.36	1.24	1.24	1.24	1.24	1.24
	40	2.80	2.47	2.13	1.80	1.49	1.49	1.49	1.49	1.49	1.49
	43	2.40	2.11	1.83	1.54	1.27	1.27	1.27	1.27	1.27	1.27

COP		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	5.46	5.32	5.45	5.65	5.92	6.45	7.27	7.91	7.91	7.91
	27	4.38	4.47	4.59	4.79	5.03	5.12	5.12	5.12	5.12	5.12
	30	4.03	4.12	4.23	4.39	4.61	4.72	4.72	4.72	4.72	4.72
	35	3.55	3.63	3.73	3.87	4.04	4.18	4.18	4.18	4.18	4.18
	40	3.01	3.07	3.15	3.27	3.43	3.43	3.43	3.43	3.43	3.43
	43	2.85	2.92	3.00	3.11	3.26	3.26	3.26	3.26	3.26	3.26

* Cooling capacity and power input at 100% load are shown at maximum compressor operating frequency

* Power input does not include water pump power.

* Cooling capacity and power input at 100% load are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C)

LWT : Leaving water temperature (°C)

Specifications Low noise operation 40.2Hz

Outdoor unit HWS-805H-E
Hydro unit HWS-805XWH**-E

Capacity (kW)		LWT (°C)		
		7	13	18
TO (°C)	20	4.70	5.93	7.09
	27	4.60	5.80	6.94
	30	4.55	5.75	6.88
	35	4.48	5.66	6.76
	40	4.10	5.18	6.19
	43	3.45	4.28	5.04

Power input (kW)		LWT (°C)		
		7	13	18
TO (°C)	20	1.10	1.15	1.27
	27	1.34	1.41	1.48
	30	1.45	1.51	1.59
	35	1.61	1.70	1.78
	40	1.74	1.83	1.92
	43	1.58	1.60	1.64

COP		LWT (°C)		
		7	13	18
TO (°C)	20	4.26	5.15	5.59
	27	3.42	4.11	4.70
	30	3.14	3.80	4.32
	35	2.78	3.34	3.81
	40	2.36	2.83	3.23
	43	2.19	2.67	3.07

* Cooling capacity and power input at 100% load are shown at maximum compressor operating frequency

* Power input does not include water pump power.

TO : Outdoor temperature (DB°C)

LWT : Leaving water temperature (°C)

Specifications part load heating capacity and input LWT(°C) = 35°C

Outdoor unit HWS-1105H-E
Hydro unit HWS-1405XWH**-E

Capacity (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-20	5.25	4.72	4.19	3.68	3.15	2.67	2.67	2.67	2.67	2.67
	-15	6.57	5.91	5.25	4.59	3.94	3.34	3.34	3.34	3.34	3.34
	-7	8.04	7.24	6.43	5.63	4.82	4.09	4.09	4.09	4.09	4.09
	-2	9.48	8.53	7.58	6.63	5.69	4.82	4.82	4.82	4.82	4.82
	2	10.10	9.09	8.08	7.07	6.06	5.05	4.54	4.54	4.54	4.54
	7	14.63	13.16	11.71	10.24	8.78	7.32	5.85	4.39	2.92	2.68
	10	15.51	13.95	12.41	10.86	9.30	7.76	6.21	4.65	3.10	2.84
	12	16.24	14.62	13.00	11.37	9.74	8.12	6.50	4.88	3.24	2.97
	15	17.20	15.48	13.76	12.04	10.32	8.60	6.88	5.16	3.44	3.15
	20	19.44	17.50	15.55	13.61	11.67	9.72	7.77	5.83	3.89	3.57

Power input (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-20	2.52	2.26	2.00	1.73	1.47	1.23	1.23	1.23	1.23	1.23
	-15	2.62	2.35	2.08	1.81	1.53	1.28	1.28	1.28	1.28	1.28
	-7	2.89	2.59	2.28	1.99	1.68	1.41	1.41	1.41	1.41	1.41
	-2	2.84	2.55	2.25	1.95	1.66	1.39	1.39	1.39	1.39	1.39
	2	2.80	2.51	2.22	1.93	1.64	1.34	1.20	1.20	1.20	1.20
	7	3.24	2.89	2.56	2.22	1.89	1.55	1.21	0.88	0.54	0.48
	10	3.22	2.89	2.54	2.21	1.87	1.54	1.21	0.87	0.54	0.48
	12	3.20	2.87	2.53	2.20	1.87	1.53	1.20	0.87	0.54	0.48
	15	3.16	2.83	2.50	2.17	1.84	1.51	1.19	0.86	0.52	0.48
	20	3.14	2.81	2.48	2.16	1.83	1.50	1.18	0.85	0.52	0.48

COP		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-20	2.08	2.09	2.10	2.12	2.14	2.17	2.17	2.17	2.17	2.17
	-15	2.50	2.51	2.53	2.54	2.58	2.61	2.61	2.61	2.61	2.61
	-7	2.78	2.79	2.82	2.83	2.87	2.90	2.90	2.90	2.90	2.90
	-2	3.33	3.35	3.37	3.40	3.42	3.46	3.46	3.46	3.46	3.46
	2	3.60	3.62	3.65	3.67	3.70	3.77	3.79	3.79	3.79	3.79
	7	4.52	4.55	4.57	4.61	4.64	4.72	4.83	4.98	5.40	5.57
	10	4.82	4.84	4.88	4.90	4.97	5.03	5.12	5.34	5.73	5.91
	12	5.07	5.09	5.13	5.16	5.20	5.30	5.41	5.60	6.00	6.18
	15	5.45	5.47	5.49	5.55	5.61	5.68	5.79	5.99	6.56	6.63
	20	6.20	6.23	6.26	6.31	6.37	6.47	6.60	6.85	7.41	7.51

- * Heating capacity and power input are shown peak value during operation
- * Heating capacity and power input at 100% load are shown at maximum compressor operating frequency
- * Power input does not include water pump power.
- * Heating capacity and power input at 100% load are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C)
LWT : Leaving water temperature (°C)

Specifications part load heating capacity and input LWT(°C) = 45°C

Outdoor unit HWS-1105H-E
 Hydro unit HWS-1405XWH**-E

Capacity (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-20	4.94	4.45	3.95	3.46	2.97	2.49	2.49	2.49	2.49	2.49
	-15	6.19	5.58	4.95	4.34	3.71	3.12	3.12	3.12	3.12	3.12
	-7	7.58	6.83	6.07	5.30	4.55	3.81	3.81	3.81	3.81	3.81
	-2	8.94	8.04	7.15	6.26	5.37	4.50	4.50	4.50	4.50	4.50
	2	9.53	8.57	7.62	6.67	5.72	4.76	4.21	4.21	4.21	4.21
	7	13.62	12.26	10.89	9.53	8.17	6.81	6.02	6.02	6.02	6.02
	10	14.43	12.99	11.55	10.10	8.66	7.22	6.38	6.38	6.38	6.38
	12	15.12	13.60	12.09	10.59	9.07	7.56	6.68	6.68	6.68	6.68
	15	15.07	13.56	12.06	10.55	9.04	7.54	6.66	6.66	6.66	6.66
	20	17.03	15.33	13.63	11.93	10.22	8.52	7.53	7.53	7.53	7.53

Power input (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-20	3.31	2.97	2.64	2.31	1.97	1.63	1.63	1.63	1.63	1.63
	-15	3.44	3.10	2.74	2.40	2.05	1.70	1.70	1.70	1.70	1.70
	-7	3.79	3.40	3.02	2.63	2.25	1.87	1.87	1.87	1.87	1.87
	-2	3.73	3.35	2.98	2.60	2.23	1.85	1.85	1.85	1.85	1.85
	2	3.67	3.30	2.93	2.56	2.19	1.82	1.60	1.60	1.60	1.60
	7	3.76	3.38	3.00	2.63	2.24	1.86	1.63	1.63	1.63	1.63
	10	3.74	3.36	2.98	2.60	2.23	1.85	1.62	1.62	1.62	1.62
	12	3.73	3.35	2.97	2.60	2.22	1.84	1.61	1.61	1.61	1.61
	15	3.50	3.14	2.80	2.44	2.08	1.74	1.52	1.52	1.52	1.52
	20	3.48	3.13	2.77	2.43	2.07	1.72	1.51	1.51	1.51	1.51

COP		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-20	1.49	1.50	1.50	1.50	1.50	1.52	1.52	1.52	1.52	1.52
	-15	1.80	1.80	1.80	1.81	1.81	1.84	1.84	1.84	1.84	1.84
	-7	2.00	2.00	2.01	2.01	2.02	2.03	2.03	2.03	2.03	2.03
	-2	2.40	2.40	2.40	2.41	2.41	2.44	2.44	2.44	2.44	2.44
	2	2.59	2.59	2.60	2.60	2.61	2.62	2.64	2.64	2.64	2.64
	7	3.62	3.62	3.63	3.63	3.65	3.66	3.70	3.70	3.70	3.70
	10	3.86	3.87	3.87	3.88	3.89	3.90	3.95	3.95	3.95	3.95
	12	4.06	4.06	4.07	4.07	4.08	4.10	4.15	4.15	4.15	4.15
	15	4.31	4.32	4.31	4.32	4.34	4.34	4.39	4.39	4.39	4.39
	20	4.90	4.90	4.91	4.91	4.94	4.94	5.00	5.00	5.00	5.00

- * Heating capacity and power input are shown peak value during operation
- * Heating capacity and power input at 100% load are shown at maximum compressor operating frequency
- * Power input does not include water pump power.
- * Heating capacity and power input at 100% load are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C)
 LWT : Leaving water temperature (°C)

Specifications part load heating capacity and input LWT(°C) = 55°C

Outdoor unit HWS-1105H-E
 Hydro unit HWS-1405XWH**-E

Capacity (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-20	—	—	—	—	—	—	—	—	—	—
	-15	—	—	—	—	—	—	—	—	—	—
	-7	—	—	—	—	—	—	—	—	—	—
	-2	7.62	6.86	6.10	5.34	4.57	4.15	4.15	4.15	4.15	4.15
	2	8.12	7.31	6.50	5.68	4.87	4.43	4.43	4.43	4.43	4.43
	7	10.98	9.88	8.78	7.69	6.59	5.49	5.29	5.29	5.29	5.29
	10	11.64	10.47	9.31	8.15	6.98	5.82	5.60	5.60	5.60	5.60
	12	12.19	10.97	9.75	8.54	7.31	6.10	5.87	5.87	5.87	5.87
	15	11.72	10.55	9.38	8.21	7.03	5.87	5.64	5.64	5.64	5.64
	20	13.26	11.93	10.60	9.28	7.95	6.63	6.38	6.38	6.38	6.38

Power input (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-20	—	—	—	—	—	—	—	—	—	—
	-15	—	—	—	—	—	—	—	—	—	—
	-7	—	—	—	—	—	—	—	—	—	—
	-2	4.13	3.72	3.31	2.90	2.49	2.27	2.27	2.27	2.27	2.27
	2	4.07	3.67	3.26	2.86	2.46	2.24	2.24	2.24	2.24	2.24
	7	3.99	3.59	3.19	2.80	2.41	2.01	1.94	1.94	1.94	1.94
	10	3.96	3.57	3.18	2.78	2.39	2.00	1.92	1.92	1.92	1.92
	12	3.95	3.56	3.16	2.77	2.38	1.99	1.92	1.92	1.92	1.92
	15	3.64	3.27	2.91	2.55	2.20	1.84	1.77	1.77	1.77	1.77
	20	3.61	3.25	2.90	2.53	2.18	1.82	1.76	1.76	1.76	1.76

COP		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-20	—	—	—	—	—	—	—	—	—	—
	-15	—	—	—	—	—	—	—	—	—	—
	-7	—	—	—	—	—	—	—	—	—	—
	-2	1.85	1.84	1.84	1.84	1.83	1.83	1.83	1.83	1.83	1.83
	2	1.99	1.99	1.99	1.99	1.98	1.98	1.98	1.98	1.98	1.98
	7	2.75	2.75	2.75	2.75	2.74	2.73	2.73	2.73	2.73	2.73
	10	2.94	2.93	2.93	2.93	2.92	2.91	2.91	2.91	2.91	2.91
	12	3.09	3.09	3.08	3.08	3.07	3.07	3.05	3.05	3.05	3.05
	15	3.22	3.22	3.22	3.22	3.20	3.19	3.20	3.20	3.20	3.20
	20	3.67	3.67	3.66	3.66	3.65	3.65	3.63	3.63	3.63	3.63

* Heating capacity and power input are shown peak value during operation
 * Heating capacity and power input at 100% load are shown at maximum compressor operating frequency
 * Power input does not include water pump power.
 * Heating capacity and power input at 100% load are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C)
 LWT : Leaving water temperature (°C)



Specifications Low noise operation

40.2Hz

Outdoor unit HWS-1105H-E
Hydro unit HWS-1405XWH**-E

Capacity (kW)		LWT (°C)		
		35	45	55
TO (°C)	-20	3.54	3.35	—
	-15	4.44	4.19	—
	-7	5.44	5.12	—
	-2	6.40	6.04	5.53
	2	6.82	6.44	5.89
	7	9.89	9.21	7.96
	10	10.49	9.76	8.43
	12	10.98	10.21	8.83
	15	11.63	10.18	8.50
20	13.14	11.52	9.61	

Power input (kW)		LWT (°C)		
		35	45	55
TO (°C)	-20	1.67	2.22	—
	-15	1.74	2.32	—
	-7	1.91	2.55	—
	-2	1.89	2.51	3.00
	2	1.86	2.48	2.96
	7	2.14	2.53	2.90
	10	2.13	2.52	2.88
	12	2.12	2.50	2.87
	15	2.09	2.36	2.65
20	2.08	2.34	2.62	

COP		LWT (°C)		
		35	45	55
TO (°C)	-20	2.12	1.50	—
	-15	2.55	1.81	—
	-7	2.85	2.01	—
	-2	3.40	2.40	1.84
	2	3.67	2.60	1.99
	7	4.61	3.64	2.75
	10	4.91	3.88	2.93
	12	5.17	4.08	3.08
	15	5.57	4.32	3.21
20	6.33	4.93	3.66	

* Heating capacity and power input are shown peak value during operation

* Heating capacity and power input at 100% load are shown at maximum compressor operating frequency

* Power input does not include water pump power.

TO : Outdoor temperature (DB°C)

LWT : Leaving water temperature (°C)

Specifications part load cooling capacity and input LWT(°C) = 7°C

Outdoor unit HWS-1105H-E
 Hydro unit HWS-1405XWH**-E

Capacity (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	11.14	10.02	8.91	7.80	6.69	5.57	4.45	3.34	2.23	1.91
	27	10.72	9.65	8.58	7.50	6.43	5.36	5.17	5.17	5.17	5.17
	30	10.54	9.49	8.43	7.38	6.33	5.27	5.08	5.08	5.08	5.08
	35	10.24	9.22	8.19	7.17	6.14	5.12	4.94	4.94	4.94	4.94
	40	9.18	8.25	7.34	6.42	5.51	5.06	5.06	5.06	5.06	5.06
	43	7.06	6.35	5.64	4.94	4.23	3.89	3.89	3.89	3.89	3.89

Power input (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	2.15	1.90	1.65	1.43	1.21	1.01	0.82	0.64	0.49	0.44
	27	2.68	2.36	2.06	1.78	1.51	1.26	1.22	1.22	1.22	1.22
	30	2.91	2.57	2.24	1.93	1.64	1.37	1.32	1.32	1.32	1.32
	35	3.29	2.90	2.53	2.18	1.85	1.54	1.50	1.50	1.50	1.50
	40	3.57	3.15	2.75	2.36	2.01	1.84	1.84	1.84	1.84	1.84
	43	3.06	2.70	2.35	2.04	1.73	1.59	1.59	1.59	1.59	1.59

COP		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	5.18	5.28	5.39	5.47	5.51	5.52	5.42	5.19	4.57	4.34
	27	4.00	4.08	4.15	4.21	4.26	4.25	4.24	4.24	4.24	4.24
	30	3.62	3.70	3.76	3.83	3.86	3.85	3.84	3.84	3.84	3.84
	35	3.11	3.18	3.24	3.29	3.32	3.32	3.30	3.30	3.30	3.30
	40	2.57	2.62	2.67	2.72	2.74	2.75	2.75	2.75	2.75	2.75
	43	2.30	2.35	2.40	2.42	2.45	2.45	2.45	2.45	2.45	2.45

* Cooling capacity and power input at 100% load are the data at rated compressor operating frequency of rated condition 1

* Power input does not include water pump power.

* Cooling capacity and power input at 100% load are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C)

LWT : Leaving water temperature (°C)

Specifications part load cooling capacity and input LWT(°C) = 13°C

Outdoor unit HWS-1105H-E
 Hydro unit HWS-1405XWH**-E

Capacity (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	12.95	11.65	10.35	9.06	7.76	6.48	5.18	3.89	3.80	3.80
	27	12.52	11.27	10.02	8.77	7.51	6.99	6.99	6.99	6.99	6.99
	30	12.34	11.11	9.87	8.64	7.40	6.89	6.89	6.89	6.89	6.89
	35	12.03	10.83	9.62	8.42	7.22	6.72	6.72	6.72	6.72	6.72
	40	10.78	9.70	8.63	7.55	6.66	6.66	6.66	6.66	6.66	6.66
	43	8.29	7.46	6.63	5.80	5.12	5.12	5.12	5.12	5.12	5.12

Power input (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	2.17	1.94	1.65	1.39	1.15	0.93	0.72	0.53	0.52	0.52
	27	2.74	2.37	2.03	1.71	1.41	1.29	1.29	1.29	1.29	1.29
	30	2.98	2.58	2.21	1.86	1.54	1.41	1.41	1.41	1.41	1.41
	35	3.39	2.93	2.52	2.12	1.75	1.61	1.61	1.61	1.61	1.61
	40	3.58	3.11	2.66	2.24	1.91	1.91	1.91	1.91	1.91	1.91
	43	3.05	2.64	2.26	1.90	1.62	1.62	1.62	1.62	1.62	1.62

COP		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	5.97	6.01	6.26	6.51	6.72	7.00	7.20	7.33	7.28	7.28
	27	4.57	4.75	4.94	5.14	5.32	5.42	5.42	5.42	5.42	5.42
	30	4.14	4.30	4.47	4.64	4.80	4.90	4.90	4.90	4.90	4.90
	35	3.55	3.69	3.82	3.98	4.14	4.18	4.18	4.18	4.18	4.18
	40	3.01	3.12	3.25	3.37	3.48	3.48	3.48	3.48	3.48	3.48
	43	2.72	2.83	2.94	3.05	3.15	3.15	3.15	3.15	3.15	3.15

* Cooling capacity and power input at 100% load are the data at rated compressor operating frequency of rated condition 1

* Power input does not include water pump power.

* Cooling capacity and power input at 100% load are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C)

LWT : Leaving water temperature (°C)

Specifications part load cooling capacity and input LWT(°C) = 18°C

Outdoor unit HWS-1105H-E
 Hydro unit HWS-1405XWH**-E

Capacity (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	14.75	13.27	11.80	10.33	8.85	7.38	5.90	5.55	5.55	5.55
	27	14.32	12.89	11.46	10.02	8.74	8.74	8.74	8.74	8.74	8.74
	30	14.13	12.71	11.31	9.89	8.63	8.63	8.63	8.63	8.63	8.63
	35	13.82	12.44	11.05	9.67	8.43	8.43	8.43	8.43	8.43	8.43
	40	12.38	11.15	9.91	8.67	8.20	8.20	8.20	8.20	8.20	8.20
	43	9.53	8.57	7.62	6.67	6.31	6.31	6.31	6.31	6.31	6.31

Power input (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	2.19	1.96	1.63	1.34	1.08	0.83	0.61	0.56	0.56	0.56
	27	2.79	2.38	1.99	1.63	1.34	1.34	1.34	1.34	1.34	1.34
	30	3.05	2.61	2.18	1.79	1.46	1.46	1.46	1.46	1.46	1.46
	35	3.49	2.97	2.49	2.05	1.68	1.68	1.68	1.68	1.68	1.68
	40	3.69	3.14	2.63	2.16	1.99	1.99	1.99	1.99	1.99	1.99
	43	3.10	2.64	2.22	1.82	1.68	1.68	1.68	1.68	1.68	1.68

COP		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	6.75	6.78	7.22	7.68	8.22	8.85	9.75	9.95	9.95	9.95
	27	5.12	5.41	5.76	6.14	6.50	6.50	6.50	6.50	6.50	6.50
	30	4.63	4.88	5.18	5.53	5.89	5.89	5.89	5.89	5.89	5.89
	35	3.96	4.19	4.44	4.73	5.02	5.02	5.02	5.02	5.02	5.02
	40	3.36	3.55	3.77	4.02	4.12	4.12	4.12	4.12	4.12	4.12
	43	3.07	3.25	3.44	3.66	3.76	3.76	3.76	3.76	3.76	3.76

* Cooling capacity and power input at 100% load are the data at rated compressor operating frequency of rated condition 1

* Power input does not include water pump power.

* Cooling capacity and power input at 100% load are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C)

LWT : Leaving water temperature (°C)

Specifications Low noise operation**40.2Hz**

Outdoor unit HWS-1105H-E
 Hydro unit HWS-1405XWH**-E

Capacity (kW)		LWT (°C)		
		7	13	18
TO (°C)	20	8.31	10.17	11.94
	27	7.99	9.84	11.60
	30	7.86	9.69	11.44
	35	7.64	9.46	11.19
	40	6.84	8.47	10.03
	43	5.26	6.51	7.72

Power input (kW)		LWT (°C)		
		7	13	18
TO (°C)	20	1.53	1.62	1.67
	27	1.91	1.98	2.03
	30	2.07	2.16	2.22
	35	2.34	2.46	2.54
	40	2.54	2.60	2.68
	43	2.18	2.21	2.25

COP		LWT (°C)		
		7	13	18
TO (°C)	20	5.43	6.27	7.17
	27	4.20	4.96	5.70
	30	3.80	4.48	5.16
	35	3.27	3.84	4.41
	40	2.69	3.26	3.75
	43	2.42	2.95	3.42

* Cooling capacity and power input in low noise operation are the data at low noise operation frequency.

* Power input does not include water pump power.

TO : Outdoor temperature (DB°C)

LWT : Leaving water temperature (°C)

Specifications part load heating capacity and input LWT(°C) = 35°C

Outdoor unit HWS-1405H-E
 Hydro unit HWS-1405XWH**-E

Capacity (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-20	5.69	5.12	4.55	3.99	3.42	2.85	2.54	2.54	2.54	2.54
	-15	7.31	6.59	5.85	5.12	4.38	3.66	3.27	3.27	3.27	3.27
	-7	8.63	7.76	6.91	6.04	5.18	4.32	3.86	3.86	3.86	3.86
	-2	10.07	9.06	8.05	7.05	6.04	5.04	4.50	4.50	4.50	4.50
	2	10.65	9.58	8.52	7.45	6.39	5.32	4.26	4.23	4.23	4.23
	7	16.74	15.06	13.39	11.72	10.05	8.37	6.69	5.02	3.35	2.92
	10	17.58	15.82	14.06	12.30	10.55	8.79	7.03	5.27	3.52	3.07
	12	18.58	16.72	14.87	13.01	11.15	9.29	7.43	5.58	3.71	3.24
	15	19.56	17.60	15.64	13.69	11.73	9.78	7.83	5.87	3.91	3.42
	20	21.29	19.16	17.04	14.90	12.77	10.65	8.52	6.39	4.25	3.72

Power input (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-20	2.81	2.51	2.22	1.92	1.62	1.33	1.16	1.16	1.16	1.16
	-15	2.96	2.65	2.34	2.02	1.71	1.40	1.23	1.23	1.23	1.23
	-7	3.29	2.95	2.59	2.25	1.90	1.55	1.37	1.37	1.37	1.37
	-2	3.25	2.90	2.56	2.22	1.87	1.53	1.35	1.35	1.35	1.35
	2	3.20	2.86	2.52	2.19	1.85	1.51	1.17	1.17	1.17	1.17
	7	3.94	3.52	3.11	2.69	2.28	1.86	1.44	1.03	0.61	0.50
	10	3.95	3.53	3.12	2.70	2.28	1.86	1.44	1.03	0.61	0.50
	12	3.96	3.54	3.13	2.70	2.28	1.86	1.45	1.03	0.61	0.51
	15	3.90	3.49	3.08	2.67	2.25	1.84	1.43	1.02	0.61	0.50
	20	3.68	3.29	2.91	2.51	2.13	1.74	1.35	0.96	0.57	0.47

COP		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-20	2.02	2.04	2.05	2.08	2.11	2.15	2.18	2.18	2.18	2.18
	-15	2.47	2.49	2.50	2.53	2.56	2.62	2.66	2.66	2.66	2.66
	-7	2.62	2.63	2.66	2.69	2.72	2.79	2.83	2.83	2.83	2.83
	-2	3.10	3.13	3.14	3.18	3.23	3.28	3.34	3.34	3.34	3.34
	2	3.33	3.35	3.38	3.41	3.46	3.53	3.63	3.63	3.63	3.63
	7	4.24	4.28	4.30	4.35	4.40	4.50	4.64	4.87	5.49	5.84
	10	4.45	4.49	4.51	4.56	4.62	4.72	4.87	5.11	5.76	6.12
	12	4.70	4.73	4.76	4.81	4.88	4.99	5.11	5.40	6.08	6.35
	15	5.01	5.04	5.08	5.13	5.20	5.31	5.47	5.76	6.44	6.83
	20	5.78	5.82	5.86	5.93	5.99	6.12	6.33	6.63	7.47	7.89

- * Heating capacity and power input are shown peak value during operation
- * Heating capacity and power input at 100% load are shown at maximum compressor operating frequency
- * Power input does not include water pump power.
- * Heating capacity and power input at 100% load are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C)
 LWT : Leaving water temperature (°C)

Specifications part load heating capacity and input LWT(°C) = 45°C

Outdoor unit HWS-1405H-E
 Hydro unit HWS-1405XWH**-E

Capacity (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-20	5.03	4.53	4.02	3.52	3.02	2.52	2.38	2.38	2.38	2.38
	-15	6.47	5.82	5.17	4.53	3.88	3.23	3.06	3.06	3.06	3.06
	-7	7.64	6.88	6.11	5.35	4.58	3.82	3.61	3.61	3.61	3.61
	-2	8.91	8.02	7.13	6.24	5.35	4.46	4.22	4.22	4.22	4.22
	2	9.43	8.48	7.54	6.60	5.65	4.72	3.92	3.92	3.92	3.92
	7	14.26	12.84	11.41	9.98	8.55	7.13	5.93	5.93	5.93	5.93
	10	14.97	13.47	11.98	10.48	8.98	7.49	6.23	6.23	6.23	6.23
	12	15.83	14.24	12.67	11.08	9.50	7.92	6.58	6.58	6.58	6.58
	15	15.80	14.21	12.64	11.06	9.48	7.90	6.57	6.57	6.57	6.57
	20	17.20	15.48	13.75	12.04	10.32	8.60	7.15	7.15	7.15	7.15

Power input (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-20	3.32	2.98	2.62	2.28	1.94	1.59	1.47	1.47	1.47	1.47
	-15	3.51	3.14	2.77	2.40	2.04	1.67	1.55	1.55	1.55	1.55
	-7	3.89	3.49	3.08	2.68	2.27	1.87	1.72	1.72	1.72	1.72
	-2	3.84	3.44	3.04	2.64	2.24	1.84	1.70	1.70	1.70	1.70
	2	3.78	3.38	3.00	2.60	2.20	1.81	1.45	1.45	1.45	1.45
	7	4.00	3.59	3.16	2.75	2.34	1.91	1.54	1.54	1.54	1.54
	10	4.00	3.59	3.16	2.75	2.33	1.91	1.53	1.53	1.53	1.53
	12	4.02	3.60	3.18	2.76	2.34	1.92	1.54	1.54	1.54	1.54
	15	3.88	3.47	3.07	2.66	2.26	1.86	1.49	1.49	1.49	1.49
	20	3.65	3.27	2.90	2.51	2.13	1.75	1.40	1.40	1.40	1.40

COP		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-20	1.52	1.52	1.53	1.54	1.56	1.59	1.62	1.62	1.62	1.62
	-15	1.85	1.86	1.86	1.89	1.90	1.93	1.97	1.97	1.97	1.97
	-7	1.96	1.97	1.98	2.00	2.01	2.05	2.10	2.10	2.10	2.10
	-2	2.32	2.33	2.35	2.36	2.39	2.42	2.48	2.48	2.48	2.48
	2	2.49	2.51	2.52	2.54	2.57	2.61	2.70	2.70	2.70	2.70
	7	3.56	3.58	3.61	3.63	3.66	3.73	3.87	3.87	3.87	3.87
	10	3.74	3.76	3.79	3.81	3.85	3.92	4.06	4.06	4.06	4.06
	12	3.94	3.96	3.99	4.01	4.06	4.12	4.28	4.28	4.28	4.28
	15	4.07	4.09	4.12	4.16	4.19	4.25	4.42	4.42	4.42	4.42
	20	4.71	4.73	4.75	4.80	4.85	4.92	5.12	5.12	5.12	5.12

- * Heating capacity and power input are shown peak value during operation
- * Heating capacity and power input at 100% load are shown at maximum compressor operating frequency
- * Power input does not include water pump power.
- * Heating capacity and power input at 100% load are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C)
 LWT : Leaving water temperature (°C)

Specifications part load heating capacity and input LWT(°C) = 55°C

Outdoor unit HWS-1405H-E
 Hydro unit HWS-1405XWH**-E

Capacity (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-20	—	—	—	—	—	—	—	—	—	—
	-15	—	—	—	—	—	—	—	—	—	—
	-7	—	—	—	—	—	—	—	—	—	—
	-2	7.84	7.06	6.27	5.49	4.71	4.09	4.09	4.09	4.09	4.09
	2	8.30	7.47	6.64	5.80	4.98	4.32	4.32	4.32	4.32	4.32
	7	11.67	10.51	9.33	8.17	7.01	5.84	5.26	5.26	5.26	5.26
	10	12.26	11.03	9.80	8.58	7.35	6.13	5.53	5.53	5.53	5.53
	12	12.96	11.66	10.37	9.07	7.77	6.48	5.85	5.85	5.85	5.85
	15	12.48	11.23	9.99	8.73	7.48	6.24	5.63	5.63	5.63	5.63
	20	13.58	12.23	10.86	9.51	8.15	6.80	6.13	6.13	6.13	6.13

Power input (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-20	—	—	—	—	—	—	—	—	—	—
	-15	—	—	—	—	—	—	—	—	—	—
	-7	—	—	—	—	—	—	—	—	—	—
	-2	4.16	3.77	3.36	2.96	2.57	2.18	2.18	2.18	2.18	2.18
	2	4.10	3.70	3.32	2.92	2.52	2.15	2.15	2.15	2.15	2.15
	7	4.06	3.67	3.28	2.89	2.50	2.12	1.85	1.85	1.85	1.85
	10	4.06	3.68	3.28	2.89	2.50	2.12	1.85	1.85	1.85	1.85
	12	4.07	3.68	3.28	2.90	2.50	2.11	1.85	1.85	1.85	1.85
	15	3.89	3.51	3.14	2.77	2.39	2.02	1.77	1.77	1.77	1.77
	20	3.66	3.31	2.96	2.61	2.26	1.90	1.67	1.67	1.67	1.67

COP		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-20	—	—	—	—	—	—	—	—	—	—
	-15	—	—	—	—	—	—	—	—	—	—
	-7	—	—	—	—	—	—	—	—	—	—
	-2	1.88	1.87	1.87	1.85	1.83	1.87	1.87	1.87	1.87	1.87
	2	2.02	2.02	2.00	1.99	1.97	2.01	2.01	2.01	2.01	2.01
	7	2.87	2.86	2.85	2.83	2.80	2.76	2.84	2.84	2.84	2.84
	10	3.02	3.00	2.99	2.97	2.93	2.89	2.99	2.99	2.99	2.99
	12	3.19	3.17	3.16	3.13	3.11	3.07	3.16	3.16	3.16	3.16
	15	3.21	3.20	3.18	3.15	3.13	3.09	3.18	3.18	3.18	3.18
	20	3.71	3.69	3.67	3.64	3.61	3.57	3.67	3.67	3.67	3.67

* Heating capacity and power input are shown peak value during operation
 * Heating capacity and power input at 100% load are shown at maximum compressor operating frequency
 * Power input does not include water pump power.
 * Heating capacity and power input at 100% load are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C)
 LWT : Leaving water temperature (°C)



Specifications Low noise operation

40.2Hz

Outdoor unit HWS-1405H-E
Hydro unit HWS-1405XWH**-E

Capacity (kW)		LWT (°C)		
		35	45	55
TO (°C)	-20	3.34	3.20	—
	-15	4.29	4.11	—
	-7	5.07	4.85	—
	-2	5.91	5.66	5.65
	2	6.26	5.99	5.98
	7	9.83	9.06	8.40
	10	10.31	9.50	8.82
	12	10.91	10.06	9.33
	15	11.48	10.03	8.98
20	12.50	10.92	9.78	

Power input (kW)		LWT (°C)		
		35	45	55
TO (°C)	-20	1.58	2.05	—
	-15	1.67	2.17	—
	-7	1.86	2.41	—
	-2	1.83	2.38	2.97
	2	1.80	2.34	2.93
	7	2.22	2.48	2.90
	10	2.22	2.48	2.90
	12	2.23	2.49	2.90
	15	2.20	2.40	2.78
20	2.08	2.26	2.62	

COP		LWT (°C)		
		35	45	55
TO (°C)	-20	2.11	1.56	—
	-15	2.57	1.90	—
	-7	2.73	2.01	—
	-2	3.23	2.38	1.90
	2	3.48	2.55	2.04
	7	4.42	3.66	2.90
	10	4.64	3.84	3.04
	12	4.88	4.04	3.21
	15	5.23	4.18	3.23
20	6.00	4.82	3.74	

* Heating capacity and power input are shown peak value during operation

* Heating capacity and power input at 100% load are shown at maximum compressor operating frequency

* Power input does not include water pump power.

TO : Outdoor temperature (DB°C)

LWT : Leaving water temperature (°C)

Specifications part load cooling capacity and input LWT(°C) = 7°C

Outdoor unit HWS-1405H-E
 Hydro unit HWS-1405XWH**-E

Capacity (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	13.29	11.97	10.63	9.31	7.97	6.65	5.32	3.99	2.66	1.89
	27	12.59	11.33	10.07	8.81	7.55	6.29	5.34	5.34	5.34	5.34
	30	12.28	11.06	9.83	8.60	7.37	6.15	5.22	5.22	5.22	5.22
	35	11.78	10.60	9.42	8.25	7.07	5.89	5.00	5.00	5.00	5.00
	40	9.46	8.51	7.56	6.62	5.68	4.73	4.60	4.60	4.60	4.60
	43	7.29	6.56	5.84	5.11	4.38	3.65	3.56	3.56	3.56	3.56

Power input (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	2.88	2.54	2.21	1.91	1.62	1.36	1.11	0.87	0.66	0.55
	27	3.44	3.03	2.64	2.28	1.93	1.62	1.39	1.39	1.39	1.39
	30	3.67	3.23	2.83	2.44	2.07	1.72	1.49	1.49	1.49	1.49
	35	4.07	3.59	3.13	2.69	2.29	1.92	1.65	1.65	1.65	1.65
	40	3.83	3.37	2.94	2.54	2.15	1.81	1.76	1.76	1.76	1.76
	43	3.24	2.85	2.49	2.14	1.83	1.53	1.49	1.49	1.49	1.49

COP		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	4.61	4.71	4.81	4.88	4.91	4.90	4.79	4.58	4.02	3.43
	27	3.66	3.74	3.82	3.86	3.90	3.89	3.86	3.86	3.86	3.86
	30	3.34	3.42	3.48	3.53	3.57	3.56	3.50	3.50	3.50	3.50
	35	2.89	2.95	3.01	3.06	3.08	3.08	3.04	3.04	3.04	3.04
	40	2.47	2.53	2.57	2.60	2.63	2.62	2.62	2.62	2.62	2.62
	43	2.25	2.30	2.34	2.38	2.40	2.39	2.39	2.39	2.39	2.39

* Cooling capacity and power input at 100% load are shown at maximum compressor operating frequency
 * Power input does not include water pump power.
 * Cooling capacity and power input at 100% load are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C)
 LWT : Leaving water temperature (°C)

Specifications part load cooling capacity and input LWT(°C) = 13°C

Outdoor unit HWS-1405H-E
 Hydro unit HWS-1405XWH**-E

Capacity (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	15.50	13.94	12.40	10.84	9.29	7.75	6.20	4.65	4.48	4.48
	27	14.52	13.06	11.61	10.16	8.71	7.59	7.59	7.59	7.59	7.59
	30	14.09	12.68	11.27	9.86	8.45	7.37	7.37	7.37	7.37	7.37
	35	13.39	12.05	10.72	9.37	8.03	7.00	7.00	7.00	7.00	7.00
	40	10.75	9.68	8.60	7.53	6.45	6.18	6.18	6.18	6.18	6.18
	43	8.28	7.46	6.63	5.80	4.97	4.76	4.76	4.76	4.76	4.76

Power input (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	2.88	2.48	2.11	1.77	1.45	1.16	0.89	0.65	0.63	0.63
	27	3.44	2.96	2.53	2.11	1.74	1.47	1.47	1.47	1.47	1.47
	30	3.67	3.17	2.70	2.25	1.85	1.56	1.56	1.56	1.56	1.56
	35	4.07	3.51	2.99	2.50	2.05	1.73	1.73	1.73	1.73	1.73
	40	3.70	3.19	2.72	2.28	1.87	1.77	1.77	1.77	1.77	1.77
	43	3.11	2.68	2.28	1.91	1.57	1.49	1.49	1.49	1.49	1.49

COP		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	5.38	5.62	5.87	6.14	6.41	6.69	6.95	7.11	7.14	7.14
	27	4.23	4.41	4.60	4.82	5.01	5.17	5.17	5.17	5.17	5.17
	30	3.84	4.01	4.18	4.37	4.57	4.73	4.73	4.73	4.73	4.73
	35	3.29	3.43	3.58	3.75	3.92	4.04	4.04	4.04	4.04	4.04
	40	2.90	3.03	3.16	3.30	3.45	3.49	3.49	3.49	3.49	3.49
	43	2.67	2.78	2.91	3.03	3.17	3.19	3.19	3.19	3.19	3.19

* Cooling capacity and power input at 100% load are shown at maximum compressor operating frequency

* Power input does not include water pump power.

* Cooling capacity and power input at 100% load are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C)

LWT : Leaving water temperature (°C)

Specifications part load cooling capacity and input LWT(°C) = 18°C

Outdoor unit HWS-1405H-E
 Hydro unit HWS-1405XWH**-E

Capacity (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	17.71	15.94	14.17	12.40	10.62	8.86	7.09	6.16	6.16	6.16
	27	16.45	14.80	13.16	11.51	9.87	9.26	9.26	9.26	9.26	9.26
	30	15.90	14.31	12.72	11.13	9.54	8.95	8.95	8.95	8.95	8.95
	35	15.00	13.50	12.00	10.50	9.00	8.44	8.44	8.44	8.44	8.44
	40	12.05	10.84	9.64	8.43	7.35	7.35	7.35	7.35	7.35	7.35
	43	8.90	8.36	7.42	6.50	5.66	5.66	5.66	5.66	5.66	5.66

Power input (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	2.88	2.57	2.16	1.78	1.43	1.12	0.83	0.70	0.70	0.70
	27	3.44	2.93	2.46	2.03	1.63	1.49	1.49	1.49	1.49	1.49
	30	3.67	3.13	2.63	2.17	1.74	1.59	1.59	1.59	1.59	1.59
	35	4.07	3.47	2.91	2.40	1.93	1.76	1.76	1.76	1.76	1.76
	40	3.68	3.14	2.64	2.17	1.78	1.78	1.78	1.78	1.78	1.78
	43	3.05	2.61	2.19	1.80	1.48	1.48	1.48	1.48	1.48	1.48

COP		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	6.15	6.19	6.55	6.96	7.42	7.93	8.55	8.82	8.82	8.82
	27	4.79	5.05	5.35	5.67	6.07	6.21	6.21	6.21	6.21	6.21
	30	4.33	4.58	4.84	5.14	5.49	5.62	5.62	5.62	5.62	5.62
	35	3.69	3.89	4.12	4.37	4.67	4.78	4.78	4.78	4.78	4.78
	40	3.27	3.45	3.66	3.88	4.12	4.12	4.12	4.12	4.12	4.12
	43	2.91	3.20	3.39	3.61	3.82	3.82	3.82	3.82	3.82	3.82

* Cooling capacity and power input at 100% load are shown at maximum compressor operating frequency
 * Power input does not include water pump power.
 * Cooling capacity and power input at 100% load are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C)
 LWT : Leaving water temperature (°C)

Specifications Low noise operation 40.2Hz

Outdoor unit HWS-1405H-E
Hydro unit HWS-1405XWH**-E

Capacity (kW)		LWT (°C)		
		7	13	18
TO (°C)	20	8.84	11.20	13.19
	27	8.37	10.49	12.25
	30	8.17	10.19	11.85
	35	7.84	9.68	11.17
	40	6.29	7.77	8.98
	43	4.85	5.99	6.91

Power input (kW)		LWT (°C)		
		7	13	18
TO (°C)	20	1.81	1.85	1.95
	27	2.16	2.20	2.22
	30	2.30	2.36	2.37
	35	2.55	2.61	2.63
	40	2.40	2.38	2.37
	43	2.04	1.99	1.97

COP		LWT (°C)		
		7	13	18
TO (°C)	20	4.89	6.07	6.78
	27	3.88	4.77	5.52
	30	3.55	4.32	5.00
	35	3.07	3.71	4.25
	40	2.61	3.27	3.78
	43	2.38	3.01	3.50

* Cooling capacity and power input at 100% load are shown at maximum compressor operating frequency

* Power input does not include water pump power.

TO : Outdoor temperature (DB°C)

LWT : Leaving water temperature (°C)

Specifications part load heating capacity and input LWT(°C) = 35°C

Outdoor unit HWS-1105H8-E, HWS-1105H8R-E
Hydro unit HWS-1405XWH**-E

Capacity (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-20	5.20	4.68	4.16	3.64	3.12	2.62	2.62	2.62	2.62	2.62
	-15	6.79	6.12	5.44	4.75	4.07	3.43	3.43	3.43	3.43	3.43
	-7	8.04	7.24	6.43	5.63	4.83	4.06	4.06	4.06	4.06	4.06
	-2	9.13	8.22	7.31	6.39	5.48	4.61	4.61	4.61	4.61	4.61
	2	10.46	9.41	8.37	7.32	6.27	5.23	4.67	4.67	4.67	4.67
	7	14.73	13.26	11.79	10.31	8.84	7.37	5.89	4.42	2.94	2.69
	10	15.73	14.16	12.59	11.00	9.43	7.86	6.29	4.72	3.14	2.88
	12	16.39	14.75	13.11	11.47	9.83	8.20	6.56	4.92	3.28	3.00
	15	17.21	15.49	13.77	12.05	10.33	8.61	6.88	5.16	3.44	3.15
	20	19.27	17.34	15.41	13.49	11.56	9.64	7.71	5.78	3.86	3.53

Power input (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-20	2.31	2.07	1.83	1.58	1.34	1.10	1.10	1.10	1.10	1.10
	-15	2.58	2.31	2.04	1.77	1.49	1.24	1.24	1.24	1.24	1.24
	-7	2.88	2.58	2.28	1.98	1.67	1.38	1.38	1.38	1.38	1.38
	-2	2.84	2.54	2.24	1.94	1.65	1.36	1.36	1.36	1.36	1.36
	2	2.90	2.59	2.29	1.98	1.68	1.37	1.21	1.21	1.21	1.21
	7	3.14	2.81	2.48	2.15	1.82	1.49	1.16	0.83	0.49	0.45
	10	3.14	2.81	2.48	2.15	1.82	1.49	1.16	0.83	0.50	0.44
	12	3.13	2.80	2.47	2.14	1.81	1.48	1.15	0.82	0.49	0.44
	15	3.07	2.75	2.43	2.10	1.78	1.46	1.14	0.81	0.48	0.44
	20	3.10	2.77	2.44	2.12	1.79	1.47	1.15	0.81	0.49	0.44

COP		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-20	2.25	2.26	2.28	2.31	2.33	2.37	2.37	2.37	2.37	2.37
	-15	2.63	2.65	2.67	2.69	2.73	2.77	2.77	2.77	2.77	2.77
	-7	2.79	2.80	2.82	2.84	2.89	2.94	2.94	2.94	2.94	2.94
	-2	3.21	3.23	3.26	3.29	3.33	3.38	3.38	3.38	3.38	3.38
	2	3.61	3.63	3.65	3.69	3.73	3.81	3.86	3.86	3.86	3.86
	7	4.69	4.71	4.75	4.79	4.85	4.93	5.06	5.30	5.95	6.04
	10	5.02	5.05	5.08	5.13	5.20	5.29	5.45	5.72	6.35	6.60
	12	5.23	5.27	5.30	5.35	5.42	5.53	5.69	5.97	6.63	6.88
	15	5.61	5.64	5.68	5.73	5.80	5.90	6.05	6.33	7.12	7.24
	20	6.22	6.25	6.31	6.36	6.46	6.57	6.73	7.10	7.83	8.10

- * Heating capacity and power input are shown peak value during operation
- * Heating capacity and power input at 100% load are shown at maximum compressor operating frequency
- * Power input does not include water pump power.
- * Heating capacity and power input at 100% load are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C)
LWT : Leaving water temperature (°C)

Specifications part load heating capacity and input LWT(°C) = 45°C

Outdoor unit HWS-1105H8-E, HWS-1105H8R-E
Hydro unit HWS-1405XWH**-E

Capacity (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-20	5.06	4.55	4.05	3.55	3.04	2.54	2.54	2.54	2.54	2.54
	-15	6.61	5.95	5.29	4.63	3.97	3.32	3.32	3.32	3.32	3.32
	-7	7.81	7.03	6.25	5.47	4.68	3.92	3.92	3.92	3.92	3.92
	-2	8.84	7.96	7.07	6.19	5.30	4.43	4.43	4.43	4.43	4.43
	2	9.81	8.83	7.85	6.87	5.88	4.91	4.33	4.33	4.33	4.33
	7	13.93	12.53	11.15	9.75	8.36	6.97	6.15	6.15	6.15	6.15
	10	15.02	13.51	12.01	10.52	9.01	7.51	6.63	6.63	6.63	6.63
	12	15.64	14.07	12.51	10.94	9.38	7.82	6.91	6.91	6.91	6.91
	15	16.30	14.67	13.05	11.41	9.78	8.15	7.20	7.20	7.20	7.20
	20	18.38	16.54	14.71	12.87	11.03	9.20	8.12	8.12	8.12	8.12

Power input (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-20	2.88	2.59	2.30	2.01	1.72	1.45	1.45	1.45	1.45	1.45
	-15	3.23	2.91	2.58	2.25	1.93	1.64	1.64	1.64	1.64	1.64
	-7	3.64	3.27	2.90	2.53	2.17	1.83	1.83	1.83	1.83	1.83
	-2	3.59	3.23	2.86	2.50	2.14	1.81	1.81	1.81	1.81	1.81
	2	3.59	3.23	2.86	2.50	2.14	1.78	1.59	1.59	1.59	1.59
	7	3.76	3.39	3.01	2.62	2.24	1.86	1.67	1.67	1.67	1.67
	10	3.79	3.41	3.03	2.65	2.26	1.88	1.68	1.68	1.68	1.68
	12	3.81	3.42	3.04	2.65	2.27	1.89	1.68	1.68	1.68	1.68
	15	3.78	3.40	3.02	2.64	2.26	1.88	1.68	1.68	1.68	1.68
	20	3.83	3.44	3.06	2.67	2.29	1.90	1.70	1.70	1.70	1.70

COP		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-20	1.76	1.76	1.76	1.77	1.77	1.76	1.76	1.76	1.76	1.76
	-15	2.04	2.05	2.05	2.05	2.06	2.03	2.03	2.03	2.03	2.03
	-7	2.15	2.15	2.16	2.16	2.16	2.14	2.14	2.14	2.14	2.14
	-2	2.46	2.47	2.47	2.47	2.48	2.45	2.45	2.45	2.45	2.45
	2	2.73	2.73	2.74	2.74	2.75	2.76	2.72	2.72	2.72	2.72
	7	3.70	3.70	3.71	3.72	3.73	3.74	3.68	3.68	3.68	3.68
	10	3.96	3.96	3.97	3.97	3.99	3.99	3.95	3.95	3.95	3.95
	12	4.10	4.11	4.11	4.12	4.12	4.15	4.11	4.11	4.11	4.11
	15	4.31	4.32	4.32	4.33	4.33	4.35	4.30	4.30	4.30	4.30
	20	4.80	4.81	4.81	4.82	4.82	4.85	4.79	4.79	4.79	4.79

* Heating capacity and power input are shown peak value during operation

* Heating capacity and power input at 100% load are shown at maximum compressor operating frequency

* Power input does not include water pump power.

* Heating capacity and power input at 100% load are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C)

LWT : Leaving water temperature (°C)

Specifications part load heating capacity and input LWT(°C) = 55°C

Outdoor unit HWS-1105H8-E, HWS-1105H8R-E
 Hydro unit HWS-1405XWH**-E

Capacity (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-20	—	—	—	—	—	—	—	—	—	—
	-15	—	—	—	—	—	—	—	—	—	—
	-7	—	—	—	—	—	—	—	—	—	—
	-2	8.13	7.31	6.50	5.69	4.87	4.07	4.00	4.00	4.00	4.00
	2	8.86	7.98	7.08	6.20	5.31	4.43	4.35	4.35	4.35	4.35
	7	12.56	11.31	10.05	8.79	7.54	6.28	5.41	5.41	5.41	5.41
	10	13.85	12.47	11.08	9.70	8.31	6.93	5.97	5.97	5.97	5.97
	12	14.57	13.11	11.66	10.20	8.74	7.29	6.27	6.27	6.27	6.27
	15	15.03	13.52	12.03	10.52	9.02	7.52	6.48	6.48	6.48	6.48
	20	16.85	15.16	13.48	11.80	10.11	8.43	7.26	7.26	7.26	7.26

Power input (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-20	—	—	—	—	—	—	—	—	—	—
	-15	—	—	—	—	—	—	—	—	—	—
	-7	—	—	—	—	—	—	—	—	—	—
	-2	4.17	3.76	3.36	2.95	2.55	2.15	2.11	2.11	2.11	2.11
	2	4.13	3.73	3.33	2.93	2.53	2.13	2.09	2.09	2.09	2.09
	7	4.36	3.94	3.51	3.10	2.67	2.25	1.95	1.95	1.95	1.95
	10	4.43	4.00	3.57	3.14	2.71	2.28	1.99	1.99	1.99	1.99
	12	4.48	4.04	3.61	3.17	2.74	2.31	2.01	2.01	2.01	2.01
	15	4.48	4.04	3.60	3.18	2.74	2.30	2.00	2.00	2.00	2.00
	20	4.55	4.10	3.67	3.22	2.79	2.34	2.04	2.04	2.04	2.04

COP		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-20	—	—	—	—	—	—	—	—	—	—
	-15	—	—	—	—	—	—	—	—	—	—
	-7	—	—	—	—	—	—	—	—	—	—
	-2	1.95	1.94	1.94	1.93	1.91	1.89	1.89	1.89	1.89	1.89
	2	2.14	2.14	2.13	2.11	2.10	2.08	2.08	2.08	2.08	2.08
	7	2.88	2.87	2.86	2.84	2.82	2.79	2.77	2.77	2.77	2.77
	10	3.13	3.12	3.10	3.09	3.06	3.04	3.00	3.00	3.00	3.00
	12	3.25	3.24	3.23	3.21	3.19	3.16	3.12	3.12	3.12	3.12
	15	3.36	3.35	3.34	3.31	3.29	3.26	3.24	3.24	3.24	3.24
	20	3.70	3.69	3.68	3.66	3.63	3.60	3.56	3.56	3.56	3.56

* Heating capacity and power input are shown peak value during operation
 * Heating capacity and power input at 100% load are shown at maximum compressor operating frequency
 * Power input does not include water pump power.
 * Heating capacity and power input at 100% load are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C)
 LWT : Leaving water temperature (°C)

Specifications Low noise operation

40.2Hz

Outdoor unit HWS-1105H8-E, HWS-1105H8R-E
 Hydro unit HWS-1405XWH**-E

Capacity (kW)		LWT (°C)		
		35	45	55
TO (°C)	-20	3.51	3.42	—
	-15	4.59	4.47	—
	-7	5.44	5.28	—
	-2	6.17	5.97	5.89
	2	7.07	6.63	6.42
	7	9.96	9.41	9.10
	10	10.63	10.15	10.04
	12	11.08	10.58	10.56
	15	11.64	11.03	10.90
20	13.03	12.43	12.22	

Power input (kW)		LWT (°C)		
		35	45	55
TO (°C)	-20	1.51	1.93	—
	-15	1.68	2.18	—
	-7	1.89	2.45	—
	-2	1.85	2.42	2.82
	2	1.90	2.41	2.79
	7	2.06	2.53	2.94
	10	2.05	2.55	2.99
	12	2.05	2.57	3.02
	15	2.01	2.54	3.03
20	2.03	2.57	3.07	

COP		LWT (°C)		
		35	45	55
TO (°C)	-20	2.32	1.77	—
	-15	2.73	2.05	—
	-7	2.88	2.16	—
	-2	3.33	2.47	2.09
	2	3.73	2.75	2.30
	7	4.84	3.72	3.09
	10	5.19	3.98	3.36
	12	5.42	4.12	3.50
	15	5.79	4.34	3.60
20	6.43	4.83	3.98	

* Heating capacity and power input are shown peak value during operation

* Heating capacity and power input at 100% load are shown at maximum compressor operating frequency

* Power input does not include water pump power.

TO : Outdoor temperature (DB°C)

LWT : Leaving water temperature (°C)

Specifications part load cooling capacity and input LWT(°C) = 7°C

Outdoor unit HWS-1105H8-E, HWS-1105H8R-E
 Hydro unit HWS-1405XWH**-E

Capacity (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	11.15	10.03	8.92	7.80	6.69	5.58	4.46	3.35	2.23	2.04
	27	10.69	9.62	8.55	7.48	6.41	5.34	5.50	5.50	5.50	5.50
	30	10.49	9.44	8.40	7.34	6.29	5.25	5.40	5.40	5.40	5.40
	35	10.16	9.14	8.13	7.11	6.09	5.09	5.23	5.23	5.23	5.23
	40	9.39	8.45	7.52	6.57	5.64	5.52	5.52	5.52	5.52	5.52
	43	8.93	8.05	7.15	6.26	5.36	5.26	5.26	5.26	5.26	5.26

Power input (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	2.10	1.85	1.61	1.39	1.18	0.99	0.80	0.63	0.47	0.50
	27	2.60	2.29	1.99	1.72	1.46	1.22	1.38	1.38	1.38	1.38
	30	2.81	2.48	2.16	1.87	1.59	1.33	1.50	1.50	1.50	1.50
	35	3.17	2.79	2.44	2.10	1.79	1.49	1.69	1.69	1.69	1.69
	40	3.50	3.09	2.69	2.32	1.97	2.12	2.12	2.12	2.12	2.12
	43	3.70	3.26	2.85	2.46	2.09	2.25	2.25	2.25	2.25	2.25

COP		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	5.32	5.43	5.53	5.63	5.66	5.66	5.57	5.34	4.73	4.06
	27	4.12	4.21	4.29	4.35	4.40	4.40	3.98	3.98	3.98	3.98
	30	3.73	3.81	3.89	3.93	3.97	3.96	3.61	3.61	3.61	3.61
	35	3.21	3.28	3.33	3.38	3.41	3.41	3.09	3.09	3.09	3.09
	40	2.68	2.73	2.79	2.83	2.86	2.60	2.60	2.60	2.60	2.60
	43	2.41	2.47	2.51	2.54	2.56	2.34	2.34	2.34	2.34	2.34

* Cooling capacity and power input at 100% load are shown at maximum compressor operating frequency

* Power input does not include water pump power.

* Cooling capacity and power input at 100% load are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C)

LWT : Leaving water temperature (°C)

Specifications part load cooling capacity and input LWT(°C) = 13°C

Outdoor unit HWS-1105H8-E, HWS-1105H8R-E

Hydro unit HWS-1405XWH**-E

Capacity (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	12.75	11.47	10.19	8.92	7.65	6.38	5.10	3.82	3.29	3.29
	27	12.24	11.01	9.79	8.57	7.34	6.56	6.56	6.56	6.56	6.56
	30	12.02	10.82	9.61	8.42	7.21	6.45	6.45	6.45	6.45	6.45
	35	11.66	10.49	9.33	8.16	6.99	6.25	6.25	6.25	6.25	6.25
	40	10.78	9.70	8.62	7.54	6.47	6.45	6.45	6.45	6.45	6.45
	43	10.25	9.23	8.20	7.17	6.15	6.13	6.13	6.13	6.13	6.13

Power input (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	2.12	1.87	1.65	1.44	1.23	1.02	0.83	0.62	0.56	0.56
	27	2.65	2.33	2.07	1.80	1.54	1.44	1.44	1.44	1.44	1.44
	30	2.87	2.52	2.25	1.96	1.67	1.57	1.57	1.57	1.57	1.57
	35	3.25	2.86	2.54	2.21	1.89	1.77	1.77	1.77	1.77	1.77
	40	3.59	3.16	2.81	2.45	2.08	2.23	2.23	2.23	2.23	2.23
	43	3.80	3.35	2.96	2.58	2.20	2.35	2.35	2.35	2.35	2.35

COP		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	6.02	6.15	6.16	6.19	6.22	6.26	6.16	6.22	5.84	5.84
	27	4.62	4.73	4.73	4.76	4.77	4.54	4.54	4.54	4.54	4.54
	30	4.18	4.29	4.28	4.30	4.33	4.11	4.11	4.11	4.11	4.11
	35	3.58	3.66	3.67	3.69	3.70	3.52	3.52	3.52	3.52	3.52
	40	3.00	3.07	3.07	3.08	3.11	2.89	2.89	2.89	2.89	2.89
	43	2.70	2.76	2.77	2.78	2.79	2.61	2.61	2.61	2.61	2.61

* Cooling capacity and power input at 100% load are shown at maximum compressor operating frequency

* Power input does not include water pump power.

* Cooling capacity and power input at 100% load are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C)

LWT : Leaving water temperature (°C)

Specifications part load cooling capacity and input LWT(°C) = 18°C

Outdoor unit HWS-1105H8-E, HWS-1105H8R-E

Hydro unit HWS-1405XWH**-E

Capacity (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	14.34	12.91	11.47	10.04	8.61	7.18	5.73	4.96	4.96	4.96
	27	13.78	12.41	11.03	9.65	8.27	8.14	8.14	8.14	8.14	8.14
	30	13.55	12.20	10.84	9.48	8.12	8.00	8.00	8.00	8.00	8.00
	35	13.15	11.83	10.52	9.20	7.89	7.77	7.77	7.77	7.77	7.77
	40	12.01	10.81	9.62	8.41	7.76	7.76	7.76	7.76	7.76	7.76
	43	11.33	10.20	9.07	7.94	7.31	7.31	7.31	7.31	7.31	7.31

Power input (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	2.14	1.92	1.70	1.47	1.24	1.08	0.85	0.55	0.55	0.55
	27	2.70	2.30	2.04	1.76	1.48	1.41	1.41	1.41	1.41	1.41
	30	2.94	2.51	2.23	1.92	1.62	1.54	1.54	1.54	1.54	1.54
	35	3.34	2.85	2.53	2.18	1.84	1.74	1.74	1.74	1.74	1.74
	40	3.67	3.13	2.78	2.40	2.18	2.18	2.18	2.18	2.18	2.18
	43	3.87	3.30	2.94	2.53	2.30	2.30	2.30	2.30	2.30	2.30

COP		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	6.70	6.72	6.75	6.83	6.94	6.64	6.75	9.01	9.01	9.01
	27	5.11	5.39	5.40	5.48	5.57	5.79	5.79	5.79	5.79	5.79
	30	4.61	4.86	4.86	4.95	5.02	5.20	5.20	5.20	5.20	5.20
	35	3.94	4.15	4.16	4.22	4.29	4.47	4.47	4.47	4.47	4.47
	40	3.27	3.45	3.46	3.50	3.56	3.56	3.56	3.56	3.56	3.56
	43	2.93	3.09	3.08	3.14	3.19	3.19	3.19	3.19	3.19	3.19

* Cooling capacity and power input at 100% load are shown at maximum compressor operating frequency

* Power input does not include water pump power.

* Cooling capacity and power input at 100% load are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C)

LWT : Leaving water temperature (°C)

Specifications Low noise operation 40.2Hz

Outdoor unit HWS-1105H8-E, HWS-1105H8R-E
Hydro unit HWS-1405XWH**-E

Capacity (kW)		LWT (°C)		
		7	13	18
TO (°C)	20	8.32	10.02	11.62
	27	7.97	9.62	11.17
	30	7.82	9.44	10.98
	35	7.58	9.16	10.65
	40	7.01	8.47	9.73
	43	6.67	8.06	9.18

Power input (kW)		LWT (°C)		
		7	13	18
TO (°C)	20	1.49	1.53	1.52
	27	1.85	1.92	1.83
	30	2.00	2.09	1.99
	35	2.25	2.36	2.27
	40	2.49	2.61	2.49
	43	2.64	2.75	2.62

COP		LWT (°C)		
		7	13	18
TO (°C)	20	5.59	6.54	7.64
	27	4.32	5.02	6.10
	30	3.91	4.53	5.52
	35	3.37	3.88	4.70
	40	2.81	3.25	3.91
	43	2.53	2.93	3.50

* Cooling capacity and power input at 100% load are shown at maximum compressor operating frequency

* Power input does not include water pump power.

TO : Outdoor temperature (DB°C)

LWT : Leaving water temperature (°C)

Specifications part load heating capacity and input LWT(°C) = 35°C

Outdoor unit HWS-1405H8-E, HWS-1405H8R-E
Hydro unit HWS-1405XWH**-E

Capacity (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-20	5.59	5.03	4.47	3.91	3.35	2.80	2.63	2.63	2.63	2.63
	-15	7.30	6.57	5.84	5.11	4.38	3.66	3.44	3.44	3.44	3.44
	-7	8.64	7.78	6.91	6.05	5.18	4.32	4.06	4.06	4.06	4.06
	-2	9.81	8.83	7.85	6.87	5.88	4.91	4.62	4.62	4.62	4.62
	2	11.01	9.91	8.81	7.71	6.61	5.51	4.62	4.62	4.62	4.62
	7	13.45	12.11	10.76	9.41	8.07	6.73	5.38	4.04	2.69	2.48
	10	17.14	15.42	13.70	12.00	10.28	8.57	6.85	5.14	3.43	3.16
	12	17.86	16.08	14.29	12.50	10.71	8.93	7.15	5.36	3.57	3.29
	15	18.86	16.98	15.08	13.20	11.32	9.43	7.54	5.66	3.78	3.47
20	20.90	18.81	16.72	14.63	12.54	10.45	8.36	6.27	4.18	3.85	

Power input (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-20	2.51	2.24	1.97	1.70	1.43	1.17	1.08	1.08	1.08	1.08
	-15	2.80	2.50	2.20	1.90	1.60	1.30	1.21	1.21	1.21	1.21
	-7	3.14	2.80	2.46	2.13	1.79	1.45	1.35	1.35	1.35	1.35
	-2	3.09	2.75	2.43	2.10	1.76	1.44	1.34	1.34	1.34	1.34
	2	3.21	2.86	2.52	2.17	1.83	1.49	1.20	1.20	1.20	1.20
	7	3.37	3.01	2.64	2.29	1.92	1.56	1.21	0.84	0.48	0.46
	10	3.54	3.16	2.78	2.40	2.02	1.64	1.26	0.89	0.51	0.49
	12	3.54	3.16	2.78	2.40	2.02	1.64	1.26	0.89	0.50	0.49
	15	3.55	3.17	2.79	2.41	2.02	1.65	1.27	0.89	0.51	0.49
20	3.58	3.20	2.82	2.43	2.05	1.66	1.28	0.90	0.51	0.49	

COP		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-20	2.23	2.24	2.27	2.30	2.33	2.40	2.43	2.43	2.43	2.43
	-15	2.60	2.63	2.65	2.69	2.73	2.81	2.84	2.84	2.84	2.84
	-7	2.76	2.78	2.81	2.84	2.89	2.98	3.01	3.01	3.01	3.01
	-2	3.18	3.21	3.23	3.28	3.34	3.42	3.46	3.46	3.46	3.46
	2	3.44	3.46	3.49	3.55	3.61	3.70	3.85	3.85	3.85	3.85
	7	3.99	4.02	4.07	4.12	4.20	4.30	4.46	4.81	5.57	5.34
	10	4.84	4.87	4.93	5.00	5.08	5.23	5.43	5.80	6.75	6.44
	12	5.05	5.09	5.14	5.22	5.31	5.44	5.65	6.05	7.14	6.71
	15	5.31	5.35	5.41	5.48	5.59	5.72	5.93	6.39	7.42	7.09
20	5.83	5.89	5.93	6.02	6.13	6.30	6.52	7.00	8.21	7.86	

- * Heating capacity and power input are shown peak value during operation
- * Heating capacity and power input at 100% load are shown at maximum compressor operating frequency
- * Power input does not include water pump power.
- * Heating capacity and power input at 100% load are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C)
LWT : Leaving water temperature (°C)

Specifications part load heating capacity and input LWT(°C) = 45°C

Outdoor unit HWS-1405H8-E, HWS-1405H8R-E
 Hydro unit HWS-1405XWH**-E

Capacity (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-20	5.36	4.82	4.29	3.75	3.22	2.68	2.41	2.41	2.41	2.41
	-15	7.00	6.30	5.60	4.90	4.20	3.50	3.15	3.15	3.15	3.15
	-7	8.27	7.45	6.61	5.79	4.96	4.14	3.73	3.73	3.73	3.73
	-2	9.36	8.42	7.48	6.55	5.62	4.68	4.22	4.22	4.22	4.22
	2	10.31	9.28	8.25	7.22	6.19	5.16	4.08	4.08	4.08	4.08
	7	14.30	12.87	11.44	10.01	8.57	7.15	5.66	5.66	5.66	5.66
	10	16.35	14.71	13.08	11.44	9.81	8.17	6.47	6.47	6.47	6.47
	12	17.14	15.43	13.71	12.00	10.28	8.57	6.78	6.78	6.78	6.78
	15	17.77	15.99	14.21	12.44	10.66	8.88	7.03	7.03	7.03	7.03
	20	19.83	17.85	15.87	13.88	11.90	9.92	7.85	7.85	7.85	7.85

Power input (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-20	3.11	2.77	2.43	2.11	1.77	1.44	1.29	1.29	1.29	1.29
	-15	3.49	3.12	2.75	2.37	1.99	1.62	1.45	1.45	1.45	1.45
	-7	3.93	3.51	3.08	2.66	2.24	1.82	1.63	1.63	1.63	1.63
	-2	3.88	3.46	3.05	2.63	2.21	1.80	1.61	1.61	1.61	1.61
	2	3.89	3.47	3.06	2.63	2.22	1.80	1.38	1.38	1.38	1.38
	7	4.18	3.73	3.28	2.84	2.38	1.94	1.48	1.48	1.48	1.48
	10	4.27	3.81	3.35	2.90	2.44	1.98	1.52	1.52	1.52	1.52
	12	4.29	3.83	3.37	2.91	2.45	1.99	1.53	1.53	1.53	1.53
	15	4.31	3.84	3.38	2.92	2.46	1.99	1.53	1.53	1.53	1.53
	20	4.36	3.90	3.43	2.95	2.49	2.02	1.55	1.55	1.55	1.55

COP		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-20	1.73	1.74	1.76	1.78	1.81	1.87	1.87	1.87	1.87	1.87
	-15	2.00	2.02	2.04	2.06	2.11	2.17	2.18	2.18	2.18	2.18
	-7	2.11	2.12	2.14	2.17	2.21	2.27	2.29	2.29	2.29	2.29
	-2	2.41	2.44	2.45	2.49	2.54	2.60	2.61	2.61	2.61	2.61
	2	2.65	2.67	2.70	2.74	2.79	2.86	2.96	2.96	2.96	2.96
	7	3.42	3.45	3.49	3.53	3.60	3.69	3.81	3.81	3.81	3.81
	10	3.83	3.86	3.91	3.95	4.02	4.14	4.27	4.27	4.27	4.27
	12	3.99	4.03	4.07	4.13	4.20	4.31	4.44	4.44	4.44	4.44
	15	4.13	4.17	4.20	4.27	4.34	4.46	4.59	4.59	4.59	4.59
	20	4.55	4.58	4.63	4.70	4.79	4.91	5.06	5.06	5.06	5.06

- * Heating capacity and power input are shown peak value during operation
- * Heating capacity and power input at 100% load are shown at maximum compressor operating frequency
- * Power input does not include water pump power.
- * Heating capacity and power input at 100% load are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C)
 LWT : Leaving water temperature (°C)

Specifications part load heating capacity and input LWT(°C) = 55°C

Outdoor unit HWS-1405H8-E, HWS-1405H8R-E
 Hydro unit HWS-1405XWH**-E

Capacity (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-20	—	—	—	—	—	—	—	—	—	—
	-15	—	—	—	—	—	—	—	—	—	—
	-7	—	—	—	—	—	—	—	—	—	—
	-2	8.53	7.68	6.83	5.97	5.12	4.27	3.90	3.90	3.90	3.90
	2	9.30	8.38	7.44	6.52	5.58	4.65	4.25	4.25	4.25	4.25
	7	13.64	12.28	10.91	9.55	8.19	6.83	5.45	5.40	5.40	5.40
	10	15.04	13.54	12.03	10.53	9.02	7.53	6.02	5.95	5.95	5.95
	12	15.81	14.24	12.65	11.07	9.48	7.91	6.33	6.26	6.26	6.26
	15	17.21	15.49	13.77	12.05	10.33	8.61	6.88	6.81	6.81	6.81
	20	18.75	16.87	15.00	13.13	11.25	9.38	7.50	7.41	7.41	7.41

Power input (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-20	—	—	—	—	—	—	—	—	—	—
	-15	—	—	—	—	—	—	—	—	—	—
	-7	—	—	—	—	—	—	—	—	—	—
	-2	4.49	3.95	3.53	3.11	2.68	2.26	2.01	2.01	2.01	2.01
	2	4.45	3.91	3.50	3.08	2.66	2.24	1.98	1.98	1.98	1.98
	7	4.86	4.27	3.82	3.36	2.90	2.44	1.99	1.88	1.88	1.88
	10	4.93	4.33	3.87	3.41	2.95	2.48	2.02	1.92	1.92	1.92
	12	4.98	4.38	3.91	3.44	2.98	2.51	2.04	1.93	1.93	1.93
	15	5.09	4.48	4.00	3.52	3.05	2.56	2.09	1.97	1.97	1.97
	20	5.18	4.55	4.07	3.58	3.09	2.61	2.13	2.01	2.01	2.01

COP		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-20	—	—	—	—	—	—	—	—	—	—
	-15	—	—	—	—	—	—	—	—	—	—
	-7	—	—	—	—	—	—	—	—	—	—
	-2	1.90	1.94	1.94	1.92	1.91	1.89	1.94	1.94	1.94	1.94
	2	2.09	2.14	2.13	2.11	2.10	2.07	2.14	2.14	2.14	2.14
	7	2.81	2.88	2.86	2.84	2.82	2.79	2.74	2.86	2.86	2.86
	10	3.05	3.12	3.11	3.09	3.06	3.03	2.97	3.10	3.10	3.10
	12	3.17	3.25	3.23	3.22	3.18	3.15	3.10	3.24	3.24	3.24
	15	3.38	3.46	3.44	3.43	3.39	3.36	3.30	3.45	3.45	3.45
	20	3.62	3.71	3.69	3.66	3.64	3.60	3.53	3.69	3.69	3.69

* Heating capacity and power input are shown peak value during operation
 * Heating capacity and power input at 100% load are shown at maximum compressor operating frequency
 * Power input does not include water pump power.
 * Heating capacity and power input at 100% load are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C)
 LWT : Leaving water temperature (°C)



Specifications Low noise operation 40.2Hz

Outdoor unit HWS-1405H8-E, HWS-1405H8R-E
Hydro unit HWS-1405XWH**-E

Capacity (kW)		LWT (°C)		
		35	45	55
TO (°C)	-20	3.28	3.40	—
	-15	4.28	4.44	—
	-7	5.08	5.26	—
	-2	5.76	5.94	6.15
	2	6.47	6.55	6.70
	7	7.89	9.08	9.82
	10	10.06	10.38	10.83
	12	10.49	10.88	11.39
	15	11.07	11.28	12.40
20	12.26	12.60	13.50	

Power input (kW)		LWT (°C)		
		35	45	55
TO (°C)	-20	1.42	1.92	—
	-15	1.59	2.17	—
	-7	1.77	2.43	—
	-2	1.74	2.41	3.20
	2	1.80	2.41	3.18
	7	1.90	2.59	3.47
	10	2.00	2.64	3.53
	12	2.00	2.66	3.56
	15	2.01	2.67	3.63
20	2.02	2.71	3.70	

COP		LWT (°C)		
		35	45	55
TO (°C)	-20	2.31	1.77	—
	-15	2.70	2.05	—
	-7	2.87	2.16	—
	-2	3.30	2.47	1.92
	2	3.58	2.72	2.11
	7	4.15	3.51	2.83
	10	5.04	3.93	3.07
	12	5.25	4.09	3.20
	15	5.52	4.23	3.41
20	6.08	4.66	3.65	

* Heating capacity and power input are shown peak value during operation

* Heating capacity and power input at 100% load are shown at maximum compressor operating frequency

* Power input does not include water pump power.

TO : Outdoor temperature (DB°C)

LWT : Leaving water temperature (°C)

Specifications part load cooling capacity and input LWT(°C) = 7°C

Outdoor unit HWS-1405H8-E, HWS-1405H8R-E

Hydro unit HWS-1405XWH**-E

Capacity (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	13.27	11.94	10.62	9.29	7.96	6.64	5.31	3.98	2.65	1.33
	27	12.69	11.42	10.15	8.88	7.61	6.34	5.08	4.53	4.53	4.53
	30	12.44	11.20	9.96	8.70	7.46	6.22	4.98	4.45	4.45	4.45
	35	12.02	10.82	9.61	8.41	7.21	6.02	4.81	4.30	4.30	4.30
	40	11.27	10.14	9.01	7.88	6.76	5.64	4.77	4.77	4.77	4.77
	43	10.82	9.74	8.65	7.57	6.49	5.41	4.58	4.58	4.58	4.58

Power input (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	2.82	2.47	2.14	1.83	1.54	1.25	0.99	0.76	0.53	0.32
	27	3.43	3.00	2.60	2.22	1.86	1.52	1.20	1.20	1.20	1.20
	30	3.70	3.24	2.80	2.39	2.00	1.64	1.30	1.29	1.29	1.29
	35	4.13	3.62	3.13	2.67	2.24	1.83	1.45	1.44	1.44	1.44
	40	4.58	4.01	3.47	2.96	2.48	2.03	1.89	1.89	1.89	1.89
	43	4.84	4.25	3.68	3.14	2.63	2.15	2.01	2.01	2.01	2.01

COP		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	4.70	4.83	4.96	5.07	5.18	5.29	5.34	5.26	4.99	4.16
	27	3.69	3.81	3.90	4.01	4.08	4.17	4.22	3.77	3.77	3.77
	30	3.37	3.46	3.56	3.64	3.72	3.79	3.82	3.44	3.44	3.44
	35	2.91	2.99	3.07	3.15	3.22	3.29	3.32	2.99	2.99	2.99
	40	2.46	2.53	2.60	2.66	2.73	2.78	2.52	2.52	2.52	2.52
	43	2.23	2.29	2.35	2.41	2.46	2.52	2.29	2.29	2.29	2.29

* Cooling capacity and power input at 100% load are shown at maximum compressor operating frequency

* Power input does not include water pump power.

* Cooling capacity and power input at 100% load are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C)

LWT : Leaving water temperature (°C)

Specifications part load cooling capacity and input LWT(°C) = 13°C

Outdoor unit HWS-1405H8-E, HWS-1405H8R-E

Hydro unit HWS-1405XWH**-E

Capacity (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	15.10	13.59	12.08	10.57	9.06	7.55	6.04	4.53	3.02	2.51
	27	14.46	13.01	11.56	10.12	8.67	7.23	6.03	6.03	6.03	6.03
	30	14.19	12.77	11.35	9.93	8.51	7.10	5.91	5.91	5.91	5.91
	35	13.73	12.36	10.98	9.61	8.24	6.87	5.72	5.72	5.72	5.72
	40	12.87	11.59	10.30	9.02	7.72	6.44	6.08	6.08	6.08	6.08
	43	12.36	11.12	9.88	8.65	7.41	6.18	5.83	5.83	5.83	5.83

Power input (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	2.82	2.48	2.20	1.92	1.64	1.35	1.10	0.82	0.53	0.39
	27	3.49	3.07	2.73	2.37	2.03	1.68	1.06	1.06	1.06	1.06
	30	3.78	3.32	2.95	2.58	2.20	1.82	1.14	1.14	1.14	1.14
	35	4.26	3.75	3.33	2.90	2.47	2.05	1.29	1.29	1.29	1.29
	40	4.72	4.16	3.68	3.21	2.74	2.26	1.31	1.31	1.31	1.31
	43	5.00	4.40	3.90	3.39	2.90	2.40	1.38	1.38	1.38	1.38

COP		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	5.35	5.48	5.50	5.50	5.53	5.58	5.47	5.53	5.64	6.50
	27	4.14	4.23	4.24	4.26	4.28	4.30	5.70	5.70	5.70	5.70
	30	3.75	3.84	3.85	3.85	3.87	3.90	5.20	5.20	5.20	5.20
	35	3.22	3.30	3.30	3.31	3.34	3.35	4.44	4.44	4.44	4.44
	40	2.73	2.79	2.80	2.81	2.82	2.85	4.63	4.63	4.63	4.63
	43	2.47	2.53	2.54	2.55	2.55	2.58	4.22	4.22	4.22	4.22

* Cooling capacity and power input at 100% load are shown at maximum compressor operating frequency

* Power input does not include water pump power.

* Cooling capacity and power input at 100% load are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C)

LWT : Leaving water temperature (°C)

Specifications part load cooling capacity and input LWT(°C) = 18°C

Outdoor unit HWS-1405H8-E, HWS-1405H8R-E
 Hydro unit HWS-1405XWH**-E

Capacity (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	16.92	15.23	13.53	11.84	10.15	8.47	6.77	5.08	4.47	4.47
	27	16.23	14.61	12.99	11.36	9.74	8.12	7.87	7.87	7.87	7.87
	30	15.93	14.35	12.75	11.16	9.56	7.97	7.72	7.72	7.72	7.72
	35	15.44	13.89	12.36	10.81	9.26	7.73	7.48	7.48	7.48	7.48
	40	14.18	12.77	11.34	9.93	8.51	7.57	7.57	7.57	7.57	7.57
	43	13.43	12.09	10.74	9.40	8.05	7.17	7.17	7.17	7.17	7.17

Power input (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	2.82	2.61	2.31	1.98	1.69	1.39	1.10	0.80	0.55	0.55
	27	3.55	3.13	2.77	2.38	2.02	1.67	1.19	1.19	1.19	1.19
	30	3.87	3.40	3.01	2.59	2.20	1.82	1.29	1.29	1.29	1.29
	35	4.39	3.86	3.43	2.95	2.50	2.07	1.47	1.47	1.47	1.47
	40	4.80	4.22	3.74	3.21	2.74	1.80	1.80	1.80	1.80	1.80
	43	5.04	4.44	3.94	3.37	2.88	1.89	1.89	1.89	1.89	1.89

COP		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	6.00	5.83	5.85	5.98	6.00	6.07	6.18	6.38	8.07	8.07
	27	4.57	4.67	4.68	4.78	4.81	4.86	6.62	6.62	6.62	6.62
	30	4.12	4.22	4.23	4.31	4.34	4.37	5.99	5.99	5.99	5.99
	35	3.52	3.60	3.60	3.67	3.70	3.74	5.10	5.10	5.10	5.10
	40	2.96	3.03	3.03	3.09	3.11	4.21	4.21	4.21	4.21	4.21
	43	2.67	2.72	2.73	2.79	2.80	3.79	3.79	3.79	3.79	3.79

* Cooling capacity and power input at 100% load are shown at maximum compressor operating frequency

* Power input does not include water pump power.

* Cooling capacity and power input at 100% load are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C)

LWT : Leaving water temperature (°C)

Specifications Low noise operation 40.2Hz

Outdoor unit HWS-1405H8-E, HWS-1405H8R-E
Hydro unit HWS-1405XWH**-E

Capacity (kW)		LWT (°C)		
		7	13	18
TO (°C)	20	8.82	10.92	12.60
	27	8.43	10.45	12.09
	30	8.27	10.26	11.87
	35	8.00	9.93	11.50
	40	7.49	9.30	10.56
	43	7.20	8.93	10.01

Power input (kW)		LWT (°C)		
		7	13	18
TO (°C)	20	1.77	1.81	1.91
	27	2.15	2.24	2.29
	30	2.31	2.42	2.49
	35	2.58	2.73	2.83
	40	2.87	3.02	3.09
	43	3.04	3.21	3.25

COP		LWT (°C)		
		7	13	18
TO (°C)	20	4.97	6.03	6.58
	27	3.92	4.66	5.28
	30	3.58	4.24	4.77
	35	3.10	3.64	4.06
	40	2.61	3.08	3.42
	43	2.36	2.79	3.08

* Cooling capacity and power input at 100% load are shown at maximum compressor operating frequency

* Power input does not include water pump power.

* Cooling capacity and power input at 100% load are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C)

LWT : Leaving water temperature (°C)

Specifications part load heating capacity and input LWT(°C) = 35°C

Outdoor unit HWS-1605H8-E, HWS-1605H8R-E
 Hydro unit HWS-1405XWH**-E

Capacity (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-20	5.85	5.27	4.68	4.10	3.51	2.93	2.63	2.63	2.63	2.63
	-15	7.65	6.88	6.12	5.35	4.59	3.83	3.43	3.43	3.43	3.43
	-7	9.05	8.15	7.24	6.34	5.43	4.53	4.05	4.05	4.05	4.05
	-2	10.28	9.26	8.22	7.20	6.17	5.14	4.60	4.60	4.60	4.60
	2	11.61	10.45	9.29	8.13	6.97	5.81	4.64	4.62	4.62	4.62
	7	14.30	12.87	11.44	10.01	8.58	7.15	5.72	4.29	2.86	2.52
	10	17.92	16.13	14.33	12.55	10.76	8.96	7.17	5.37	3.59	3.15
	12	18.68	16.82	14.94	13.08	11.21	9.34	7.47	5.61	3.74	3.29
	15	19.82	17.84	15.86	13.88	11.90	9.92	7.93	5.94	3.96	3.49
	20	22.08	19.87	17.66	15.46	13.25	11.04	8.83	6.62	4.42	3.89

Power input (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-20	2.72	2.43	2.13	1.84	1.55	1.26	1.09	1.09	1.09	1.09
	-15	3.03	2.71	2.38	2.06	1.73	1.41	1.23	1.23	1.23	1.23
	-7	3.39	3.03	2.66	2.30	1.93	1.57	1.37	1.37	1.37	1.37
	-2	3.34	2.99	2.62	2.26	1.91	1.55	1.35	1.35	1.35	1.35
	2	3.46	3.08	2.72	2.35	1.97	1.60	1.24	1.22	1.22	1.22
	7	3.65	3.26	2.86	2.48	2.08	1.69	1.30	0.95	0.62	0.54
	10	3.89	3.47	3.05	2.64	2.22	1.80	1.38	1.01	0.66	0.58
	12	3.88	3.47	3.04	2.63	2.22	1.80	1.38	1.01	0.66	0.58
	15	3.90	3.47	3.06	2.64	2.23	1.80	1.39	1.02	0.66	0.58
	20	3.93	3.51	3.08	2.66	2.24	1.83	1.40	1.02	0.67	0.59

COP		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-20	2.15	2.17	2.20	2.23	2.26	2.33	2.40	2.40	2.40	2.40
	-15	2.52	2.54	2.57	2.60	2.65	2.72	2.79	2.79	2.79	2.79
	-7	2.67	2.69	2.72	2.76	2.81	2.88	2.95	2.95	2.95	2.95
	-2	3.08	3.10	3.14	3.18	3.23	3.31	3.41	3.41	3.41	3.41
	2	3.36	3.39	3.42	3.47	3.53	3.63	3.76	3.80	3.80	3.80
	7	3.92	3.95	3.99	4.04	4.13	4.23	4.41	4.54	4.61	4.66
	10	4.61	4.64	4.70	4.76	4.85	4.97	5.19	5.33	5.42	5.48
	12	4.81	4.85	4.91	4.97	5.05	5.20	5.40	5.56	5.64	5.71
	15	5.09	5.14	5.18	5.26	5.34	5.50	5.70	5.84	5.99	6.06
	20	5.62	5.67	5.73	5.81	5.92	6.05	6.30	6.50	6.57	6.64

* Heating capacity and power input are shown peak value during operation

* Heating capacity and power input at 100% load are shown at maximum compressor operating frequency

* Power input does not include water pump power.

* Heating capacity and power input at 100% load are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C)

LWT : Leaving water temperature (°C)

Specifications part load heating capacity and input LWT(°C) = 45°C

Outdoor unit HWS-1605H8-E, HWS-1605H8R-E
Hydro unit HWS-1405XWH**-E

Capacity (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-20	5.58	5.02	4.46	3.91	3.35	2.79	2.46	2.46	2.46	2.46
	-15	7.28	6.55	5.82	5.10	4.37	3.64	3.21	3.21	3.21	3.21
	-7	8.61	7.75	6.89	6.02	5.16	4.30	3.79	3.79	3.79	3.79
	-2	9.74	8.76	7.79	6.81	5.85	4.87	4.29	4.29	4.29	4.29
	2	10.76	9.68	8.61	7.53	6.45	5.38	4.30	4.08	4.08	4.08
	7	14.95	13.46	11.96	10.47	8.98	7.48	5.98	5.68	5.68	5.68
	10	17.01	15.31	13.61	11.91	10.20	8.51	6.81	6.46	6.46	6.46
	12	17.78	16.00	14.22	12.44	10.67	8.89	7.11	6.75	6.75	6.75
	15	18.78	16.90	15.03	13.15	11.27	9.40	7.52	7.14	7.14	7.14
	20	21.01	18.91	16.81	14.70	12.60	10.50	8.40	7.98	7.98	7.98

Power input (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-20	3.32	2.95	2.59	2.22	1.86	1.49	1.31	1.31	1.31	1.31
	-15	3.73	3.32	2.91	2.50	2.08	1.67	1.47	1.47	1.47	1.47
	-7	4.20	3.74	3.27	2.81	2.34	1.88	1.66	1.66	1.66	1.66
	-2	4.15	3.69	3.23	2.77	2.32	1.86	1.64	1.64	1.64	1.64
	2	4.16	3.70	3.24	2.78	2.32	1.86	1.40	1.35	1.35	1.35
	7	4.50	4.00	3.51	3.01	2.51	2.01	1.52	1.47	1.47	1.47
	10	4.62	4.11	3.59	3.08	2.58	2.07	1.56	1.50	1.50	1.50
	12	4.64	4.13	3.62	3.11	2.59	2.08	1.57	1.51	1.51	1.51
	15	4.70	4.17	3.66	3.14	2.63	2.11	1.58	1.54	1.54	1.54
	20	4.76	4.24	3.71	3.18	2.65	2.13	1.61	1.55	1.55	1.55

COP		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-20	1.68	1.70	1.72	1.76	1.80	1.87	1.87	1.87	1.87	1.87
	-15	1.95	1.97	2.00	2.04	2.10	2.18	2.18	2.18	2.18	2.18
	-7	2.05	2.07	2.11	2.14	2.20	2.29	2.29	2.29	2.29	2.29
	-2	2.35	2.38	2.41	2.46	2.52	2.61	2.62	2.62	2.62	2.62
	2	2.59	2.61	2.66	2.71	2.78	2.89	3.07	3.02	3.02	3.02
	7	3.32	3.37	3.41	3.48	3.57	3.72	3.93	3.88	3.88	3.88
	10	3.69	3.73	3.79	3.86	3.95	4.11	4.36	4.30	4.30	4.30
	12	3.83	3.88	3.93	4.01	4.11	4.27	4.52	4.46	4.46	4.46
	15	4.00	4.05	4.10	4.19	4.29	4.46	4.74	4.65	4.65	4.65
	20	4.42	4.46	4.53	4.62	4.75	4.92	5.21	5.13	5.13	5.13

* Heating capacity and power input are shown peak value during operation

* Heating capacity and power input at 100% load are shown at maximum compressor operating frequency

* Power input does not include water pump power.

* Heating capacity and power input at 100% load are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C)

LWT : Leaving water temperature (°C)

Specifications part load heating capacity and input LWT(°C) = 55°C

Outdoor unit HWS-1605H8-E, HWS-1605H8R-E
 Hydro unit HWS-1405XWH**-E

Capacity (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-20	—	—	—	—	—	—	—	—	—	—
	-15	—	—	—	—	—	—	—	—	—	—
	-7	—	—	—	—	—	—	—	—	—	—
	-2	8.85	7.97	7.08	6.20	5.31	4.43	3.87	3.87	3.87	3.87
	2	9.65	8.68	7.72	6.76	5.79	4.83	4.22	4.22	4.22	4.22
	7	14.12	12.71	11.29	9.88	8.47	7.06	5.65	5.35	5.35	5.35
	10	15.57	14.01	12.46	10.89	9.34	7.78	6.23	5.90	5.90	5.90
	12	16.53	14.88	13.23	11.57	9.92	8.27	6.61	6.27	6.27	6.27
	15	17.23	15.51	13.78	12.06	10.34	8.62	6.89	6.53	6.53	6.53
	20	19.13	17.22	15.30	13.39	11.48	9.56	7.65	7.25	7.25	7.25

Power input (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-20	—	—	—	—	—	—	—	—	—	—
	-15	—	—	—	—	—	—	—	—	—	—
	-7	—	—	—	—	—	—	—	—	—	—
	-2	4.78	4.19	3.75	3.30	2.85	2.40	1.99	1.99	1.99	1.99
	2	4.74	4.16	3.72	3.27	2.82	2.38	1.97	1.97	1.97	1.97
	7	5.22	4.59	4.10	3.61	3.12	2.63	2.13	1.88	1.88	1.88
	10	5.30	4.66	4.16	3.66	3.17	2.67	2.16	1.91	1.91	1.91
	12	5.35	4.70	4.20	3.70	3.19	2.69	2.19	1.93	1.93	1.93
	15	5.46	4.80	4.29	3.77	3.26	2.74	2.23	1.96	1.96	1.96
	20	5.55	4.88	4.36	3.83	3.31	2.79	2.27	2.00	2.00	2.00

COP		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-20	—	—	—	—	—	—	—	—	—	—
	-15	—	—	—	—	—	—	—	—	—	—
	-7	—	—	—	—	—	—	—	—	—	—
	-2	1.85	1.90	1.89	1.88	1.87	1.84	1.95	1.95	1.95	1.95
	2	2.04	2.09	2.08	2.06	2.05	2.03	2.14	2.14	2.14	2.14
	7	2.70	2.77	2.76	2.74	2.72	2.69	2.65	2.84	2.84	2.84
	10	2.94	3.01	3.00	2.98	2.95	2.92	2.88	3.08	3.08	3.08
	12	3.09	3.16	3.15	3.13	3.11	3.07	3.01	3.24	3.24	3.24
	15	3.16	3.23	3.22	3.20	3.18	3.14	3.08	3.32	3.32	3.32
	20	3.45	3.53	3.51	3.50	3.47	3.43	3.37	3.62	3.62	3.62

* Heating capacity and power input are shown peak value during operation
 * Heating capacity and power input at 100% load are shown at maximum compressor operating frequency
 * Power input does not include water pump power.
 * Heating capacity and power input at 100% load are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C)
 LWT : Leaving water temperature (°C)

Specifications Low noise operation**40.2Hz**

Outdoor unit HWS-1605H8-E, HWS-1605H8R-E
 Hydro unit HWS-1405XWH**-E

Capacity (kW)		LWT (°C)		
		35	45	55
TO (°C)	-20	3.43	3.54	—
	-15	4.49	4.63	—
	-7	5.31	5.47	—
	-2	6.03	6.18	6.38
	2	6.81	6.83	6.95
	7	8.40	9.50	10.17
	10	10.52	10.80	11.20
	12	10.96	11.29	11.91
	15	11.63	11.93	12.41
	20	12.96	13.34	13.78

Power input (kW)		LWT (°C)		
		35	45	55
TO (°C)	-20	1.53	2.05	—
	-15	1.71	2.31	—
	-7	1.92	2.60	—
	-2	1.88	2.56	3.41
	2	1.95	2.57	3.38
	7	2.05	2.79	3.73
	10	2.19	2.86	3.78
	12	2.19	2.87	3.83
	15	2.20	2.91	3.90
	20	2.22	2.94	3.96

COP		LWT (°C)		
		35	45	55
TO (°C)	-20	2.25	1.73	—
	-15	2.62	2.01	—
	-7	2.77	2.11	—
	-2	3.20	2.41	1.87
	2	3.50	2.65	2.06
	7	4.09	3.41	2.73
	10	4.81	3.78	2.96
	12	5.01	3.93	3.11
	15	5.29	4.10	3.18
	20	5.84	4.53	3.48

* Heating capacity and power input are shown peak value during operation

* Heating capacity and power input at 100% load are shown at maximum compressor operating frequency

* Power input does not include water pump power.

TO : Outdoor temperature (DB°C)

LWT : Leaving water temperature (°C)

Specifications part load cooling capacity and input LWT(°C) = 7°C

Outdoor unit HWS-1605H8-E, HWS-1605H8R-E
 Hydro unit HWS-1405XWH**-E

Capacity (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	14.39	12.95	11.51	10.08	8.64	7.20	5.75	4.31	2.88	1.78
	27	13.67	12.30	10.93	9.57	8.20	6.83	5.47	5.19	5.19	5.19
	30	13.36	12.03	10.69	9.35	8.01	6.68	5.34	5.07	5.07	5.07
	35	12.84	11.56	10.27	8.99	7.71	6.43	5.13	4.88	4.88	4.88
	40	11.53	10.37	9.22	8.07	6.91	5.77	5.04	5.04	5.04	5.04
	43	10.72	9.65	8.58	7.51	6.44	5.37	4.69	4.69	4.69	4.69

Power input (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	3.25	2.82	2.43	2.05	1.70	1.38	1.07	0.79	0.54	0.38
	27	3.89	3.39	2.90	2.46	2.03	1.64	1.28	1.22	1.22	1.22
	30	4.17	3.62	3.11	2.63	2.18	1.76	1.38	1.31	1.31	1.31
	35	4.63	4.02	3.45	2.91	2.42	1.95	1.52	1.46	1.46	1.46
	40	4.95	4.30	3.69	3.12	2.58	2.09	1.81	1.81	1.81	1.81
	43	5.16	4.48	3.85	3.25	2.69	2.18	1.87	1.87	1.87	1.87

COP		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	4.43	4.59	4.74	4.91	5.08	5.23	5.36	5.45	5.32	4.74
	27	3.51	3.63	3.77	3.89	4.04	4.16	4.28	4.26	4.26	4.26
	30	3.20	3.32	3.44	3.56	3.68	3.80	3.88	3.89	3.89	3.89
	35	2.78	2.88	2.97	3.09	3.19	3.30	3.38	3.35	3.35	3.35
	40	2.33	2.41	2.50	2.58	2.68	2.76	2.79	2.79	2.79	2.79
	43	2.08	2.15	2.23	2.31	2.39	2.47	2.50	2.50	2.50	2.50

* Cooling capacity and power input at 100% load are shown at maximum compressor operating frequency

* Power input does not include water pump power.

* Cooling capacity and power input at 100% load are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C)

LWT : Leaving water temperature (°C)

Specifications part load cooling capacity and input LWT(°C) = 13°C

Outdoor unit HWS-1605H8-E, HWS-1605H8R-E

Hydro unit HWS-1405XWH**-E

Capacity (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	16.34	14.70	13.07	11.43	9.80	8.18	6.54	4.91	3.27	3.26
	27	15.54	13.98	12.43	10.87	9.32	7.77	6.46	6.46	6.46	6.46
	30	15.19	13.67	12.15	10.64	9.12	7.60	6.32	6.32	6.32	6.32
	35	14.62	13.15	11.69	10.23	8.77	7.31	6.08	6.08	6.08	6.08
	40	13.29	11.96	10.63	9.31	7.98	6.65	6.17	6.17	6.17	6.17
	43	12.49	11.24	9.99	8.74	7.49	6.25	5.79	5.79	5.79	5.79

Power input (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	3.27	2.88	2.52	2.19	1.83	1.51	1.18	0.85	0.56	0.46
	27	3.99	3.50	3.07	2.67	2.23	1.83	1.06	1.06	1.06	1.06
	30	4.29	3.78	3.30	2.88	2.40	1.97	1.14	1.14	1.14	1.14
	35	4.81	4.23	3.70	3.22	2.69	2.21	1.28	1.28	1.28	1.28
	40	5.15	4.53	3.96	3.46	2.89	2.37	1.61	1.61	1.61	1.61
	43	5.42	4.77	4.17	3.63	3.03	2.49	1.70	1.70	1.70	1.70

COP		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	5.00	5.10	5.18	5.21	5.34	5.43	5.56	5.79	5.86	7.11
	27	3.90	3.99	4.05	4.07	4.18	4.24	6.09	6.09	6.09	6.09
	30	3.54	3.62	3.68	3.70	3.80	3.85	5.54	5.54	5.54	5.54
	35	3.04	3.11	3.16	3.17	3.26	3.30	4.74	4.74	4.74	4.74
	40	2.58	2.64	2.68	2.69	2.76	2.80	3.82	3.82	3.82	3.82
	43	2.31	2.36	2.40	2.41	2.47	2.51	3.42	3.42	3.42	3.42

* Cooling capacity and power input at 100% load are shown at maximum compressor operating frequency

* Power input does not include water pump power.

* Cooling capacity and power input at 100% load are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C)

LWT : Leaving water temperature (°C)

Specifications part load cooling capacity and input LWT(°C) = 18°C

Outdoor unit HWS-1605H8-E, HWS-1605H8R-E
 Hydro unit HWS-1405XWH**-E

Capacity (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	18.29	16.46	14.63	12.81	10.98	9.15	7.31	5.48	4.45	4.45
	27	17.40	15.67	13.92	12.19	10.44	8.71	7.57	7.57	7.57	7.57
	30	17.02	15.32	13.62	11.92	10.21	8.52	7.41	7.41	7.41	7.41
	35	16.39	14.75	13.11	11.47	9.83	8.20	7.12	7.12	7.12	7.12
	40	14.92	13.44	11.94	10.45	8.95	7.12	7.12	7.12	7.12	7.12
	43	14.24	12.81	11.39	9.97	8.54	6.80	6.80	6.80	6.80	6.80

Power input (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	3.29	3.04	2.69	2.32	1.96	1.62	1.28	0.93	0.58	0.58
	27	4.08	3.59	3.18	2.74	2.33	1.92	1.06	1.06	1.06	1.06
	30	4.42	3.89	3.45	2.96	2.52	2.08	1.15	1.15	1.15	1.15
	35	4.98	4.38	3.88	3.34	2.84	2.35	1.30	1.30	1.30	1.30
	40	5.35	4.71	4.17	3.59	3.05	1.57	1.57	1.57	1.57	1.57
	43	5.68	5.00	4.44	3.80	3.24	1.66	1.66	1.66	1.66	1.66

COP		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	5.56	5.41	5.44	5.53	5.59	5.65	5.73	5.88	7.68	7.68
	27	4.27	4.37	4.38	4.46	4.48	4.53	7.14	7.14	7.14	7.14
	30	3.85	3.94	3.95	4.03	4.06	4.10	6.46	6.46	6.46	6.46
	35	3.29	3.37	3.38	3.43	3.46	3.49	5.49	5.49	5.49	5.49
	40	2.79	2.85	2.86	2.91	2.94	4.55	4.55	4.55	4.55	4.55
	43	2.50	2.56	2.57	2.62	2.63	4.09	4.09	4.09	4.09	4.09

* Cooling capacity and power input at 100% load are shown at maximum compressor operating frequency

* Power input does not include water pump power.

* Cooling capacity and power input at 100% load are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C)

LWT : Leaving water temperature (°C)

Specifications Low noise operation 40.2Hz

Outdoor unit HWS-1605H8-E, HWS-1605H8R-E
Hydro unit HWS-1405XWH**-E

Capacity (kW)		LWT (°C)		
		7	13	18
TO (°C)	20	9.57	11.81	13.62
	27	9.09	11.23	12.97
	30	8.88	10.98	12.68
	35	8.54	10.57	12.21
	40	7.67	9.61	11.12
	43	7.13	9.03	10.60

Power input (kW)		LWT (°C)		
		7	13	18
TO (°C)	20	2.04	2.09	2.23
	27	2.44	2.56	2.63
	30	2.61	2.76	2.85
	35	2.90	3.08	3.22
	40	3.10	3.30	3.45
	43	3.23	3.47	3.67

COP		LWT (°C)		
		7	13	18
TO (°C)	20	4.69	5.64	6.11
	27	3.73	4.39	4.93
	30	3.40	3.98	4.45
	35	2.94	3.43	3.79
	40	2.47	2.91	3.22
	43	2.20	2.60	2.89

* Cooling capacity and power input at 100% load are shown at maximum compressor operating frequency

* Power input does not include water pump power.

TO : Outdoor temperature (DB°C)

LWT : Leaving water temperature (°C)

Specifications part load heating capacity and input LWT(°C) = 35°C

Outdoor unit HWS-P805HR-E
Hydro unit HWS-P805XWH**-E

Capacity (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-25	6.18	5.56	4.94	4.33	3.71	3.09	2.15	2.15	2.15	2.24
	-20	7.77	7.00	6.22	5.44	4.66	3.89	2.70	2.70	2.70	2.82
	-15	9.37	8.43	7.50	6.56	5.62	4.68	3.25	3.25	3.25	3.40
	-7	11.92	10.73	9.54	8.34	7.15	5.96	4.14	4.14	4.14	4.32
	-2	13.74	12.36	10.99	9.62	8.24	6.87	4.77	4.77	4.77	4.98
	2	15.19	13.67	12.15	10.63	9.11	7.60	5.27	5.27	5.27	5.50
	7	16.92	15.23	13.54	11.84	10.15	8.46	6.77	5.08	3.38	2.07
	10	18.21	16.38	14.56	12.74	10.92	9.10	7.28	5.46	3.64	2.34
	12	19.06	17.16	15.25	13.34	11.44	9.53	7.62	5.72	3.81	2.52
	15	20.35	18.31	16.28	14.24	12.21	10.17	8.14	6.10	4.07	2.79
20	22.49	20.24	17.99	15.74	13.49	11.25	9.00	6.75	4.50	3.24	

Power input (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-25	3.40	2.99	2.58	2.17	1.76	1.49	0.99	0.99	0.99	1.11
	-20	3.66	3.22	2.78	2.33	1.89	1.60	1.07	1.07	1.07	1.20
	-15	3.85	3.39	2.92	2.46	2.00	1.69	1.13	1.13	1.13	1.26
	-7	4.08	3.59	3.10	2.60	2.11	1.78	1.19	1.19	1.19	1.33
	-2	4.22	3.71	3.20	2.69	2.18	1.84	1.23	1.23	1.23	1.38
	2	4.31	3.79	3.27	2.75	2.23	1.88	1.26	1.26	1.26	1.41
	7	4.25	3.68	3.11	2.54	2.19	1.85	1.50	1.15	0.80	0.53
	10	4.09	3.60	3.10	2.61	2.11	1.77	1.43	1.09	0.75	0.51
	12	4.00	3.52	3.04	2.56	2.08	1.74	1.40	1.06	0.73	0.50
	15	3.89	3.43	2.96	2.50	2.03	1.70	1.36	1.03	0.69	0.48
20	3.74	3.30	2.86	2.42	1.98	1.65	1.31	0.97	0.64	0.45	

COP		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-25	1.82	1.86	1.92	1.99	2.11	2.08	2.16	2.16	2.16	2.02
	-20	2.13	2.18	2.24	2.33	2.46	2.43	2.52	2.52	2.52	2.36
	-15	2.43	2.49	2.56	2.67	2.82	2.78	2.88	2.88	2.88	2.70
	-7	2.92	2.99	3.08	3.20	3.39	3.34	3.47	3.47	3.47	3.24
	-2	3.26	3.33	3.43	3.57	3.78	3.72	3.87	3.87	3.87	3.61
	2	3.53	3.61	3.72	3.87	4.09	4.03	4.19	4.19	4.19	3.91
	7	3.98	4.14	4.35	4.66	4.63	4.58	4.52	4.42	4.24	3.92
	10	4.45	4.56	4.70	4.89	5.17	5.14	5.08	5.00	4.84	4.59
	12	4.76	4.87	5.02	5.22	5.51	5.48	5.44	5.37	5.25	5.07
	15	5.23	5.35	5.50	5.70	6.00	5.99	5.98	5.95	5.89	5.82
20	6.01	6.13	6.29	6.50	6.81	6.83	6.87	6.93	7.06	7.21	

* Heating capacity and power input are include defrost cycle data.

* Heating capacity and power input at 100% load are shown at maximum compressor operating frequency

* Power input does not include water pump power.

* Heating capacity and power input at 100% load are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C) RH85%

LWT : Leaving water temperature (°C)

Specifications part load heating capacity and input LWT(°C) = 45°C

Outdoor unit HWS-P805HR-E
 Hydro unit HWS-P805XWH**-E

Capacity (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-25	—	—	—	—	—	—	—	—	—	—
	-20	6.72	6.05	5.38	4.71	4.03	2.73	2.73	2.73	2.73	2.96
	-15	8.04	7.24	6.44	5.63	4.83	3.42	3.42	3.42	3.42	3.54
	-7	10.16	9.14	8.13	7.11	6.10	4.52	4.52	4.52	4.52	4.48
	-2	11.56	10.41	9.25	8.09	6.94	5.07	5.07	5.07	5.07	5.10
	2	12.69	11.42	10.15	8.88	7.61	5.50	5.50	5.50	5.50	5.59
	7	14.00	12.60	11.20	9.80	8.40	7.00	5.67	5.67	5.67	5.67
	10	15.00	13.50	12.00	10.50	9.00	7.50	6.28	6.28	6.28	6.28
	12	15.66	14.10	12.53	10.96	9.40	7.83	6.69	6.69	6.69	6.69
	15	16.66	14.99	13.33	11.66	10.00	8.33	7.30	7.30	7.30	7.30
	20	18.32	16.49	14.66	12.82	10.99	9.16	8.31	8.31	8.31	8.31

Power input (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-25	—	—	—	—	—	—	—	—	—	—
	-20	3.88	3.47	3.06	2.65	2.24	1.65	1.65	1.65	1.65	1.62
	-15	4.02	3.59	3.17	2.75	2.32	1.72	1.72	1.72	1.72	1.68
	-7	4.17	3.73	3.29	2.85	2.41	1.79	1.79	1.79	1.79	1.75
	-2	4.23	3.79	3.34	2.89	2.45	1.77	1.77	1.77	1.77	1.77
	2	4.27	3.82	3.37	2.92	2.47	1.76	1.76	1.76	1.76	1.79
	7	4.20	3.75	3.30	2.85	2.39	1.98	1.59	1.59	1.59	1.59
	10	4.05	3.61	3.17	2.73	2.29	1.89	1.57	1.57	1.57	1.57
	12	3.96	3.53	3.10	2.67	2.24	1.84	1.56	1.56	1.56	1.56
	15	3.85	3.41	2.97	2.53	2.15	1.77	1.54	1.54	1.54	1.54
	20	3.70	3.27	2.84	2.41	2.04	1.68	1.51	1.51	1.51	1.51

COP		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-25	—	—	—	—	—	—	—	—	—	—
	-20	1.73	1.74	1.76	1.77	1.80	1.66	1.66	1.66	1.66	1.82
	-15	2.00	2.01	2.03	2.05	2.08	1.99	1.99	1.99	1.99	2.11
	-7	2.44	2.45	2.47	2.49	2.53	2.52	2.52	2.52	2.52	2.56
	-2	2.73	2.75	2.77	2.80	2.84	2.86	2.86	2.86	2.86	2.88
	2	2.97	2.99	3.01	3.04	3.08	3.13	3.13	3.13	3.13	3.13
	7	3.33	3.36	3.40	3.44	3.51	3.54	3.58	3.58	3.58	3.58
	10	3.71	3.74	3.78	3.84	3.92	3.96	4.01	4.01	4.01	4.01
	12	3.95	3.99	4.04	4.11	4.20	4.25	4.30	4.30	4.30	4.30
	15	4.33	4.40	4.49	4.62	4.65	4.70	4.74	4.74	4.74	4.74
	20	4.95	5.04	5.16	5.32	5.38	5.46	5.51	5.51	5.51	5.51

* Heating capacity and power input are include defrost cycle data.

* Heating capacity and power input at 100% load are shown at maximum compressor operating frequency

* Power input does not include water pump power.

* Heating capacity and power input at 100% load are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C) RH85%

LWT : Leaving water temperature (°C)

Specifications part load heating capacity and input LWT(°C) = 55°C

Outdoor unit HWS-P805HR-E
 Hydro unit HWS-P805XWH**-E

Capacity (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-25	—	—	—	—	—	—	—	—	—	—
	-20	—	—	—	—	—	—	—	—	—	—
	-15	—	—	—	—	—	—	—	—	—	—
	-7	8.40	7.56	6.72	5.88	5.04	4.09	4.09	4.09	4.09	4.18
	-2	9.39	8.45	7.51	6.57	5.63	4.48	4.48	4.48	4.48	4.67
	2	10.18	9.16	8.15	7.13	6.11	4.80	4.80	4.80	4.80	5.06
	7	11.08	9.97	8.86	7.76	6.65	5.54	5.20	5.20	5.20	5.20
	10	11.79	10.61	9.43	8.25	7.07	5.89	5.75	5.75	5.75	5.75
	12	12.26	11.03	9.81	8.58	7.36	6.13	6.11	6.11	6.11	6.11
	15	12.97	11.67	10.38	9.08	7.78	6.66	6.66	6.66	6.66	6.66
	20	14.15	12.74	11.32	9.91	8.49	7.58	7.58	7.58	7.58	7.58

Power input (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-25	—	—	—	—	—	—	—	—	—	—
	-20	—	—	—	—	—	—	—	—	—	—
	-15	—	—	—	—	—	—	—	—	—	—
	-7	4.32	3.89	3.46	3.03	2.61	2.21	2.21	2.21	2.21	2.18
	-2	4.26	3.83	3.41	2.99	2.57	2.13	2.13	2.13	2.13	2.15
	2	4.23	3.80	3.38	2.96	2.56	2.08	2.08	2.08	2.08	2.14
	7	4.13	3.72	3.31	2.90	2.50	2.10	1.97	1.97	1.97	1.97
	10	3.98	3.59	3.19	2.80	2.41	2.02	1.97	1.97	1.97	1.97
	12	3.90	3.51	3.13	2.74	2.36	1.97	1.97	1.97	1.97	1.97
	15	3.79	3.42	3.05	2.67	2.29	1.97	1.97	1.97	1.97	1.97
	20	3.65	3.30	2.95	2.58	2.20	1.96	1.96	1.96	1.96	1.96

COP		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-25	—	—	—	—	—	—	—	—	—	—
	-20	—	—	—	—	—	—	—	—	—	—
	-15	—	—	—	—	—	—	—	—	—	—
	-7	1.95	1.94	1.94	1.94	1.93	1.85	1.85	1.85	1.85	1.91
	-2	2.21	2.20	2.20	2.20	2.19	2.10	2.10	2.10	2.10	2.17
	2	2.41	2.41	2.41	2.40	2.39	2.31	2.31	2.31	2.31	2.37
	7	2.68	2.68	2.68	2.67	2.66	2.64	2.63	2.63	2.63	2.63
	10	2.96	2.96	2.95	2.95	2.94	2.92	2.92	2.92	2.92	2.92
	12	3.14	3.14	3.14	3.13	3.12	3.11	3.11	3.11	3.11	3.11
	15	3.42	3.41	3.40	3.40	3.39	3.39	3.39	3.39	3.39	3.39
	20	3.88	3.86	3.84	3.85	3.86	3.87	3.87	3.87	3.87	3.87

* Heating capacity and power input are include defrost cycle data.
 * Heating capacity and power input at 100% load are shown at maximum compressor operating frequency
 * Power input does not include water pump power.
 * Heating capacity and power input at 100% load are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C) RH85%
 LWT : Leaving water temperature (°C)



Specifications Low noise operation 40.2Hz

Outdoor unit HWS-P805HR-E
Hydro unit HWS-P805XWH**-E

Capacity (kW)		LWT (°C)		
		35	45	55
TO (°C)	-25	3.38	—	—
	-20	4.25	4.07	—
	-15	5.12	4.87	—
	-7	6.52	6.15	5.79
	-2	7.51	7.00	6.47
	2	8.31	7.68	7.01
	7	8.96	8.47	7.69
	10	10.06	9.44	8.59
	12	10.79	10.09	9.19
	15	11.89	11.05	10.09
20	13.73	12.66	11.58	

Power input (kW)		LWT (°C)		
		35	45	55
TO (°C)	-25	1.60	—	—
	-20	1.73	2.26	—
	-15	1.82	2.34	—
	-7	1.92	2.43	2.98
	-2	1.99	2.47	2.94
	2	2.03	2.49	2.92
	7	1.92	2.41	2.88
	10	1.95	2.41	2.91
	12	1.96	2.40	2.93
	15	1.98	2.39	2.97
20	2.02	2.38	3.02	

COP		LWT (°C)		
		35	45	55
TO (°C)	-25	2.11	—	—
	-20	2.46	1.80	—
	-15	2.82	2.08	—
	-7	3.39	2.53	1.94
	-2	3.78	2.84	2.20
	2	4.09	3.08	2.40
	7	4.66	3.51	2.67
	10	5.17	3.92	2.95
	12	5.51	4.20	3.13
	15	6.00	4.62	3.40
20	6.81	5.32	3.84	

* Heating capacity and power input are include defrost cycle data.

* Heating capacity and power input in low noise operation are the data at low noise operating frequency.

* Power input does not include water pump power.

TO : Outdoor temperature (DB°C)

LWT : Leaving water temperature (°C)

Specifications part load cooling capacity and input LWT(°C) = 7°C

Outdoor unit HWS-P805HR-E
 Hydro unit HWS-P805XWH**-E

Capacity (kW)		Load (%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	7.82	7.04	6.26	5.48	4.70	3.91	3.13	2.35	1.56	0.98
	27	7.53	6.77	6.03	5.27	4.52	3.77	3.04	3.04	3.04	3.04
	30	7.41	6.66	5.93	5.18	4.45	3.70	2.98	2.98	2.98	2.98
	35	7.20	6.48	5.76	5.04	4.32	3.60	2.90	2.90	2.90	2.90
	40	6.50	5.85	5.20	4.55	3.90	3.25	3.02	3.02	3.02	3.02
	43	6.08	5.47	4.87	4.25	3.64	3.04	2.83	2.83	2.83	2.83

Power input (kW)		Load(%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	1.30	1.18	1.06	0.94	0.82	0.70	0.58	0.46	0.34	0.25
	27	1.67	1.52	1.36	1.21	1.05	0.90	0.74	0.74	0.74	0.74
	30	1.83	1.66	1.49	1.32	1.16	0.98	0.82	0.82	0.82	0.82
	35	2.09	1.90	1.71	1.51	1.32	1.12	0.93	0.93	0.93	0.93
	40	2.31	2.10	1.88	1.67	1.46	1.25	1.17	1.17	1.17	1.17
	43	2.44	2.22	1.99	1.77	1.54	1.31	1.24	1.24	1.24	1.24

COP		Load(%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	6.00	5.96	5.91	5.80	5.71	5.59	5.41	5.15	4.57	3.87
	27	4.51	4.47	4.42	4.36	4.29	4.19	4.08	4.08	4.08	4.08
	30	4.05	4.02	3.97	3.93	3.85	3.77	3.64	3.64	3.64	3.64
	35	3.44	3.42	3.37	3.33	3.28	3.21	3.11	3.11	3.11	3.11
	40	2.81	2.78	2.76	2.72	2.67	2.61	2.59	2.59	2.59	2.59
	43	2.49	2.46	2.45	2.41	2.36	2.32	2.28	2.28	2.28	2.28

* Cooling capacity and power input at 100% load are the data at rated compressor operating frequency of rated condition 1

* Power input does not include water pump power.

* Cooling capacity and power input at 100% load are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C) RH85%

LWT : Leaving water temperature (°C)

Specifications part load cooling capacity and input LWT(°C) = 13°C

Outdoor unit HWS-P805HR-E
 Hydro unit HWS-P805XWH**-E

Capacity (kW)		Load(%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	8.99	8.10	7.20	6.30	5.40	4.50	3.59	2.70	2.42	2.42
	27	8.50	7.65	6.79	5.94	5.09	4.25	4.25	4.25	4.25	4.25
	30	8.51	7.66	6.80	5.96	5.11	4.26	4.26	4.26	4.26	4.26
	35	8.62	7.75	6.89	6.04	5.17	4.32	4.32	4.32	4.32	4.32
	40	7.77	6.99	6.21	5.45	4.67	4.30	4.30	4.30	4.30	4.30
	43	7.31	6.58	5.84	5.12	4.38	4.04	4.04	4.04	4.04	4.04

Power input (kW)		Load(%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	1.29	1.15	1.01	0.88	0.74	0.60	0.46	0.32	0.28	0.28
	27	1.67	1.49	1.31	1.13	0.96	0.77	0.77	0.77	0.77	0.77
	30	1.83	1.64	1.44	1.25	1.05	0.85	0.85	0.85	0.85	0.85
	35	2.11	1.88	1.66	1.43	1.21	0.98	0.98	0.98	0.98	0.98
	40	2.35	2.09	1.84	1.59	1.34	1.22	1.22	1.22	1.22	1.22
	43	2.51	2.24	1.97	1.70	1.43	1.31	1.31	1.31	1.31	1.31

COP		Load(%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	6.97	7.04	7.13	7.17	7.32	7.53	7.84	8.46	8.65	8.65
	27	5.09	5.12	5.19	5.24	5.32	5.50	5.50	5.50	5.50	5.50
	30	4.65	4.68	4.72	4.78	4.86	4.98	4.98	4.98	4.98	4.98
	35	4.09	4.13	4.16	4.23	4.29	4.42	4.42	4.42	4.42	4.42
	40	3.31	3.35	3.37	3.43	3.48	3.52	3.52	3.52	3.52	3.52
	43	2.91	2.93	2.97	3.00	3.07	3.09	3.09	3.09	3.09	3.09

* Cooling capacity and power input at 100% load are the data at rated compressor operating frequency of rated condition 1

* Power input does not include water pump power.

* Cooling capacity and power input at 100% load are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C) RH85%

LWT : Leaving water temperature (°C)

Specifications part load cooling capacity and input LWT(°C) = 18°C

Outdoor unit HWS-P805HR-E
 Hydro unit HWS-P805XWH**-E

Capacity (kW)		Load(%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	8.99	8.10	7.19	6.30	5.40	4.50	3.60	3.22	3.22	3.22
	27	9.30	8.37	7.44	6.51	5.58	5.23	5.23	5.23	5.23	5.23
	30	9.43	8.49	7.54	6.60	5.66	5.30	5.30	5.30	5.30	5.30
	35	9.65	8.68	7.71	6.76	5.79	5.43	5.43	5.43	5.43	5.43
	40	8.84	7.95	7.07	6.18	5.37	5.37	5.37	5.37	5.37	5.37
	43	8.35	7.51	6.68	5.84	5.07	5.07	5.07	5.07	5.07	5.07

Power input (kW)		Load(%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	1.29	1.19	1.03	0.87	0.71	0.55	0.39	0.32	0.32	0.32
	27	1.67	1.47	1.28	1.07	0.87	0.80	0.80	0.80	0.80	0.80
	30	1.83	1.61	1.40	1.18	0.96	0.88	0.88	0.88	0.88	0.88
	35	2.10	1.85	1.60	1.35	1.11	1.00	1.00	1.00	1.00	1.00
	40	2.37	2.09	1.81	1.53	1.27	1.27	1.27	1.27	1.27	1.27
	43	2.54	2.23	1.93	1.63	1.35	1.35	1.35	1.35	1.35	1.35

COP		Load(%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	6.97	6.80	6.97	7.22	7.57	8.24	9.29	10.10	10.10	10.10
	27	5.57	5.68	5.83	6.09	6.39	6.50	6.50	6.50	6.50	6.50
	30	5.15	5.26	5.40	5.60	5.89	6.03	6.03	6.03	6.03	6.03
	35	4.59	4.69	4.82	5.01	5.23	5.40	5.40	5.40	5.40	5.40
	40	3.72	3.80	3.90	4.05	4.24	4.24	4.24	4.24	4.24	4.24
	43	3.29	3.36	3.46	3.59	3.76	3.76	3.76	3.76	3.76	3.76

* Cooling capacity and power input at 100% load are the data at rated compressor operating frequency of rated condition 1

* Power input does not include water pump power.

* Cooling capacity and power input at 100% load are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C) RH85%

LWT : Leaving water temperature (°C)

Specifications Low noise operation 40.2Hz

Outdoor unit HWS-P805HR-E
Hydro unit HWS-P805XWH**-E

Capacity (kW)		LWT (°C)		
		7	13	18
TO (°C)	20	5.01	6.29	6.62
	27	4.82	5.93	6.85
	30	4.73	5.94	6.94
	35	4.61	6.02	7.10
	40	4.16	5.43	6.50
	43	3.89	5.11	6.14

Power input (kW)		LWT (°C)		
		7	13	18
TO (°C)	20	0.87	0.87	0.93
	27	1.12	1.13	1.15
	30	1.22	1.24	1.26
	35	1.40	1.43	1.44
	40	1.54	1.59	1.63
	43	1.63	1.69	1.74

COP		LWT (°C)		
		7	13	18
TO (°C)	20	5.75	7.23	7.15
	27	4.32	5.23	5.97
	30	3.87	4.81	5.51
	35	3.30	4.22	4.92
	40	2.70	3.42	4.00
	43	2.39	3.02	3.54

* Cooling capacity and power input in low noise operation are the data at low noise operation frequency.

* Power input does not include water pump power.

TO : Outdoor temperature (DB°C)

LWT : Leaving water temperature (°C)

Specifications part load heating capacity and input LWT(°C) = 35°C

Outdoor unit HWS-P1105HR-E
Hydro unit HWS-P1105XWH**-E

Capacity (kW)		Load(%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-25	7.81	7.03	6.25	5.46	4.68	3.90	2.83	2.83	2.83	2.83
	-20	9.19	8.27	7.35	6.43	5.52	4.60	3.33	3.33	3.33	3.33
	-15	11.23	10.11	8.98	7.86	6.74	5.62	4.07	4.07	4.07	4.07
	-7	12.79	11.51	10.23	8.96	7.68	6.40	4.64	4.64	4.64	4.64
	-2	14.39	12.95	11.52	10.08	8.64	7.20	5.22	5.22	5.22	5.22
	2	15.67	14.11	12.54	10.97	9.40	7.84	5.68	5.68	5.68	5.68
	7	18.05	16.24	14.44	12.63	10.83	9.02	7.22	5.41	3.61	2.21
	10	18.94	17.05	15.15	13.26	11.37	9.47	7.58	5.68	3.79	2.43
	12	19.54	17.59	15.63	13.68	11.72	9.77	7.82	5.86	3.91	2.58
	15	20.43	18.39	16.35	14.30	12.26	10.22	8.17	6.13	4.09	2.79
	20	21.92	19.73	17.54	15.35	13.15	10.96	8.77	6.58	4.38	3.16

Power input (kW)		Load(%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-25	4.32	3.80	3.28	2.76	2.24	1.89	1.41	1.41	1.41	1.41
	-20	4.33	3.81	3.29	2.76	2.24	1.89	1.42	1.42	1.42	1.42
	-15	4.34	3.81	3.29	2.77	2.24	1.90	1.42	1.42	1.42	1.42
	-7	4.35	3.82	3.30	2.78	2.25	1.90	1.42	1.42	1.42	1.42
	-2	4.35	3.82	3.30	2.77	2.25	1.90	1.42	1.42	1.42	1.42
	2	4.35	3.82	3.30	2.77	2.25	1.90	1.42	1.42	1.42	1.42
	7	4.29	3.72	3.15	2.57	2.22	1.87	1.51	1.16	0.81	0.53
	10	4.12	3.62	3.12	2.63	2.13	1.79	1.44	1.10	0.76	0.51
	12	4.01	3.53	3.05	2.57	2.09	1.75	1.41	1.07	0.73	0.50
	15	3.88	3.42	2.96	2.49	2.03	1.70	1.36	1.03	0.69	0.48
	20	3.70	3.26	2.83	2.39	1.96	1.63	1.29	0.96	0.63	0.44

COP		Load(%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-25	1.81	1.85	1.91	1.98	2.10	2.07	2.00	2.00	2.00	2.00
	-20	2.12	2.17	2.24	2.33	2.46	2.43	2.35	2.35	2.35	2.35
	-15	2.59	2.65	2.73	2.84	3.00	2.96	2.87	2.87	2.87	2.87
	-7	2.94	3.01	3.10	3.23	3.41	3.36	3.26	3.26	3.26	3.26
	-2	3.31	3.39	3.49	3.63	3.84	3.79	3.67	3.67	3.67	3.67
	2	3.61	3.69	3.80	3.96	4.18	4.12	4.00	4.00	4.00	4.00
	7	4.20	4.37	4.59	4.91	4.88	4.84	4.77	4.67	4.47	4.14
	10	4.60	4.71	4.85	5.05	5.34	5.30	5.25	5.16	4.99	4.73
	12	4.87	4.98	5.12	5.32	5.62	5.59	5.55	5.48	5.35	5.16
	15	5.27	5.38	5.53	5.73	6.03	6.02	6.00	5.97	5.92	5.84
	20	5.93	6.05	6.20	6.41	6.71	6.74	6.78	6.84	6.96	7.12

* Heating capacity and power input are include defrost cycle data.

* Heating capacity and power input at 100% load are shown at maximum compressor operating frequency

* Power input does not include water pump power.

* Heating capacity and power input at 100% load are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C) RH85%

LWT : Leaving water temperature (°C)

Specifications part load heating capacity and input LWT(°C) = 45°C

Outdoor unit HWS-P1105HR-E
Hydro unit HWS-P1105XWH**-E

Capacity (kW)		Load(%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-25	—	—	—	—	—	—	—	—	—	—
	-20	7.64	6.88	6.11	5.35	4.58	3.37	3.37	3.37	3.37	3.37
	-15	8.13	7.32	6.50	5.69	4.88	3.58	3.58	3.58	3.58	3.58
	-7	10.61	9.55	8.49	7.42	6.36	4.67	4.67	4.67	4.67	4.67
	-2	11.95	10.76	9.56	8.37	7.17	5.27	5.27	5.27	5.27	5.27
	2	13.03	11.72	10.42	9.12	7.82	5.74	5.74	5.74	5.74	5.74
	7	14.74	13.26	11.79	10.32	8.84	7.37	5.97	5.97	5.97	5.97
	10	15.50	13.95	12.40	10.85	9.30	7.75	6.48	6.48	6.48	6.48
	12	16.01	14.41	12.81	11.21	9.61	8.01	6.82	6.82	6.82	6.82
	15	16.78	15.10	13.42	11.74	10.07	8.39	7.34	7.34	7.34	7.34
	20	18.05	16.25	14.44	12.64	10.83	9.03	8.19	8.19	8.19	8.19

Power input (kW)		Load(%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-25	—	—	—	—	—	—	—	—	—	—
	-20	4.31	3.86	3.40	2.95	2.49	1.80	1.80	1.80	1.80	1.80
	-15	4.32	3.86	3.41	2.95	2.50	1.81	1.81	1.81	1.81	1.81
	-7	4.33	3.87	3.41	2.96	2.50	1.81	1.81	1.81	1.81	1.81
	-2	4.31	3.86	3.40	2.95	2.49	1.80	1.80	1.80	1.80	1.80
	2	4.30	3.85	3.40	2.94	2.49	1.80	1.80	1.80	1.80	1.80
	7	4.23	3.77	3.32	2.86	2.41	1.99	1.60	1.60	1.60	1.60
	10	4.06	3.62	3.18	2.74	2.31	1.90	1.57	1.57	1.57	1.57
	12	3.97	3.54	3.11	2.67	2.24	1.85	1.56	1.56	1.56	1.56
	15	3.84	3.40	2.96	2.52	2.15	1.77	1.53	1.53	1.53	1.53
	20	3.67	3.25	2.82	2.39	2.03	1.66	1.50	1.50	1.50	1.50

COP		Load(%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-25	—	—	—	—	—	—	—	—	—	—
	-20	1.77	1.78	1.80	1.82	1.84	1.87	1.87	1.87	1.87	1.87
	-15	1.88	1.89	1.91	1.93	1.95	1.98	1.98	1.98	1.98	1.98
	-7	2.45	2.47	2.49	2.51	2.55	2.58	2.58	2.58	2.58	2.58
	-2	2.77	2.79	2.81	2.84	2.88	2.92	2.92	2.92	2.92	2.92
	2	3.03	3.05	3.07	3.10	3.14	3.19	3.19	3.19	3.19	3.19
	7	3.49	3.52	3.55	3.60	3.67	3.70	3.74	3.74	3.74	3.74
	10	3.82	3.85	3.90	3.95	4.04	4.07	4.12	4.12	4.12	4.12
	12	4.04	4.08	4.13	4.19	4.28	4.33	4.38	4.38	4.38	4.38
	15	4.37	4.44	4.53	4.65	4.69	4.74	4.78	4.78	4.78	4.78
	20	4.91	5.01	5.12	5.29	5.34	5.43	5.48	5.48	5.48	5.48

* Heating capacity and power input are include defrost cycle data.

* Heating capacity and power input at 100% load are shown at maximum compressor operating frequency

* Power input does not include water pump power.

* Heating capacity and power input at 100% load are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C) RH85%

LWT : Leaving water temperature (°C)

Specifications part load heating capacity and input LWT(°C) = 55°C

Outdoor unit HWS-P1105HR-E
Hydro unit HWS-P1105XWH**-E

Capacity (kW)		Load(%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-25	—	—	—	—	—	—	—	—	—	—
	-20	—	—	—	—	—	—	—	—	—	—
	-15	—	—	—	—	—	—	—	—	—	—
	-7	8.42	7.58	6.74	5.89	5.05	4.19	4.19	4.19	4.19	4.19
	-2	9.51	8.56	7.61	6.66	5.71	4.73	4.73	4.73	4.73	4.73
	2	10.38	9.34	8.30	7.27	6.23	5.16	5.16	5.16	5.16	5.16
	7	11.43	10.28	9.14	8.00	6.86	5.71	5.36	5.36	5.36	5.36
	10	12.06	10.86	9.65	8.44	7.24	6.03	5.88	5.88	5.88	5.88
	12	12.49	11.24	9.99	8.74	7.49	6.24	6.22	6.22	6.22	6.22
	15	13.12	11.81	10.50	9.19	7.87	6.74	6.74	6.74	6.74	6.74
	20	14.18	12.76	11.35	9.93	8.51	7.60	7.60	7.60	7.60	7.60

Power input (kW)		Load(%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-25	—	—	—	—	—	—	—	—	—	—
	-20	—	—	—	—	—	—	—	—	—	—
	-15	—	—	—	—	—	—	—	—	—	—
	-7	4.30	3.87	3.44	3.02	2.60	2.17	2.17	2.17	2.17	2.17
	-2	4.26	3.84	3.42	2.99	2.58	2.16	2.16	2.16	2.16	2.16
	2	4.25	3.82	3.40	2.98	2.57	2.15	2.15	2.15	2.15	2.15
	7	4.12	3.71	3.31	2.90	2.50	2.10	1.97	1.97	1.97	1.97
	10	3.98	3.58	3.19	2.80	2.41	2.02	1.97	1.97	1.97	1.97
	12	3.90	3.51	3.13	2.74	2.36	1.97	1.96	1.96	1.96	1.96
	15	3.79	3.42	3.05	2.67	2.29	1.96	1.96	1.96	1.96	1.96
	20	3.64	3.29	2.94	2.57	2.19	1.96	1.96	1.96	1.96	1.96

COP		Load(%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	-25	—	—	—	—	—	—	—	—	—	—
	-20	—	—	—	—	—	—	—	—	—	—
	-15	—	—	—	—	—	—	—	—	—	—
	-7	1.96	1.96	1.96	1.95	1.94	1.93	1.93	1.93	1.93	1.93
	-2	2.23	2.23	2.23	2.23	2.21	2.19	2.19	2.19	2.19	2.19
	2	2.45	2.44	2.44	2.44	2.43	2.41	2.41	2.41	2.41	2.41
	7	2.77	2.77	2.76	2.76	2.74	2.73	2.72	2.72	2.72	2.72
	10	3.03	3.03	3.03	3.02	3.01	2.99	2.99	2.99	2.99	2.99
	12	3.21	3.20	3.19	3.19	3.18	3.17	3.17	3.17	3.17	3.17
	15	3.47	3.46	3.45	3.44	3.44	3.44	3.44	3.44	3.44	3.44
	20	3.90	3.88	3.86	3.87	3.88	3.89	3.89	3.89	3.89	3.89

* Heating capacity and power input are include defrost cycle data.

* Heating capacity and power input at 100% load are shown at maximum compressor operating frequency

* Power input does not include water pump power.

* Heating capacity and power input at 100% load are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C) RH85%

LWT : Leaving water temperature (°C)

Specifications Low noise operation 40.2Hz

Outdoor unit HWS-P1105HR-E
Hydro unit HWS-P1105XWH**-E

Capacity (kW)		LWT (°C)		
		35	45	55
TO (°C)	-25	4.27	—	—
	-20	5.03	4.63	—
	-15	6.14	4.92	—
	-7	6.99	6.42	5.80
	-2	7.87	7.24	6.55
	2	8.57	7.89	7.15
	7	9.56	8.92	7.93
	10	10.44	9.74	8.78
	12	11.03	10.29	9.35
	15	11.91	11.11	10.19
20	13.38	12.48	11.61	

Power input (kW)		LWT (°C)		
		35	45	55
TO (°C)	-25	2.04	—	—
	-20	2.04	2.51	—
	-15	2.05	2.52	—
	-7	2.05	2.52	2.97
	-2	2.05	2.52	2.94
	2	2.05	2.51	2.93
	7	1.95	2.43	2.88
	10	1.96	2.41	2.91
	12	1.96	2.40	2.93
	15	1.97	2.39	2.96
20	1.99	2.36	3.01	

COP		LWT (°C)		
		35	45	55
TO (°C)	-25	2.10	—	—
	-20	2.46	1.84	—
	-15	3.00	1.95	—
	-7	3.41	2.55	1.95
	-2	3.84	2.88	2.23
	2	4.18	3.14	2.44
	7	4.91	3.67	2.76
	10	5.34	4.04	3.02
	12	5.62	4.28	3.19
	15	6.03	4.65	3.45
20	6.71	5.29	3.86	

* Heating capacity and power input are include defrost cycle data.

* Heating capacity and power input in low noise operation are the data at low noise operating frequency.

* Power input does not include water pump power.

TO : Outdoor temperature (DB°C)

LWT : Leaving water temperature (°C)

Specifications part load cooling capacity and input LWT(°C) = 7°C

Outdoor unit HWS-P1105HR-E
 Hydro unit HWS-P1105XWH**-E

Capacity (kW)		Load(%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	11.21	10.09	8.97	7.85	6.73	5.61	4.48	3.36	2.25	1.92
	27	10.67	9.61	8.54	7.47	6.40	5.34	5.14	5.14	5.14	5.14
	30	10.44	9.40	8.35	7.31	6.27	5.23	5.04	5.04	5.04	5.04
	35	10.06	9.05	8.05	7.04	6.04	5.03	4.85	4.85	4.85	4.85
	40	8.75	7.87	7.00	6.12	5.26	4.83	4.83	4.83	4.83	4.83
	43	7.97	7.17	6.37	5.57	4.78	4.39	4.39	4.39	4.39	4.39

Power input (kW)		Load(%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	2.07	1.83	1.59	1.37	1.17	0.97	0.79	0.62	0.47	0.42
	27	2.63	2.32	2.02	1.75	1.48	1.24	1.19	1.19	1.19	1.19
	30	2.87	2.53	2.21	1.90	1.62	1.35	1.31	1.31	1.31	1.31
	35	3.27	2.88	2.52	2.16	1.84	1.53	1.49	1.49	1.49	1.49
	40	3.49	3.08	2.69	2.31	1.96	1.80	1.80	1.80	1.80	1.80
	43	3.62	3.19	2.78	2.41	2.04	1.88	1.88	1.88	1.88	1.88

COP		Load(%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	5.42	5.53	5.64	5.73	5.76	5.77	5.67	5.43	4.78	4.54
	27	4.06	4.15	4.22	4.28	4.33	4.32	4.31	4.31	4.31	4.31
	30	3.64	3.72	3.78	3.85	3.88	3.87	3.86	3.86	3.86	3.86
	35	3.08	3.15	3.20	3.25	3.28	3.28	3.26	3.26	3.26	3.26
	40	2.51	2.56	2.61	2.65	2.68	2.68	2.68	2.68	2.68	2.68
	43	2.20	2.25	2.29	2.32	2.34	2.34	2.34	2.34	2.34	2.34

* Cooling capacity and power input at 100% load are the data at rated compressor operating frequency of rated condition 1
 * Power input does not include water pump power.
 * Cooling capacity and power input at 100% load are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C) RH85%
 LWT : Leaving water temperature (°C)



Specifications part load cooling capacity and input LWT(°C) = 13°C

Outdoor unit HWS-P1105HR-E
Hydro unit HWS-P1105XWH**-E

Capacity (kW)		Load(%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	12.89	11.60	10.31	9.02	7.73	6.45	5.16	3.87	3.78	3.78
	27	12.22	11.00	9.78	8.56	7.34	6.82	6.82	6.82	6.82	6.82
	30	11.97	10.78	9.58	8.38	7.18	6.69	6.69	6.69	6.69	6.69
	35	11.66	10.50	9.33	8.16	7.00	6.51	6.51	6.51	6.51	6.51
	40	9.70	8.73	7.76	6.79	5.99	5.99	5.99	5.99	5.99	5.99
	43	9.16	8.25	7.33	6.42	5.66	5.66	5.66	5.66	5.66	5.66

Power input (kW)		Load(%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	2.08	1.86	1.59	1.34	1.11	0.89	0.69	0.51	0.50	0.50
	27	2.67	2.31	1.97	1.66	1.37	1.26	1.26	1.26	1.26	1.26
	30	2.92	2.53	2.16	1.82	1.51	1.38	1.38	1.38	1.38	1.38
	35	3.36	2.91	2.49	2.10	1.73	1.59	1.59	1.59	1.59	1.59
	40	3.31	2.87	2.45	2.07	1.77	1.77	1.77	1.77	1.77	1.77
	43	3.58	3.10	2.65	2.24	1.91	1.91	1.91	1.91	1.91	1.91

COP		Load(%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	6.20	6.24	6.50	6.75	6.98	7.26	7.47	7.61	7.55	7.55
	27	4.59	4.76	4.95	5.15	5.34	5.43	5.43	5.43	5.43	5.43
	30	4.10	4.26	4.43	4.60	4.76	4.86	4.86	4.86	4.86	4.86
	35	3.47	3.61	3.74	3.89	4.04	4.09	4.09	4.09	4.09	4.09
	40	2.93	3.04	3.16	3.29	3.39	3.39	3.39	3.39	3.39	3.39
	43	2.56	2.66	2.77	2.87	2.97	2.97	2.97	2.97	2.97	2.97

* Cooling capacity and power input at 100% load are the data at rated compressor operating frequency of rated condition 1

* Power input does not include water pump power.

* Cooling capacity and power input at 100% load are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C) RH85%

LWT : Leaving water temperature (°C)

Specifications part load cooling capacity and input LWT(°C) = 18°C

Outdoor unit HWS-P1105HR-E
 Hydro unit HWS-P1105XWH**-E

Capacity (kW)		Load(%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	14.12	12.71	11.30	9.89	8.48	7.06	5.65	5.31	5.31	5.31
	27	13.51	12.16	10.81	9.45	8.24	8.24	8.24	8.24	8.24	8.24
	30	13.25	11.92	10.60	9.27	8.09	8.09	8.09	8.09	8.09	8.09
	35	12.81	11.53	10.25	8.96	7.82	7.82	7.82	7.82	7.82	7.82
	40	10.49	9.44	8.39	7.34	6.95	6.95	6.95	6.95	6.95	6.95
	43	9.09	8.18	7.28	6.36	6.03	6.03	6.03	6.03	6.03	6.03

Power input (kW)		Load(%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	2.07	1.85	1.55	1.27	1.02	0.79	0.57	0.53	0.53	0.53
	27	2.70	2.30	1.92	1.58	1.30	1.30	1.30	1.30	1.30	1.30
	30	2.97	2.53	2.12	1.74	1.42	1.42	1.42	1.42	1.42	1.42
	35	3.42	2.91	2.44	2.00	1.64	1.64	1.64	1.64	1.64	1.64
	40	3.16	2.69	2.26	1.85	1.71	1.71	1.71	1.71	1.71	1.71
	43	3.01	2.56	2.15	1.76	1.63	1.63	1.63	1.63	1.63	1.63

COP		Load(%)									
		100	90	80	70	60	50	40	30	20	10
TO (°C)	20	6.83	6.87	7.30	7.78	8.32	8.96	9.87	10.07	10.07	10.07
	27	5.01	5.29	5.63	6.00	6.35	6.35	6.35	6.35	6.35	6.35
	30	4.47	4.71	5.00	5.34	5.69	5.69	5.69	5.69	5.69	5.69
	35	3.75	3.97	4.20	4.48	4.76	4.76	4.76	4.76	4.76	4.76
	40	3.32	3.51	3.72	3.97	4.07	4.07	4.07	4.07	4.07	4.07
	43	3.02	3.20	3.39	3.61	3.70	3.70	3.70	3.70	3.70	3.70

* Cooling capacity and power input at 100% load are the data at rated compressor operating frequency of rated condition 1
 * Power input does not include water pump power.
 * Cooling capacity and power input at 100% load are measured in accordance with EN14511.

TO : Outdoor temperature (DB°C) RH85%
 LWT : Leaving water temperature (°C)

Specifications Low noise operation 40.2Hz

Outdoor unit HWS-P1105HR-E
Hydro unit HWS-P1105XWH**-E

Capacity (kW)		LWT (°C)		
		7	13	18
TO (°C)	20	8.36	10.13	11.44
	27	7.96	9.61	10.94
	30	7.79	9.41	10.73
	35	7.50	9.17	10.37
	40	6.53	7.62	8.50
	43	5.94	7.20	7.37

Power input (kW)		LWT (°C)		
		7	13	18
TO (°C)	20	1.47	1.56	1.58
	27	1.87	1.93	1.96
	30	2.04	2.12	2.15
	35	2.32	2.44	2.48
	40	2.48	2.40	2.30
	43	2.57	2.59	2.18

COP		LWT (°C)		
		7	13	18
TO (°C)	20	5.68	6.51	7.26
	27	4.26	4.97	5.57
	30	3.82	4.44	4.98
	35	3.23	3.76	4.18
	40	2.63	3.17	3.70
	43	2.31	2.78	3.37

* Cooling capacity and power input in low noise operation are the data at low noise operation frequency.


* Power input does not include water pump power.

TO : Outdoor temperature (DB°C)


LWT : Leaving water temperature (°C)

4-7. Q-H characteristics of hydro unit


4-7-1. HWS-455XWHM3-E / HWS-805XWHM3-E, T6-E, T9-E

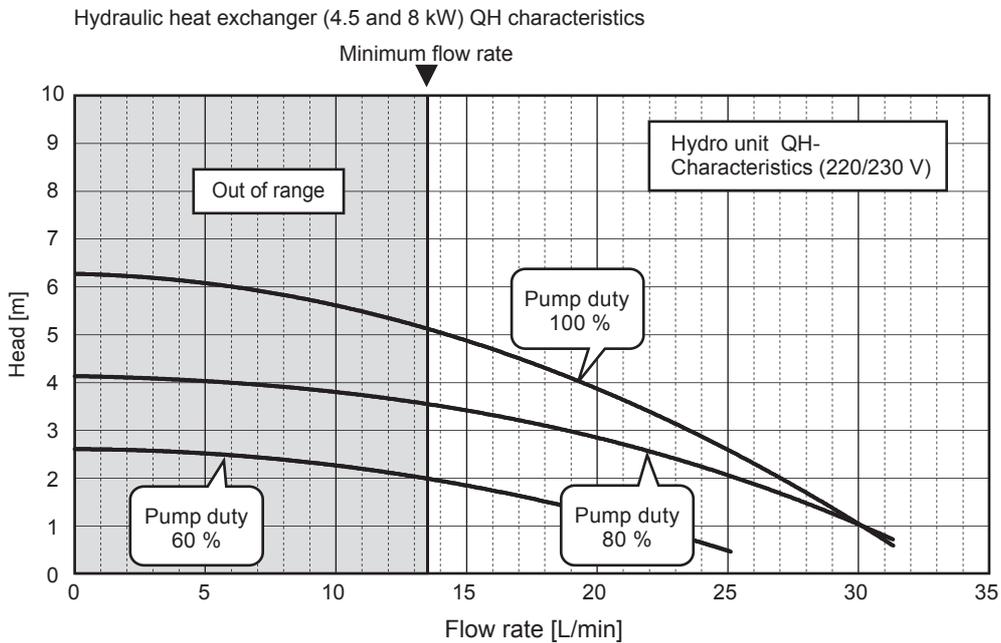


4-7-2. HWS-1405XWHM3-E, T6-E, T9-E

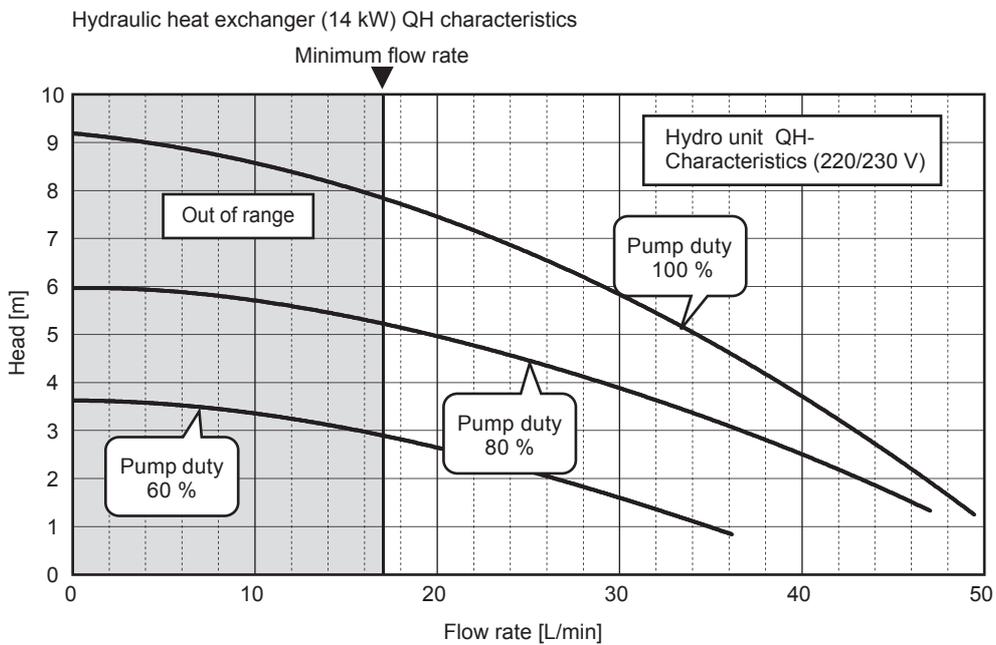

4-7-3. HWS-P805XWHM3-E, T6-E, T9-E

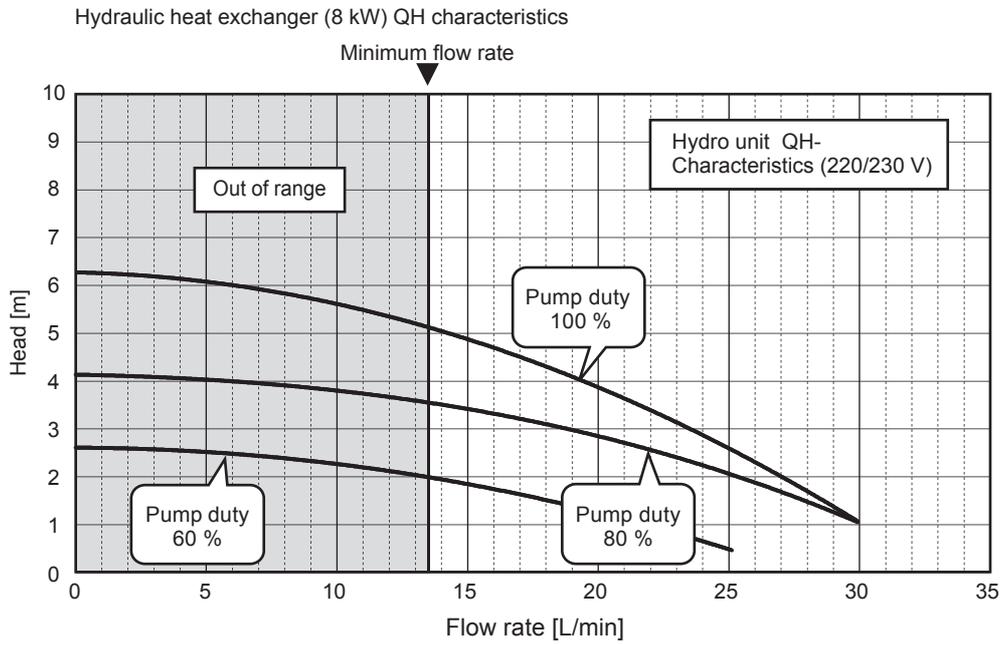

4-7-4. HWS-P1105XWHM3-E, T6-E, T9-E

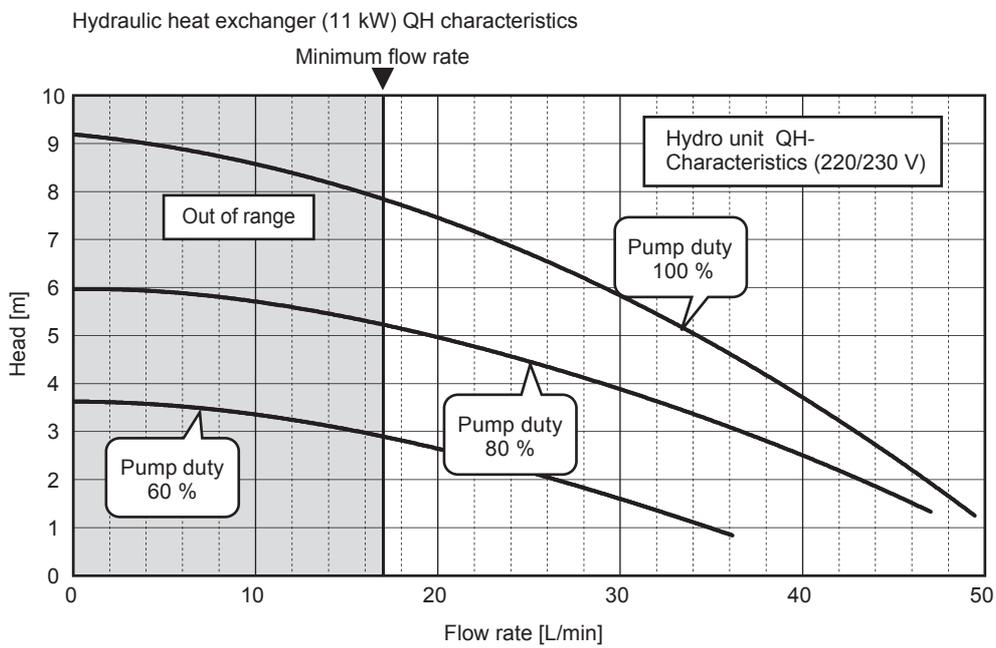

4-8. Options

Optional parts

No.	Part name	Model name	Application	Remarks
1	External output board	TCB-PCIN3E	Boiler-linked output, Alarm output	Up to two boards (according to applications)
			Defrost signal output, Compressor operation signal output	
2	External input board	TCB-PCMO3E	Cooling/heating thermostat input	Up to two boards (according to applications)
			Forced-stop signal input	

▼External output board


Feature

Operation and Error monitoring is possible by using Error output control board "TCB-PCIN3E"

Function / Electric wiring diagram


Alarm output : Output enabled when the system is in alarm / fault condition.

Boiler control output : Output enabled when outdoor ambient temperature <-10 °C

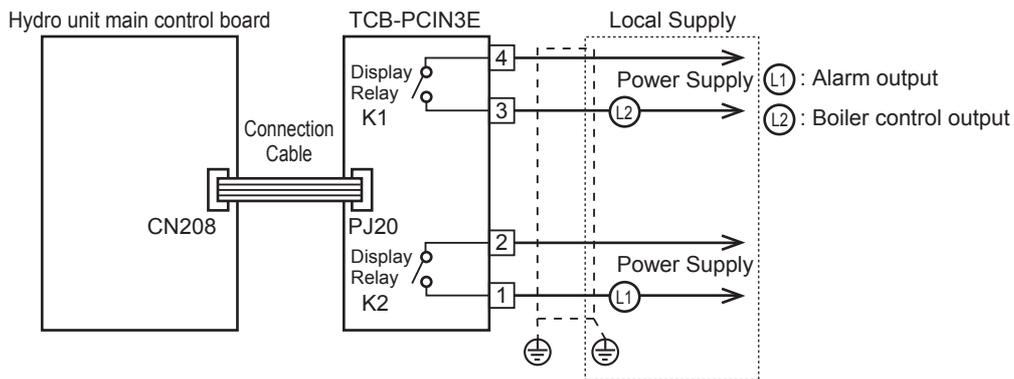

Operation output : Display relay is ON with outdoor unit compressor operation.

Defrost output : Display relay is ON when the system in defrost.

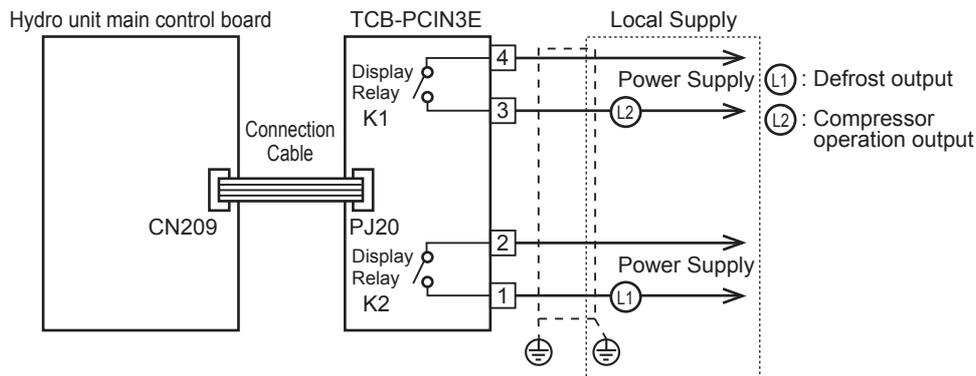

⚠ CAUTION

- Be sure to prepare a non-voltage point for each terminal.
- Display Relay capacity of "ALERM" and "BOILER", "OPERATION" and "DEFROST"
 Below AC230V 0.5A (COS Ø =100%). when connecting load such as relay coil to "L1,L2" load, insert the noise surge absorber.
 Below DC24V 1A (Non-inductive load). when connecting load such as relay coil to "L1,L2" load, insert the bypass circuit.

▼External input board

Feature

*“TCB-PCMO3E“ is used for the following external master controls.

1. Room thermostat input
2. Emergency shutdown input

Refer to “Function/Electric wiring diagram“ for feature of each control because connection is different according to the control.


Function / Electric wiring diagram

Room thermostat input

2-3 : Room thermostat input for cooling mode

1-3 : Room thermostat input for heating mode

- Output enabled when either heating or cooling mode selected on room thermostat. (locally procured)
- Volt free details :
- Connection details :
 Cooling connection :Terminals 3 (COM) and 2 (COOL) on TCB-PCMO3E (See Schematic below)
 Heating connection :Terminals 3 (COM) and 1 (HEAT) on TCB-PCMO3E (See Schematic below)

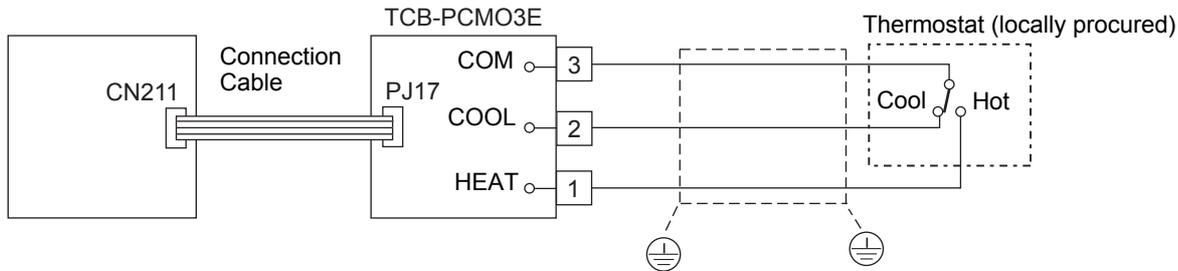


Thermostat operation

	Cooling		Heating	
	on	off	on	off
2 - 3	open	close	–	–
1 - 3	–	–	close	open

Emergency shutdown input

S2 : Emergency stop input

- Non-voltage contacts
- Connection details :
 Emergency stop :Terminals 3 (COM) and 1 (HEAT) on TCB-PCMO3E (See Schematic below)

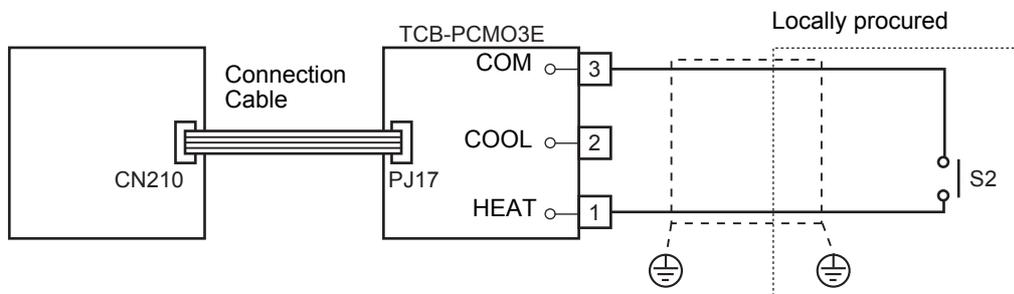

⚠ CAUTION

- Be sure to prepare non voltage continuous point of contact for each terminal.
- Supplementary Insulation must be added to user touched to user touchable part of switches.

5. OUTDOOR UNIT

5-1. Specification

5-1-1. Outdoor unit specifications

Unit name		Hydro unit	HWS-455XWHM3-E		
		Outdoor unit	HWS-455H-E		
Heating capacity *1 (kW)		4.5			
Cooling capacity *2 (kW)		4.5			
Variable range of compressor frequency		10 - 70 Hz			
Power source		Single phase 50 Hz 220-230 V			
Operation mode		Heating	Cooling		
Electric characteristic *1 *2	Hydro unit	Current (A)	0.44	0.44	
		Power (kW)	0.06	0.06	
		Power factor (%)	59.3	59.3	
	Outdoor unit	Current (A)	4.56	6.76	
		Power (kW)	0.86	1.40	
		Power factor (%)	82	90	
Total	Starting current (A)	5.00	7.20		
Operating noise sound power level	Hydro unit (dB (A))		41		
	Outdoor unit (dB (A))		65		
Coefficient of performance *1 *2		4.90	3.08		
Hydro unit	Outer dimension	Height (mm)	925		
		Width (mm)	525		
		Depth (mm)	355		
	Net weight (kg)		47		
	Color		Silky shade (Munsell 1Y8.5/0.5)		
	Remote controller Outer dimension *3	Height (mm)	120		
		Width (mm)	120		
		Depth (mm)	20		
	Circulating pump	Motor output (W)	125 (MAX)		
		Flow rate (L/min)	12.9	12.9	
		Type	Non-self-suction centrifugal pump		
Heat exchanger		Plate-type heat exchange			
Outdoor unit	Outer dimension	Height (mm)	630		
		Width (mm)	800		
		Depth (mm)	300		
	Net weight (kg)		42		
	Color		Silky shade (Munsell 1Y8.5/0.5)		
	Compressor	Motor output (W)	1100		
		Type	Twin rotary type with DC-inverter variable speed control		
		Model	DA150A1T-21F		
	Fan motor	Standard air capacity (m ³ /min)	40		
		Motor output (W)	43		
Refrigerant piping	Connection method		Flare connection		
	Hydro unit	Liquid	Ø6.35		
		Gas	Ø12.7		
	Outdoor unit	Liquid	Ø6.35		
		Gas	Ø12.7		
	Maximum length (m)		15		
	Maximum chargeless length (m)		15		
	Maximum height difference (m)		±10		
Minimum length (m)		5			
Refrigerant	Refrigerant name		R410A		
	Charge amount (kg)		1.15		
Water piping	Pipe diameter		R1		
	Maximum length (m)		None (Need the flow rate 13ℓ/min or more)		
	Maximum height difference (m)		±7		
	Maximum working water pressure (kPa) *4		300		
Operating temperature range	Hydro unit (°C) *5 (Cooling/Heating/Hot water)		5-32 / 5-32 / 5-32		
	Outdoor unit (°C) (Cooling/Heating/Hot water)		10-43 / -20-25 / -20-43		
Operating humidity range	Hydro unit (%)		15-85		
	Outdoor unit (%)		15-100		
Wiring connection	Power wiring		3 wires: including earth wire (Outdoor unit)		
	Connecting line		4 wires: including earth wire		

*1 Heating performance measurement conditions: outside air temperature 7 °C, water supply temperature 30 °C, outlet temperature 35 °C, refrigerant piping length 7.5 m (no height difference).

*2 Cooling performance measurement conditions: outside air temperature 35 °C, water supply temperature 12 °C, outlet temperature 7 °C, refrigerant piping length 7.5 m (no height difference).

*3 • The remote controller should be shipped with the hydro unit.

• Use two 1.5-meter wires to connect the hydro unit with the remote controller.

*4 Do not leave the hydro unit at 5 °C or below.

*5 Check the water piping for leakage under the maximum operating pressure.

Unit name	Hydro unit	HWS-805XWHM3-E, 805XWHT6-E, 805XWHT9-E		
	Outdoor unit	HWS-805H-E		
Heating capacity *1 (kW)	8.0			
Cooling capacity *2 (kW)	6.0			
Variable range of compressor frequency	10 - 70 Hz			
Power source	Single phase 50 Hz 220-230 V			
Operation mode	Heating		Cooling	
Electric characteristic *1 *2	Hydro unit	Current (A)	0.44	0.44
		Power (kW)	0.06	0.06
		Power factor (%)	59.3	59.3
	Outdoor unit	Current (A)	79.7	8.50
		Power (kW)	1.73	1.88
		Power factor (%)	94.4	96.2
	Total	Starting current (A)	8.41	8.94
Operating noise sound power level	Hydro unit (dB (A))		41	41
	Outdoor unit (dB (A))		64	64
Coefficient of performance *1 *2			4.46	3.10
Hydro unit	Outer dimension	Height (mm)	925	
		Width (mm)	525	
		Depth (mm)	355	
	Net weight (kg)		49	
	Color		Silky shade (Munsell 1Y8.5/0.5)	
	Remote controller Outer dimension *3	Height (mm)	120	
		Width (mm)	120	
		Depth (mm)	16	
	Circulating pump	Motor output (W)	125 (MAX)	
		Flow rate (L/min)	22.9	17.2
		Type	Non-self-suction centrifugal pump	
	Heat exchanger		Plate-type heat exchange	
	Outdoor unit	Outer dimension	Height (mm)	890
Width (mm)			900	
Depth (mm)			320	
Net weight (kg)		63		
Color		Silky shade (Munsell 1Y8.5/0.5)		
Compressor		Motor output (W)	1400	
		Type	Twin rotary type with DC-inverter variable speed control	
		Model	DA220A2F-22L	
Fan motor		Standard air capacity (m ³ /min)	50.0	
		Motor output (W)	60	
Refrigerant piping	Connection method		Flare connection	
	Hydro unit	Liquid	Ø9.52	
		Gas	Ø15.9	
	Outdoor unit	Liquid	Ø9.52	
		Gas	Ø15.9	
	Maximum length (m)		30	
	Maximum chargeless length (m)		30	
	Maximum height difference (m)		±30	
Minimum length (m)		5		
Refrigerant	Refrigerant name		R410A	
	Charge amount (kg)		1.8	
Water piping	Pipe diameter		R1 1/4	
	Maximum length (m)		None (Need the flow rate 13ℓ/min or more)	
	Maximum height difference (m)		±7	
	Maximum working water pressure (kPa) *4		300	
Operating temperature range	Hydro unit (°C) *5		5-32	
	Outdoor unit (°C)		-20-43	
Operating humidity range	Hydro unit (%)		15-85	
	Outdoor unit (%)		15-100	
Wiring connection	Power wiring		3 wires: including earth wire (Outdoor unit)	
	Connecting line		4 wires: including earth wire	

*1 Heating performance measurement conditions: outside air temperature 7 °C, water supply temperature 30 °C, outlet temperature 35 °C, refrigerant piping length 7.5 m (no height difference).
 *2 Cooling performance measurement conditions: outside air temperature 35 °C, water supply temperature 12 °C, outlet temperature 7 °C, refrigerant piping length 7.5 m (no height difference).
 *3 • The remote controller should be shipped with the hydro unit.
 • Use two 1.5-meter wires to connect the hydro unit with the remote controller.
 *4 Do not leave the hydro unit at 5 °C or below.
 *5 Check the water piping for leakage under the maximum operating pressure.

Unit name		Hydro unit	HWS-1405XWHM3-E, 1405XWHT6-E, 1405XWHT9-E				
		Outdoor unit	HWS-1105H-E	HWS-1405H-E			
Heating capacity *1 (kW)		11.2		14.0			
Cooling capacity *2 (kW)		10.0		11.0			
Variable range of compressor frequency		10 - 60 Hz		10 - 70 Hz			
Power source		Single phase 50 Hz 220-230 V					
Operation mode		Heating		Cooling			
Electric characteristic *1 *2	Hydro unit	Current (A)	0.66	0.66	0.66	0.66	
		Power (kW)	0.09	0.09	0.09	0.09	
		Power factor (%)	59.2	59.2	59.2	59.2	
	Outdoor unit	Current (A)	10.08	14.71	13.74	17.19	
		Power (kW)	2.21	3.17	3.02	3.72	
		Power factor (%)	95.3	93.7	95.6	94.1	
	Total	Starting current (A)	10.74	15.37	14.40	17.85	
Operating noise sound power level	Hydro unit (dB (A))		43	43	43	43	
	Outdoor unit (dB (A))		66	66	68	68	
Coefficient of performance *1 *2		4.88		3.07	4.50	2.89	
Hydro unit	Outer dimension	Height (mm)	925				
		Width (mm)	525				
		Depth (mm)	355				
	Net weight (kg)		52				
	Color		Silky shade (Munsell 1Y8.5/0.5)				
	Remote controller Outer dimension *3	Height (mm)	120				
		Width (mm)	120				
		Depth (mm)	16				
	Circulating pump	Motor output (W)	190 (MAX)				
		Flow rate (L/min)	32.1	28.9	40.1	31.5	
		Type	Non-self-suction centrifugal pump				
	Heat exchanger		Plate-type heat exchange				
Outdoor unit	Outer dimension	Height (mm)	1340				
		Width (mm)	900				
		Depth (mm)	320				
	Net weight (kg)		92				
	Color		Silky shade (Munsell 1Y8.5/0.5)				
	Compressor	Motor output (W)	2500				
		Type	Twin rotary type with DC-inverter variable speed control				
		Model	DA422A3F-26M				
	Fan motor	Standard air capacity (m ³ /min)	103.0				
		Motor output (W)	100 × 2				
	Refrigerant piping	Connection method		Flare connection			
		Hydro unit	Liquid	Ø9.52			
Gas			Ø15.9				
Outdoor unit		Liquid	Ø9.52				
		Gas	Ø15.9				
Maximum length (m)		30					
Maximum chargeless length (m)		30					
Maximum height difference (m)		±30					
Minimum length (m)		5					
Refrigerant	Refrigerant name		R410A				
	Charge amount (kg)		2.7				
Water piping	Pipe diameter		R1 1/4				
	Maximum length (m)		None (Need the flow rate 17.5ℓ/min or more)				
	Maximum height difference (m)		±7				
	Maximum working water pressure (kPa) *4		300				
Operating temperature range	Hydro unit (°C) *5		5-32				
	Outdoor unit (°C)		-20-43				
Operating humidity range	Hydro unit (%)		15-85				
	Outdoor unit (%)		15-100				
Wiring connection	Power wiring		3 wires: including earth wire (Outdoor unit)				
	Connecting line		4 wires: including earth wire				

*1 Heating performance measurement conditions: outside air temperature 7 °C, water supply temperature 30 °C, outlet temperature 35 °C, refrigerant piping length 7.5 m (no height difference).

*2 Cooling performance measurement conditions: outside air temperature 35 °C, water supply temperature 12 °C, outlet temperature 7 °C, refrigerant piping length 7.5 m (no height difference).

*3 • The remote controller should be shipped with the hydro unit.

• Use two 1.5-meter wires to connect the hydro unit with the remote controller.

*4 Do not leave the hydro unit at 5 °C or below.

*5 Check the water piping for leakage under the maximum operating pressure.

Unit name	Hydro unit		HWS-1405XWHM3-E, 1405XWHT6-E, 1405XWHT9-E					
	Outdoor unit		HWS-1105H8(R)-E	HWS-1405H8(R)-E	HWS-1605H8(R)-E			
Heating capacity *1 (kW)			11.2	14.0	16.0			
Cooling capacity *2 (kW)			10.0	11.0	13.0			
Variable range of compressor frequency			10 - 60 Hz	10 - 66 Hz	10 - 70 Hz			
Power source			3 phase 50 Hz 380-400 V					
Operation mode			Heating	Cooling	Heating	Cooling	Heating	Cooling
Electric characteristic *1 *2	Hydro unit	Current (A)	0.66	0.66	0.66	0.66	0.66	0.66
		Power (kW)	0.09	0.09	0.09	0.09	0.09	0.09
		Power factor (%)	59.2	59.2	59.2	59.2	59.2	59.2
	Outdoor unit	Current (A)	3.73	5.08	5.01	5.71	5.94	7.51
		Power (kW)	2.25	3.17	3.07	3.72	3.63	4.71
		Power factor (%)	87.4	90.4	88.5	94.4	88.6	90.9
	Total	Starting current (A)	4.39	5.74	5.67	6.37	6.60	7.60
Operating noise sound power level	Hydro unit (dB (A))		43	43	43	43	43	43
	Outdoor unit (dB (A))		66	66	68	68	69	69
Coefficient of performance *1 *2			4.80	3.07	4.44	2.89	4.30	2.71
Hydro unit	Outer dimension	Height (mm)	925					
		Width (mm)	525					
		Depth (mm)	355					
	Net weight (kg)		52					
	Color		Silky shade (Munsell 1Y8.5/0.5)					
	Remote controller Outer dimension *3	Height (mm)	120					
		Width (mm)	120					
		Depth (mm)	16					
	Circulating pump	Motor output (W)	190 (MAX)					
		Flow rate (L/min)	32.1	28.9	40.1	31.5	45.8	37.3
		Type	Non-self-suction centrifugal pump					
Heat exchanger		Plate-type heat exchange						
Outdoor unit	Outer dimension	Height (mm)	1340					
		Width (mm)	900					
		Depth (mm)	320					
	Net weight (kg)		93					
	Color		Silky shade (Munsell 1Y8.5/0.5)					
	Compressor	Motor output (W)	2500					
		Type	Twin rotary type with DC-inverter variable speed control					
		Model	DA422A3F-27M					
	Fan motor	Standard air capacity (m ³ /min)	103.0					
		Motor output (W)	100 × 2					
	Refrigerant piping	Connection method		Flare connection				
Hydro unit		Liquid	Ø9.52					
		Gas	Ø15.9					
Outdoor unit		Liquid	Ø9.52					
		Gas	Ø15.9					
Maximum length (m)		30						
Maximum chargeless length (m)		30						
Maximum height difference (m)		±30						
Minimum length (m)		5						
Refrigerant	Refrigerant name		R410A					
	Charge amount (kg)		2.7					
Water piping	Pipe diameter		R1 1/4					
	Maximum length (m)		None (Need the flow rate 17.5ℓ/min or more)					
	Maximum height difference (m)		±7					
	Maximum working water pressure (kPa) *4		300					
Operating temperature range	Hydro unit (°C) *5		5-32					
	Outdoor unit (°C)		-20-43					
Operating humidity range	Hydro unit (%)		15-85					
	Outdoor unit (%)		15-100					
Wiring connection	Power wiring		5 wires: including earth wire (Outdoor unit)					
	Connecting line		4 wires: including earth wire					

*1 Heating performance measurement conditions: outside air temperature 7 °C, water supply temperature 30 °C, outlet temperature 35 °C, refrigerant piping length 7.5 m (no height difference).

*2 Cooling performance measurement conditions: outside air temperature 35 °C, water supply temperature 12 °C, outlet temperature 7 °C, refrigerant piping length 7.5 m (no height difference).

*3 • The remote controller should be shipped with the hydro unit.

• Use two 1.5-meter wires to connect the hydro unit with the remote controller.

*4 Do not leave the hydro unit at 5 °C or below.

*5 Check the water piping for leakage under the maximum operating pressure.

Unit name	Hydro unit		HWS-P805XWHM3-E, P805XWHT6-E, P805XWHT9-E	
	Outdoor unit		HWS-P805HR-E	
Heating capacity *1 (kW)			8.0	
Cooling capacity *2 (kW)			6.0	
Variable range of compressor frequency			10 - 70 Hz	
Power source			Single phase 50 Hz 220-230 V	
Operation mode			Heating	Cooling
Electric characteristic *1 *2	Hydro unit	Current (A)	0.44	0.44
		Power (kW)	0.06	0.06
		Power factor (%)	59.3	59.3
	Outdoor unit	Current (A)	7.57	7.39
		Power (kW)	1.62	1.58
		Power factor (%)	93	93
Total	Running current (A)	8.01	7.83	
Operating noise sound power level	Hydro unit (dB(A))		41	41
	Outdoor unit (dB(A))		66	66
Coefficient of performance *1 *2			4.76	3.66
Hydro unit	Outer dimension	Height (mm)	925	
		Width (mm)	525	
		Depth (mm)	355	
	Net weight (kg)		49	
	Color		Silky shade (Munsell 1Y8.5/0.5)	
	Remote controller Outer dimension *3	Height (mm)	120	
		Width (mm)	120	
		Depth (mm)	16	
	Circulating pump	Motor output (W)	125 (MAX)	
		Flow rate (L/min)	22.9	17.2
		Type	Non-self-suction centrifugal pump	
Heat exchanger		Plate-type heat exchange		
Outdoor unit	Outer dimension	Current (A)	1340	
		Power (kW)	900	
		Power factor (%)	320	
	Net weight (kg)		92	
	Color		Silky shade (Munsell 1Y8.5/0.5)	
	Compressor	Current (A)	2500	
		Power (kW)	Twin rotary type with DC-inverter variable speed control	
		Power factor (%)	DA422A3F-26M	
	Fan motor	Standard air capacity (m ³ /min)	103.0	
		Motor output (W)	100 x 2	
Refrigerant piping	Connection method		Flare connection	
	Hydro unit	Liquid	Ø9.52	
		Gas	Ø15.9	
	Outdoor unit	Liquid	Ø9.52	
		Gas	Ø15.9	
	Maximum length (m)		30	
	Maximum chargeless length (m)		30	
	Maximum height difference (m)		±30	
Minimum length (m)		5		
Refrigerant	Refrigerant name		R410A	
	Charge amount (kg)		2.7	
Water piping	Pipe diameter		R1 1/4	
	Maximum length (m)		None (Need the flow rate 13ℓ/min or more)	
	Maximum height difference (m)		±7	
	Maximum working water pressure (kPa) *4		300	
Operating temperature range	Hydro unit (°C) *5		5-32	
	Outdoor unit (°C)		-25-43	
Operating humidity range	Hydro unit (%)		15-85	
	Outdoor unit (%)		15-100	
Wiring connection	Power wiring		3 wires: including earth wire (Outdoor unit)	
	Connecting line		4 wires: including earth wire	

*1 Heating performance measurement conditions: outside air temperature 7 °C, water supply temperature 30 °C, outlet temperature 35 °C, refrigerant piping length 7.5 m (no height difference).

*2 Cooling performance measurement conditions: outside air temperature 35 °C, water supply temperature 12 °C, outlet temperature 7 °C, refrigerant piping length 7.5 m (no height difference).

*3 • The remote controller should be shipped with the hydro unit.

• Use two 1.5-meter wires to connect the hydro unit with the remote controller.

*4 Do not leave the hydro unit at 5 °C or below.

*5 Check the water piping for leakage under the maximum operating pressure.

Unit name	Hydro unit	HWS-P1105XWHM3-E, P1105XWHT6-E, P1105XWHT9-E		
	Outdoor unit	HWS-P1105HR-E		
Heating capacity *1 (kW)	11.2			
Cooling capacity *2 (kW)	10.0			
Variable range of compressor frequency	10 - 90 Hz			
Power source	Single phase 50 Hz 220-230 V			
Operation mode	Heating		Cooling	
Electric characteristic *1 *2	Hydro unit	Current (A)	0.66	0.66
		Power (kW)	0.09	0.09
		Power factor (%)	59.2	59.2
	Outdoor unit	Current (A)	10.33	14.99
		Power (kW)	2.21	3.24
		Power factor (%)	93	94
Total	Running current (A)	10.99	15.65	
Operating noise sound power level	Hydro unit (dB(A))		43	43
	Outdoor unit (dB(A))		66	66
Coefficient of performance *1 *2			4.88	3.00
Hydro unit	Outer dimension	Height (mm)	925	
		Width (mm)	525	
		Depth (mm)	355	
	Net weight (kg)		52	
	Color		Silky shade (Munsell 1Y8.5/0.5)	
	Remote controller Outer dimension *3	Height (mm)	120	
		Width (mm)	120	
		Depth (mm)	16	
	Circulating pump	Motor output (W)	190 (MAX)	
		Flow rate (L/min)	32.1	28.9
		Type	Non-self-suction centrifugal pump	
Heat exchanger		Plate-type heat exchange		
Outdoor unit	Outer dimension	Current (A)	1340	
		Power (kW)	900	
		Power factor (%)	320	
	Net weight (kg)		92	
	Color		Silky shade (Munsell 1Y8.5/0.5)	
	Compressor	Current (A)	2500	
		Power (kW)	Twin rotary type with DC-inverter variable speed control	
		Power factor (%)	DA422A3F-26M	
	Fan motor	Standard air capacity (m ³ /min)	103.0	
		Motor output (W)	100 x 2	
	Refrigerant piping	Connection method		Flare connection
Hydro unit		Liquid	Ø9.52	
		Gas	Ø15.9	
Outdoor unit		Liquid	Ø9.52	
		Gas	Ø15.9	
Maximum length (m)		30		
Maximum chargeless length (m)		30		
Maximum height difference (m)		±30		
Minimum length (m)		5		
Refrigerant	Refrigerant name		R410A	
	Charge amount (kg)		2.7	
Water piping	Pipe diameter		R1 1/4	
	Maximum length (m)		None (Need the flow rate 13 ℓ/min or more)	
	Maximum height difference (m)		±7	
	Maximum working water pressure (kPa) *4		300	
Operating temperature range	Hydro unit (°C) *5		5-32	
	Outdoor unit (°C)		-23-43	
Operating humidity range	Hydro unit (%)		15-85	
	Outdoor unit (%)		15-100	
Wiring connection	Power wiring		3 wires: including earth wire (Outdoor unit)	
	Connecting line		4 wires: including earth wire	

*1 Heating performance measurement conditions: outside air temperature 7 °C, water supply temperature 30 °C, outlet temperature 35 °C, refrigerant piping length 7.5 m (no height difference).

*2 Cooling performance measurement conditions: outside air temperature 35 °C, water supply temperature 12 °C, outlet temperature 7 °C, refrigerant piping length 7.5 m (no height difference).

*3 • The remote controller should be shipped with the hydro unit.


• Use two 1.5-meter wires to connect the hydro unit with the remote controller.

*4 Do not leave the hydro unit at 5 °C or below.

*5 Check the water piping for leakage under the maximum operating pressure.


5-2-2. HWS-805H-E

Unit: mm

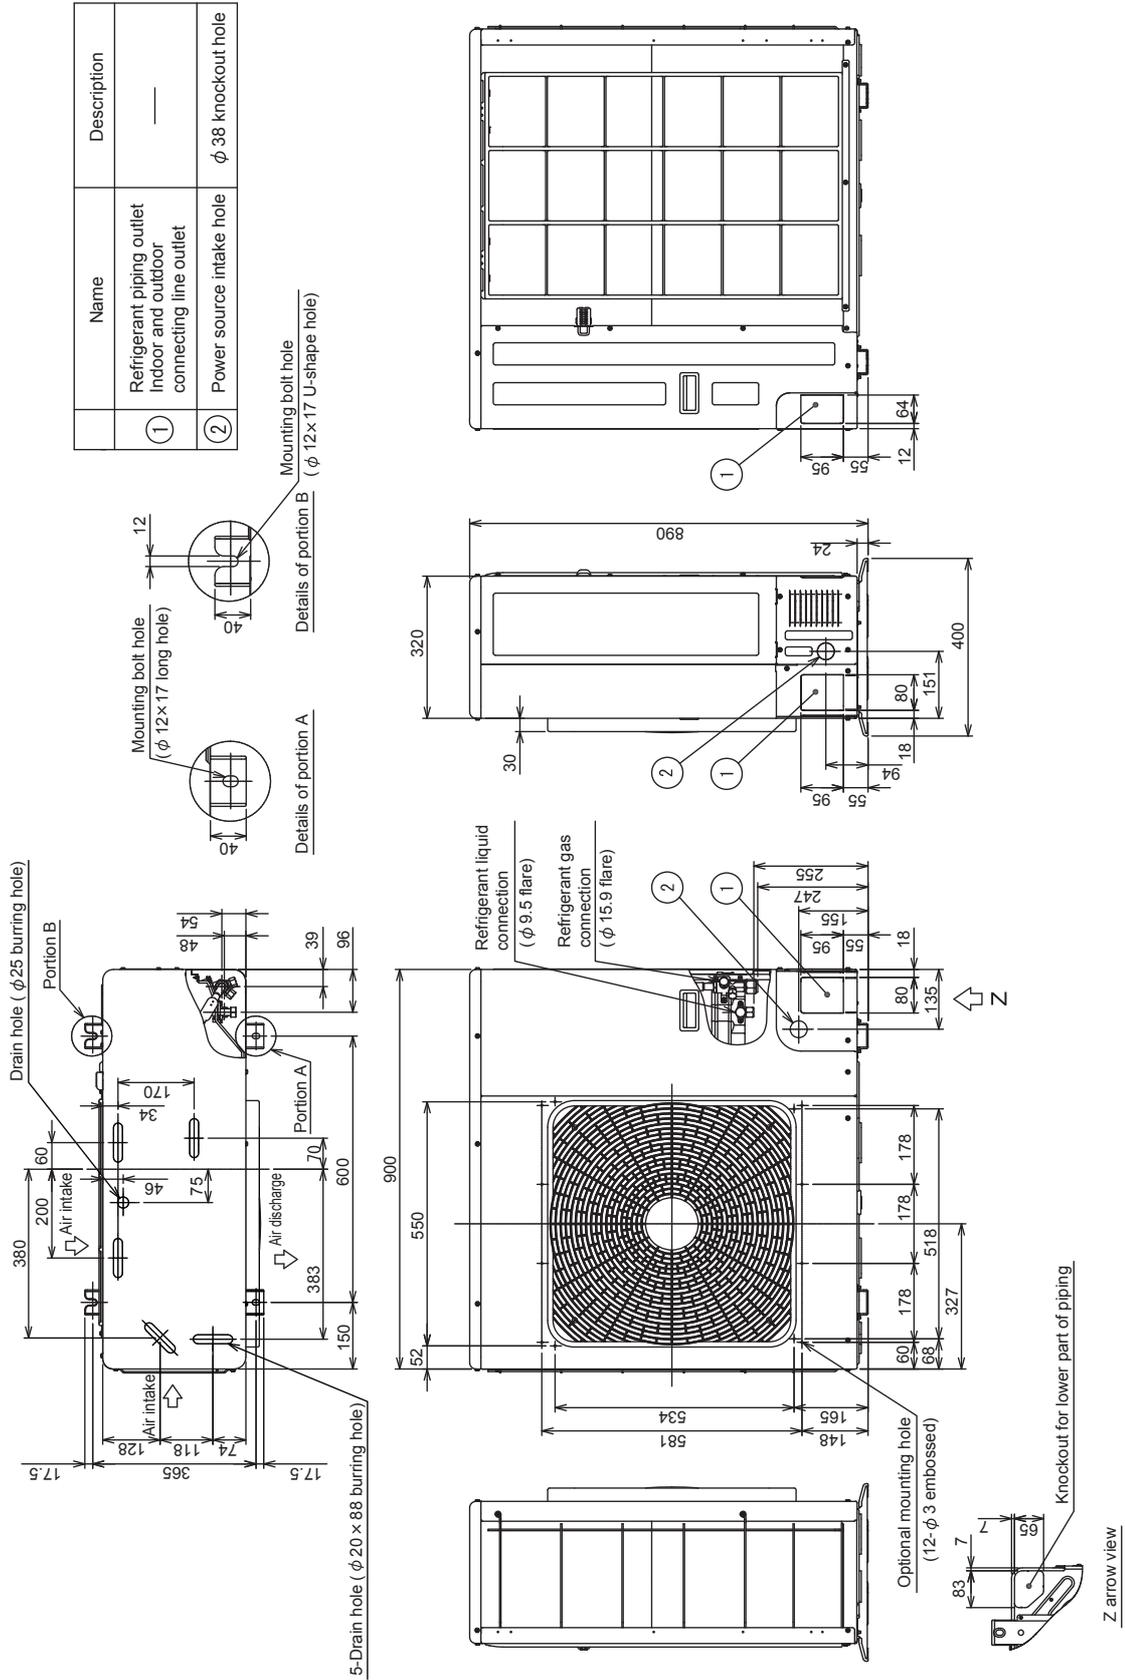


5-2-3. HWS-1105H-E, HWS-1405H-E, HWS-1105H8(R)-E, HWS-1405H8(R)-E, HWS-1605H8(R)-E HWS-P805HR-E, HWS-P1105HR-E

Unit: mm

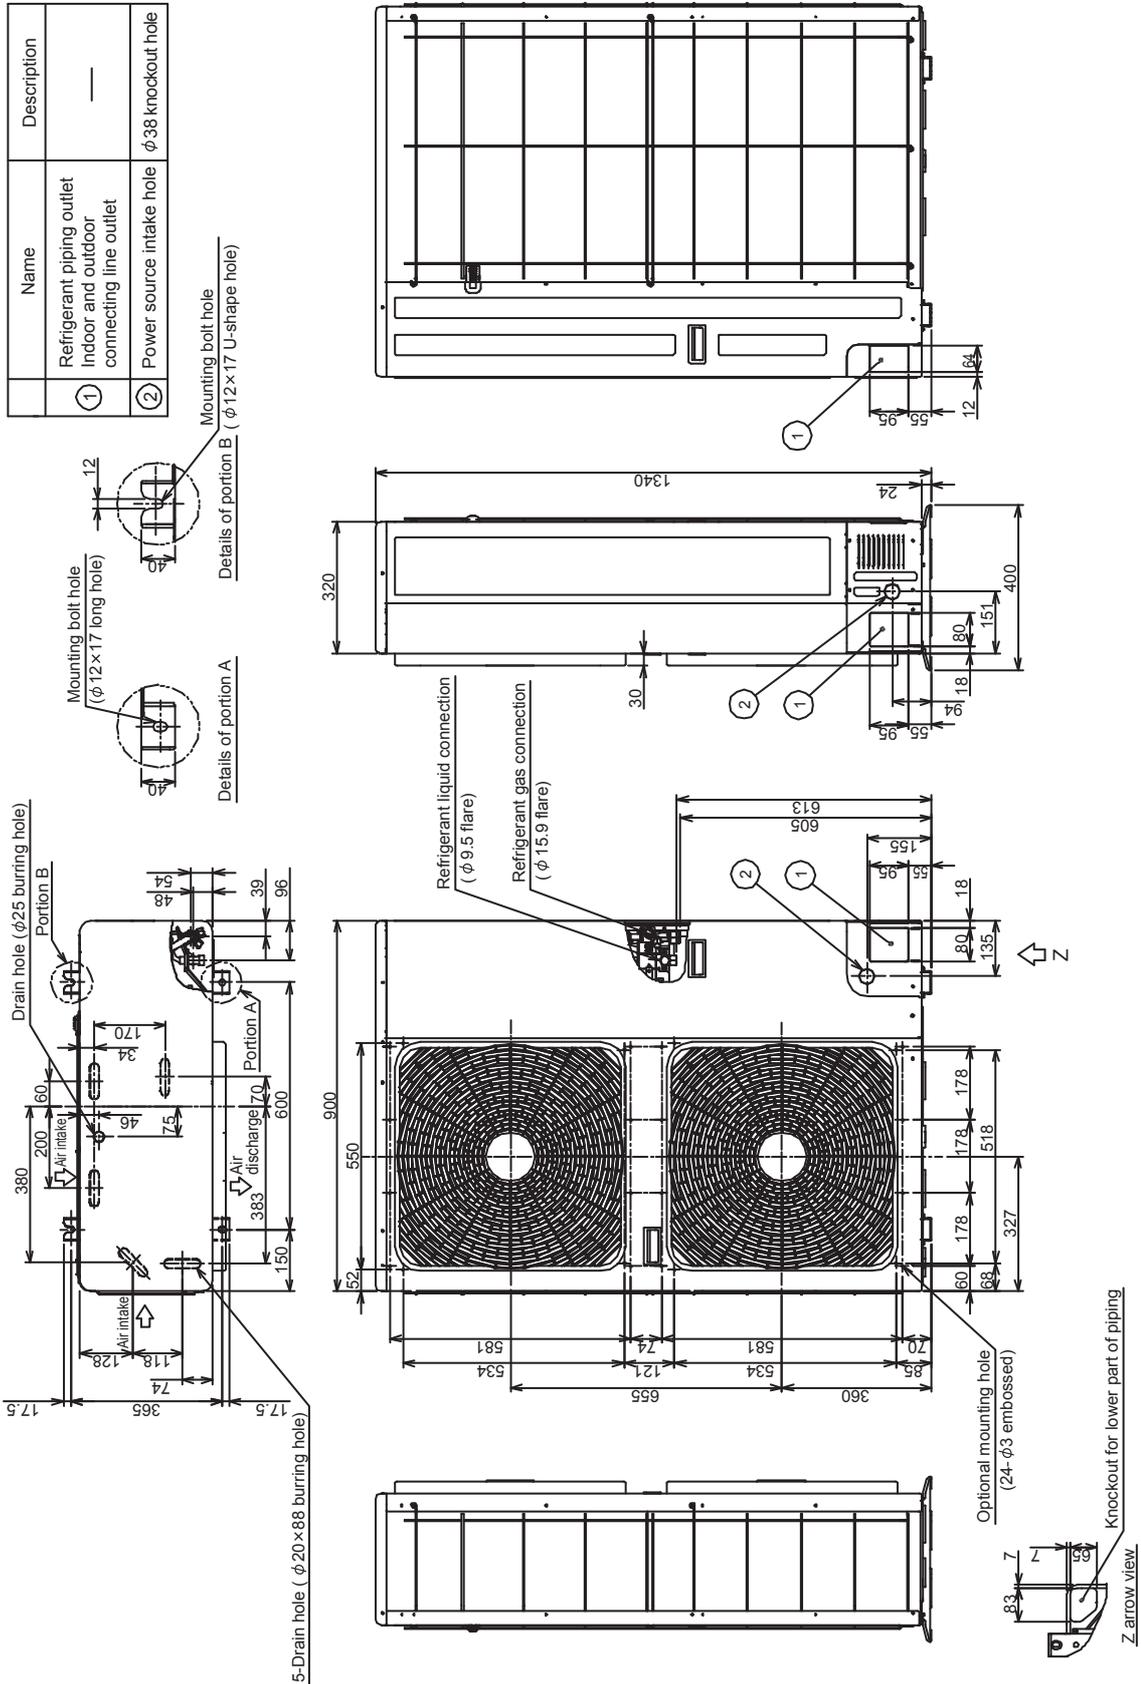


5-3. Piping Diagram


HWS-805XWHM3-E, HWS-805XWHT6-E, HWS-805XWHT9-E / HWS-805H-E

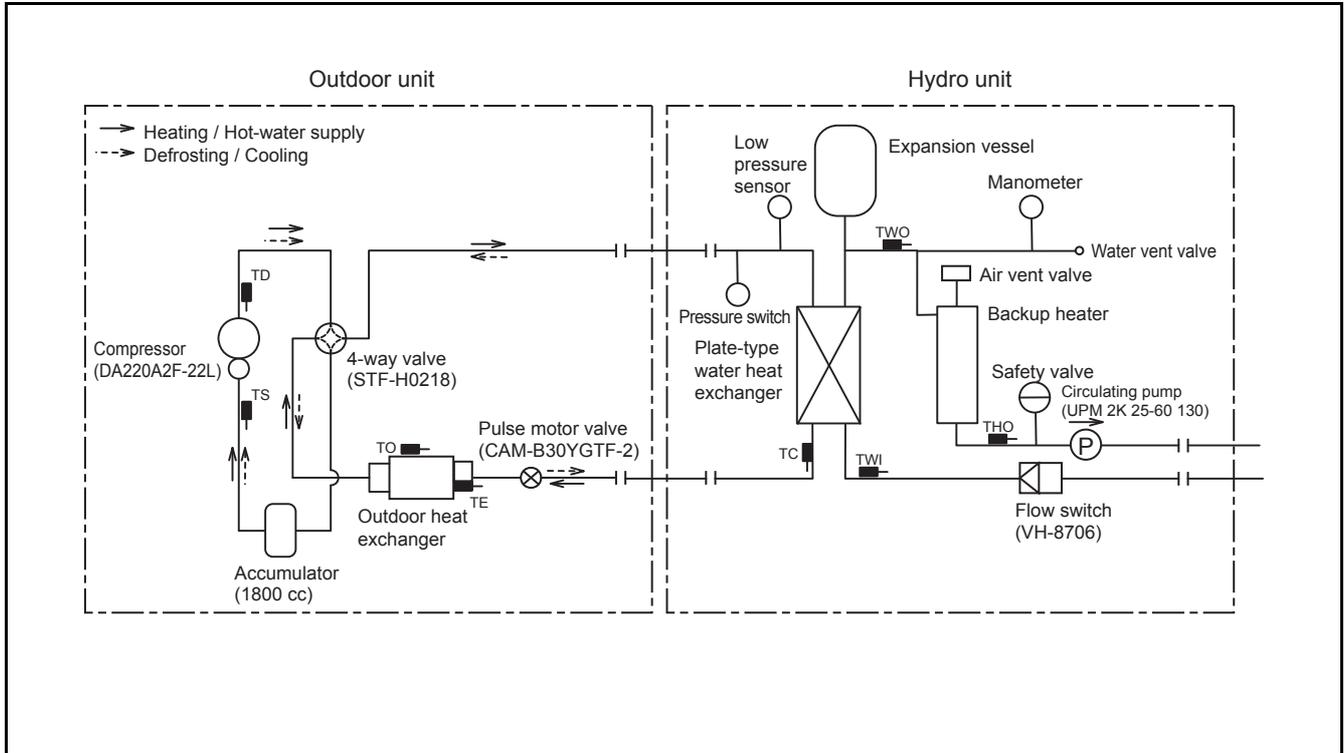

HWS-1405XWHM3-E, HWS-1405XWHT6-E, HWS-1405XWHT9-E / HWS-1105H-E, HWS-1405H-E

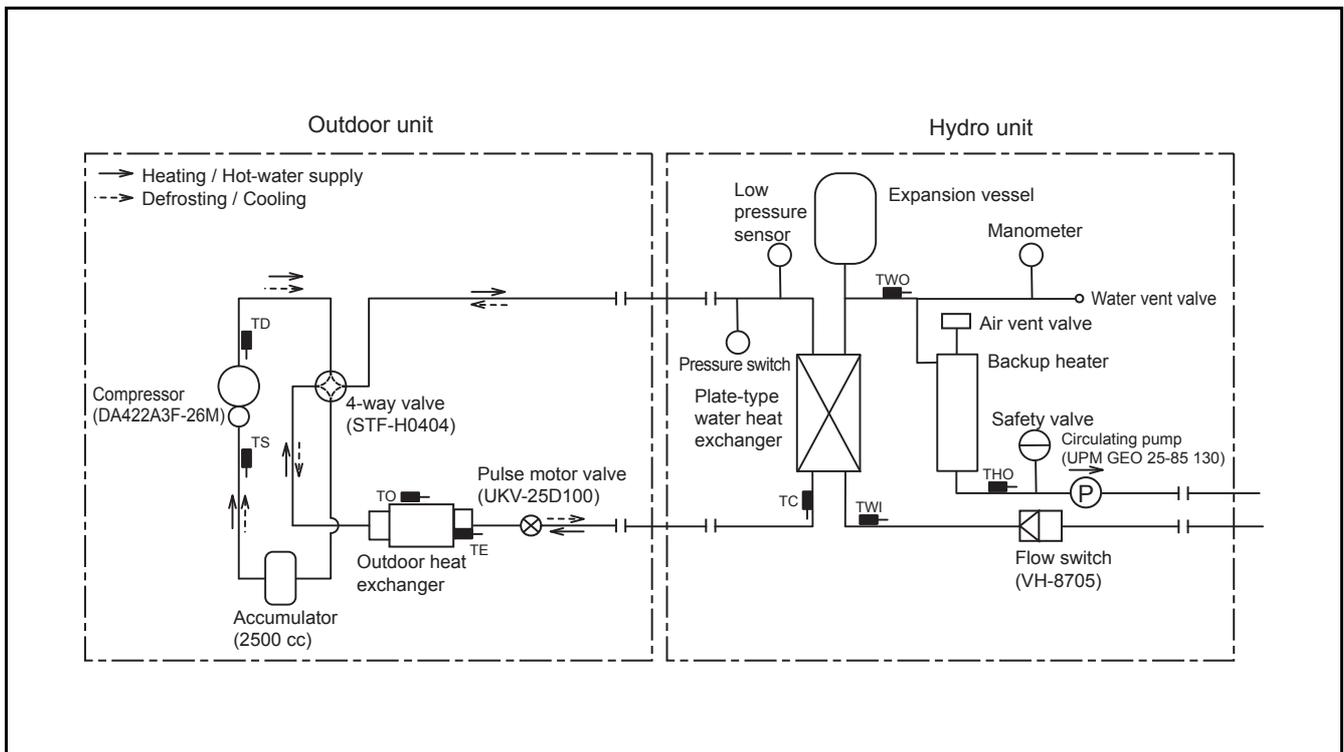


**HWS-P805XWHM3-E, HWS-P805XWHT6-E, HWS-P805XWHT9-E,
HWS-P1105XWHM3-E, HWS-P1105XWHT6-E, HWS-P1105XWHT9-E/
HWS-P805HR-E, HWS-P1105HR-E**

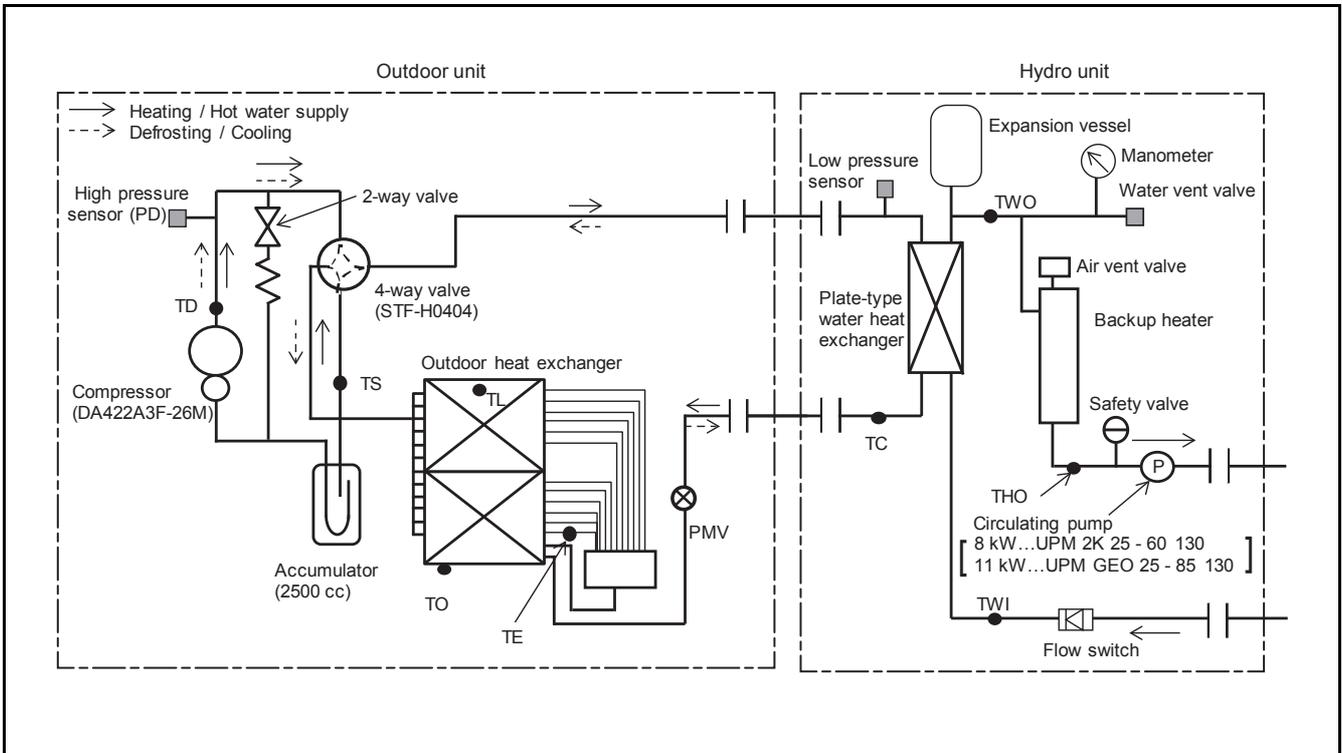

5-4. Wiring Diagram

5-4-1. Outdoor Unit (Single phase type)


▼HWS-455H-E

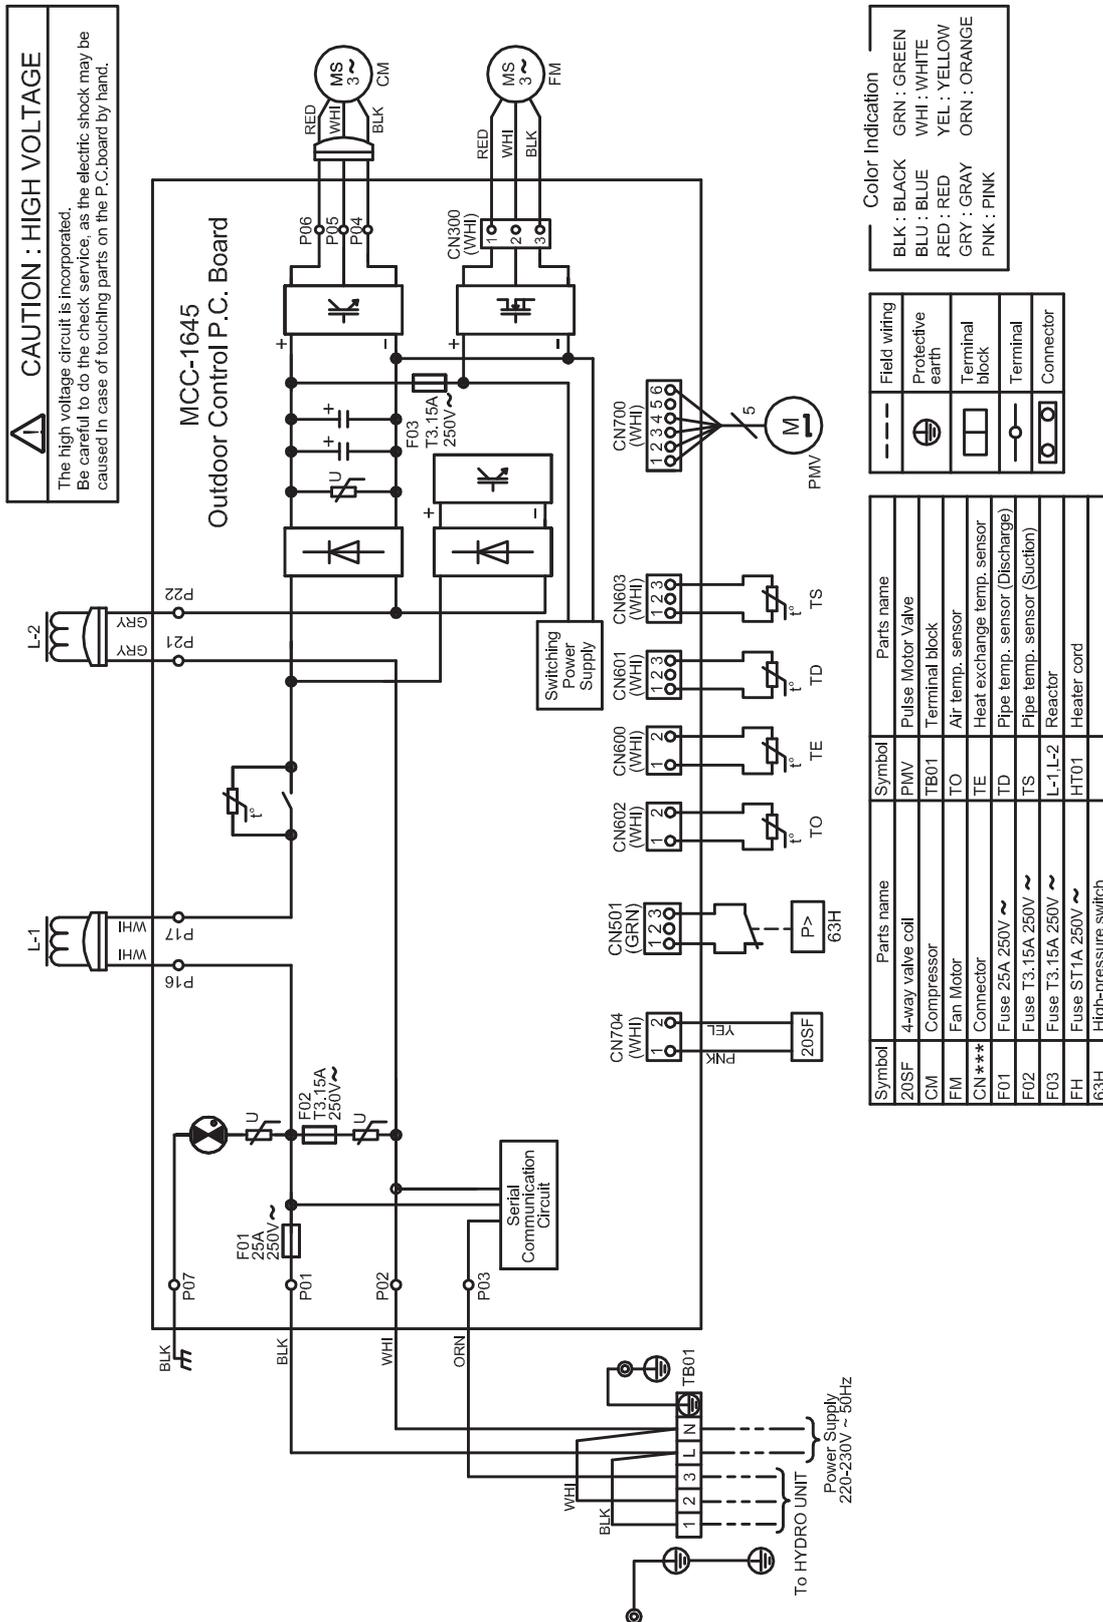


▼HWS-805H-E, HWS-1105H-E, HWS-1405H-E

Symbol	Item name
CM	Compressor
FM	Fan motor
PMV	Pulse motor valve coil
TD	Discharge temperature sensor
TS	Suction temperature sensor
TE	Heat exchange sensor 1
TL	Heat exchange sensor 2
T0	Outdoor temperature sensor
4F	Linefilter
20SF	4-way valve coil
49C	Compressor case thermostat
F01	Fuse 25 A, 250 VAC
F03	Fuse 10 A, 250 VAC

1. © indicates a terminal plate. The number inside indicates the terminal number.
2. The double-dashed line indicates a local wiring while the dashed line indicates an optional accessory or service wiring.
3.  indicates a printed board.
4. For the hydro unit circuit, see the hydro unit wiring diagram.

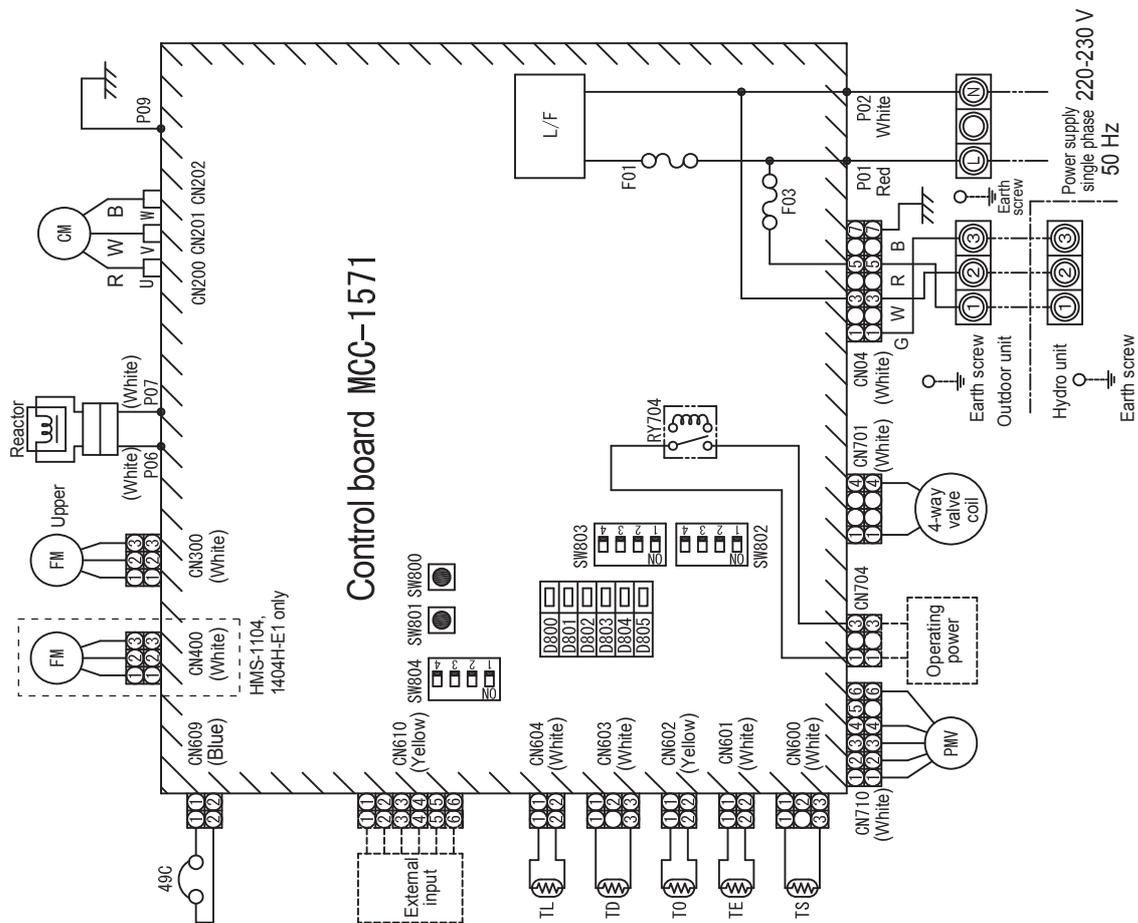

▼HWS-P805HR-E, HWS-P1105HR-E

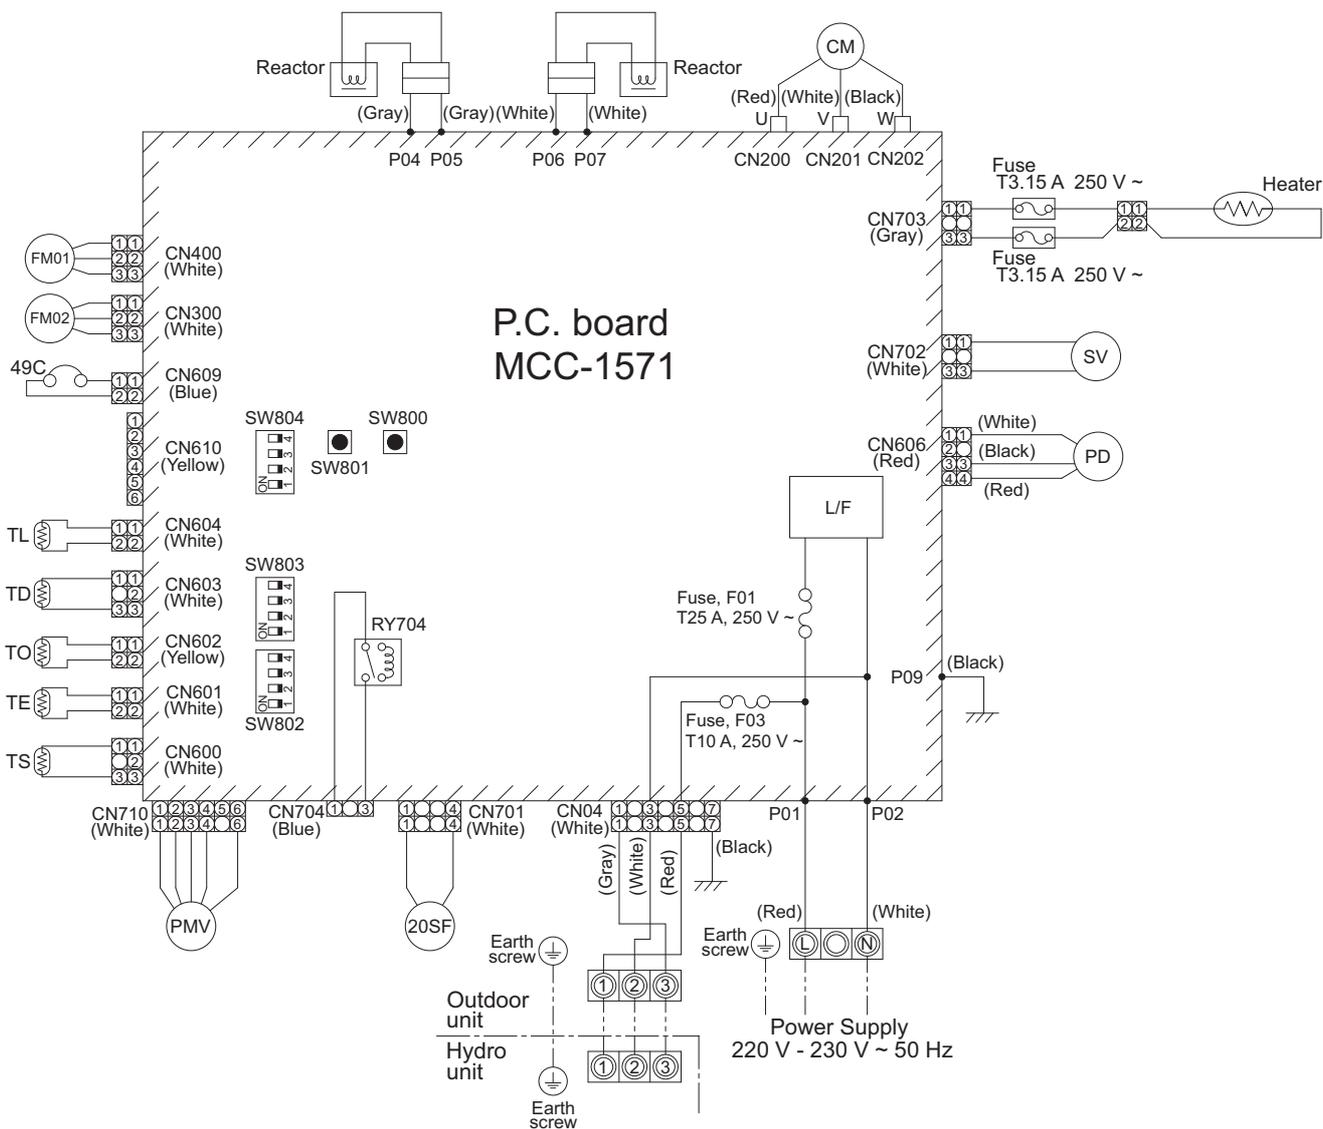


Symbol	Part name
CM	Compressor
FM01	Fan motor
FM02	Fan motor
PMV	Pulse motor valve
TD	Pipe temperature sensor(Discharge)
TS	Pipe temperature sensor(Suction)
TE	Heat exchanger sensor 1
TL	Heat exchanger sensor 2
TO	Outside temperature sensor
20SF	4-way valve coil
SV	2-way valve coil
PD	Pressure sensor
49C	Compressor case thermostat
RY	Relay
L/F	Line Filter


1. Ⓞ indicates the terminal block. Alphanumeric characters in the cycle indicate the terminal No.
2. The two-dot chain line indicates the wiring procured locally.
3. ▨ indicates the P.C. board.
4. For the hydro unit circuit, refer to the wiring diagram of the hydro unit.

5-4-2. Outdoor unit (3 phase type)

▼HWS-1105H8(R)-E, -1405H8(R)-E, -1605H8(R)-E

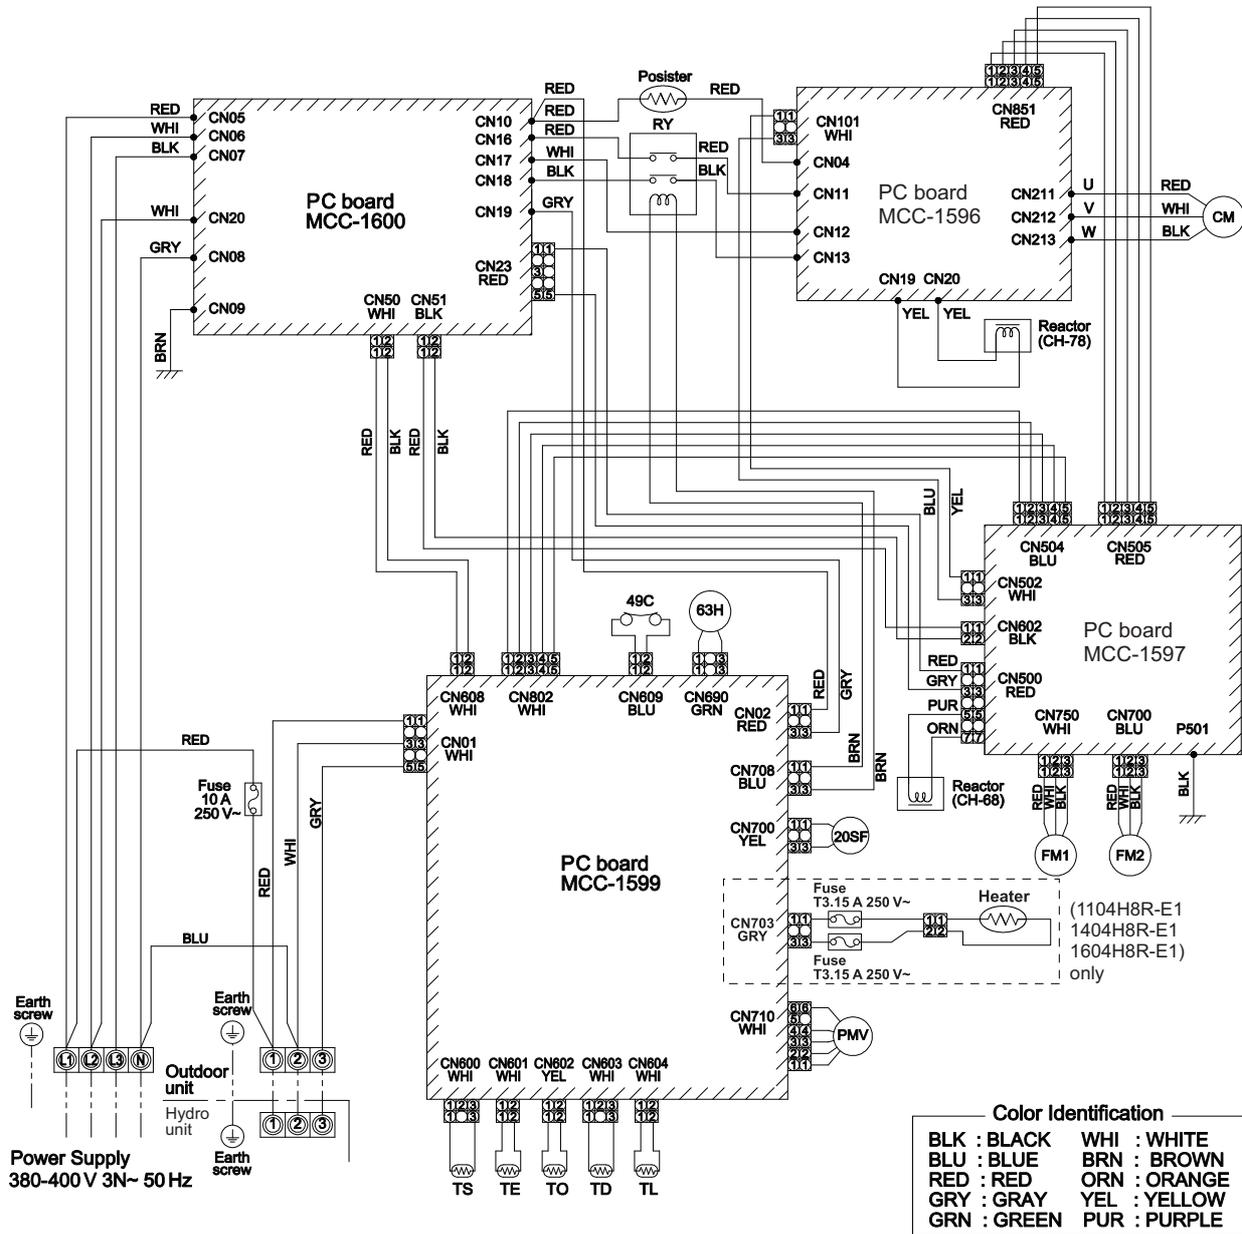


5-4-3. Power line

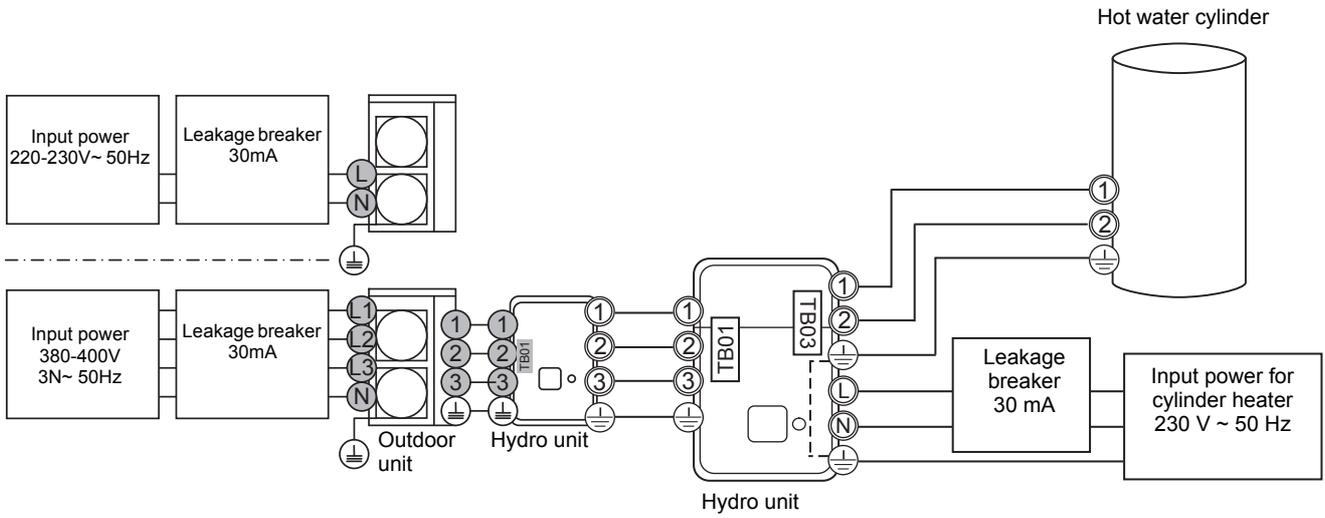


5-4-4. Wiring between Hydro Unit and Outdoor Unit


- ▼ HWS-455H-E, HWS-805H-E, HWS-1105H-E, HWS-1405H-E
HWS-P805HR-E, HWS-P1105HR-E

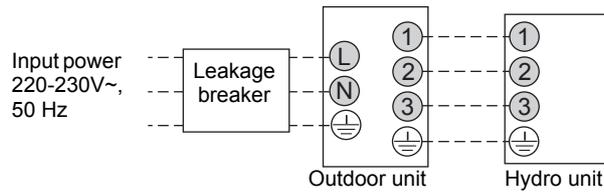


- ▼ HWS-1105H8-E, H8R-E
HWS-1405H8-E, H8R-E
HWS-1605H8-E, H8R-E

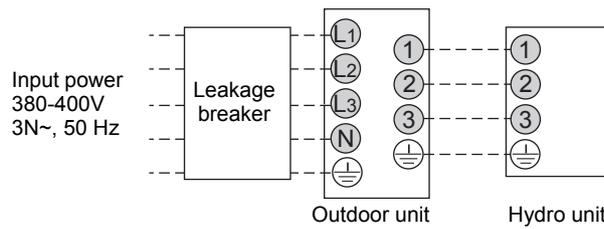


▼ HWS-805H-E, HWS-1105H-E, HWS-1405H-E
HWS-P805HR-E, HWS-P1105HR-E

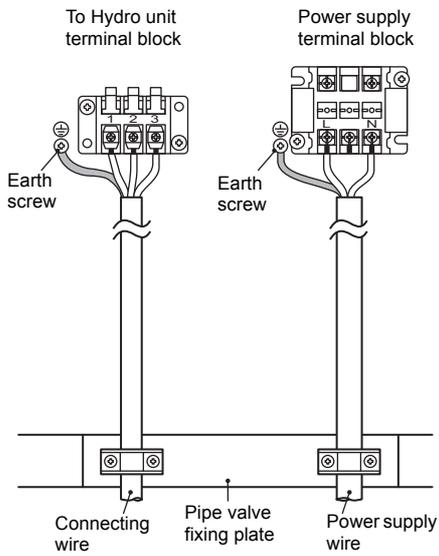


Stripping length power cord and connecting wire

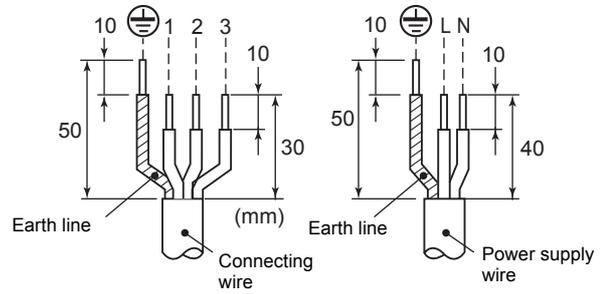

▼ HWS-1105H8-E, H8R-E
HWS-1405H8-E, H8R-E
HWS-1605H8-E, H8R-E

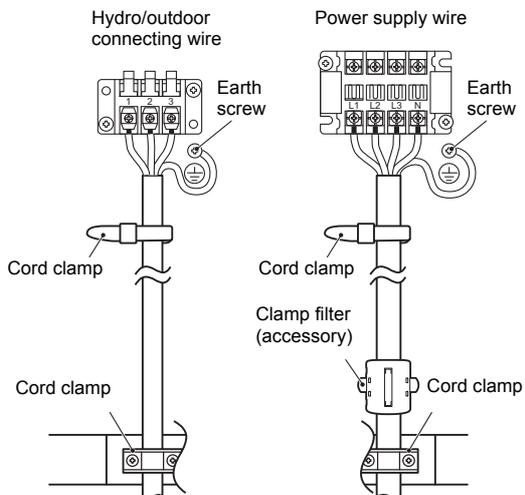


Stripping length power cord and connecting wire

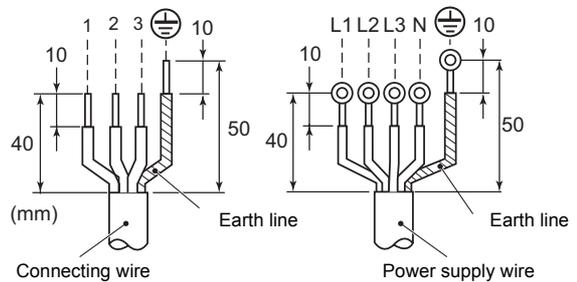


5-5. Sound Data

5-5-1. Sound pressure level measurement

▼HWS-455H-E, HWS-805H-E

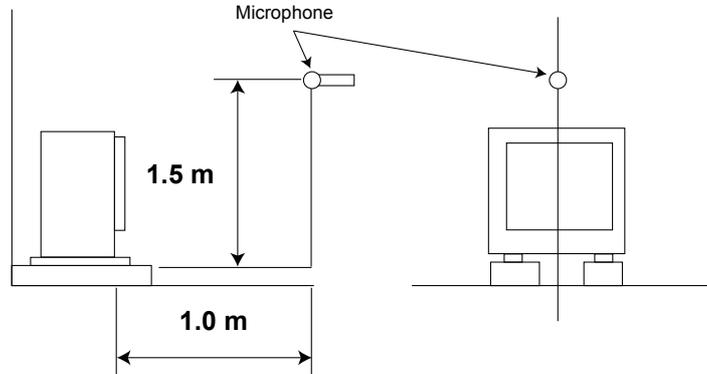


▼HWS-1105H-E, HWS-1405H-E, HWS-1105H8(R)-E, HWS-1405H8(R)-E, HWS-1605H8(R)-E, HWS-P805HR-E, HWS-P1105HR-E

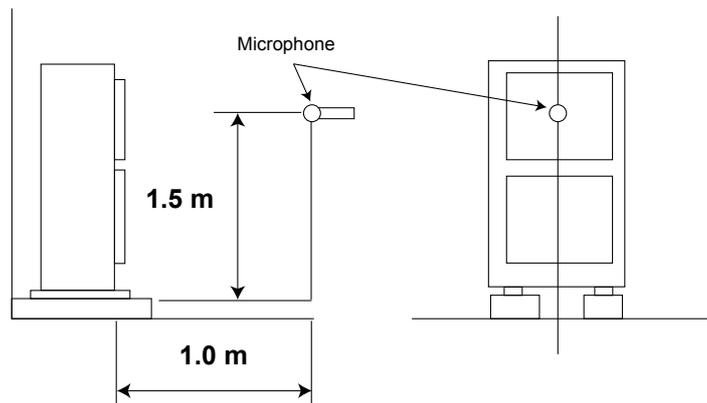


5-5-2. Sound Characteristics (NC Curve)

▼HWS-455H-E


(4.5 kw, 230 V ~ 50Hz)

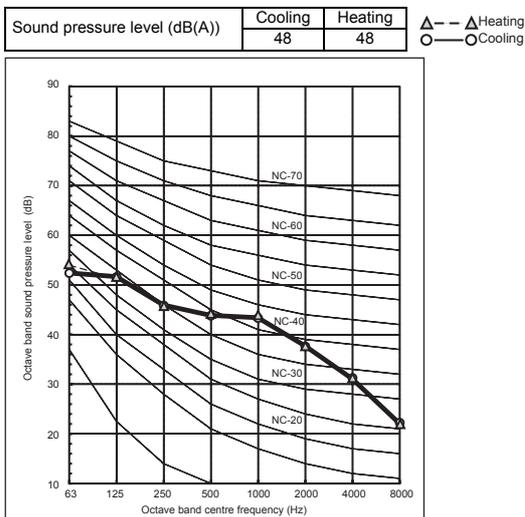


▼HWS-805H-E
(8 kw, 230 V ~ 50Hz)

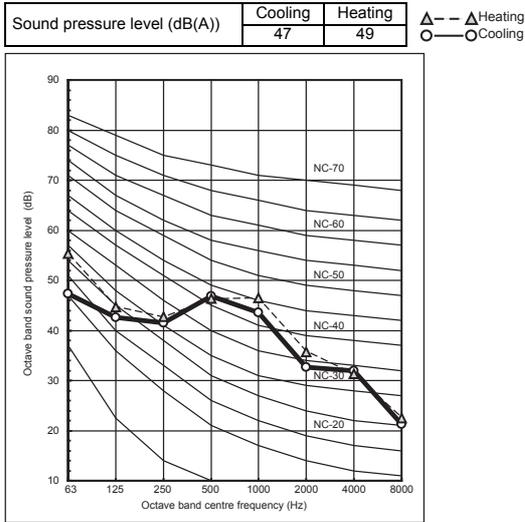


▼HWS-1405H-E, 1405H8(R)-E
(14kw, 380-400V 3N~ 50Hz)

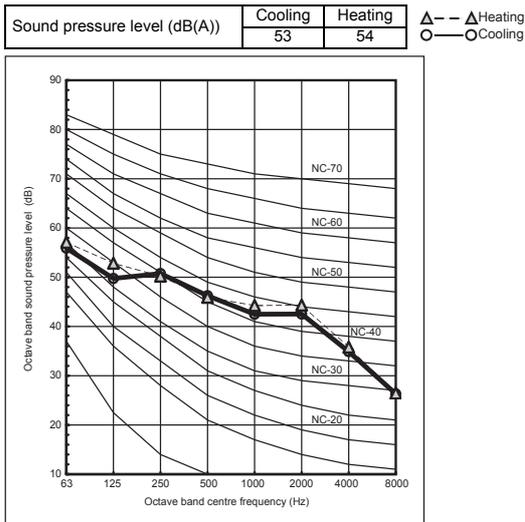


▼HWS-P805HR-E
(8kW, 230V ~50Hz)

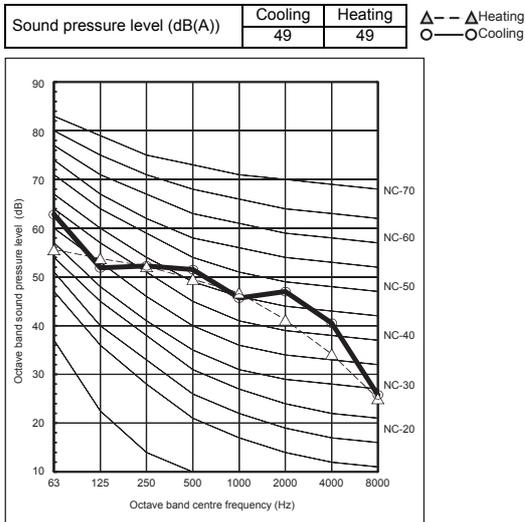


▼HWS-1105H-E, 1105H8(R)-E
(11 kw, 380-400V 3N~ 50Hz)

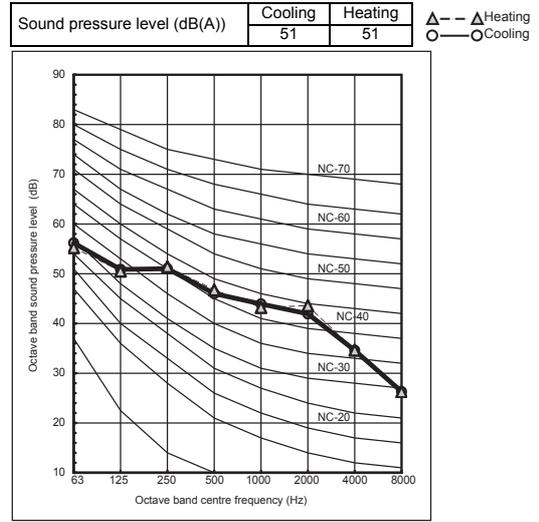

▼HWS-1605H8(R)-E
(16kw, 380-400V 3N~ 50Hz)

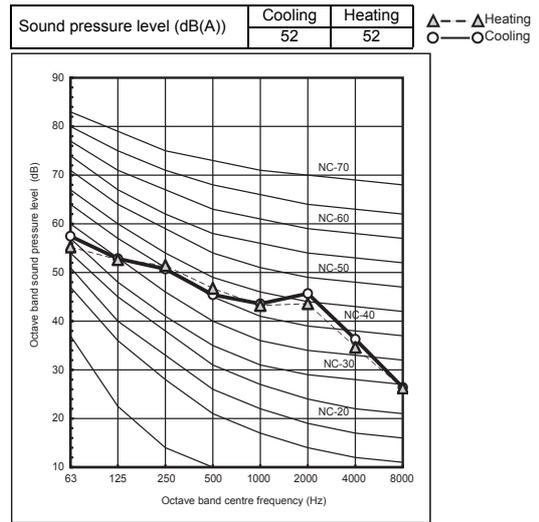

▼HWS-P1105HR-E
(11kW, 230V ~50Hz)

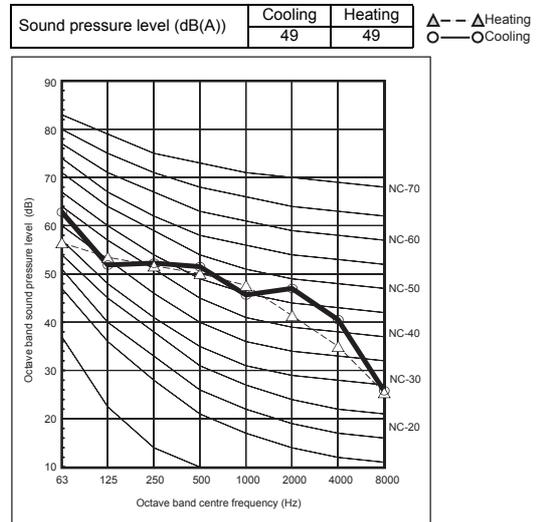


5-6. Operation Range


Standard type

4.5 kW, 8 kW class


Cooling operation

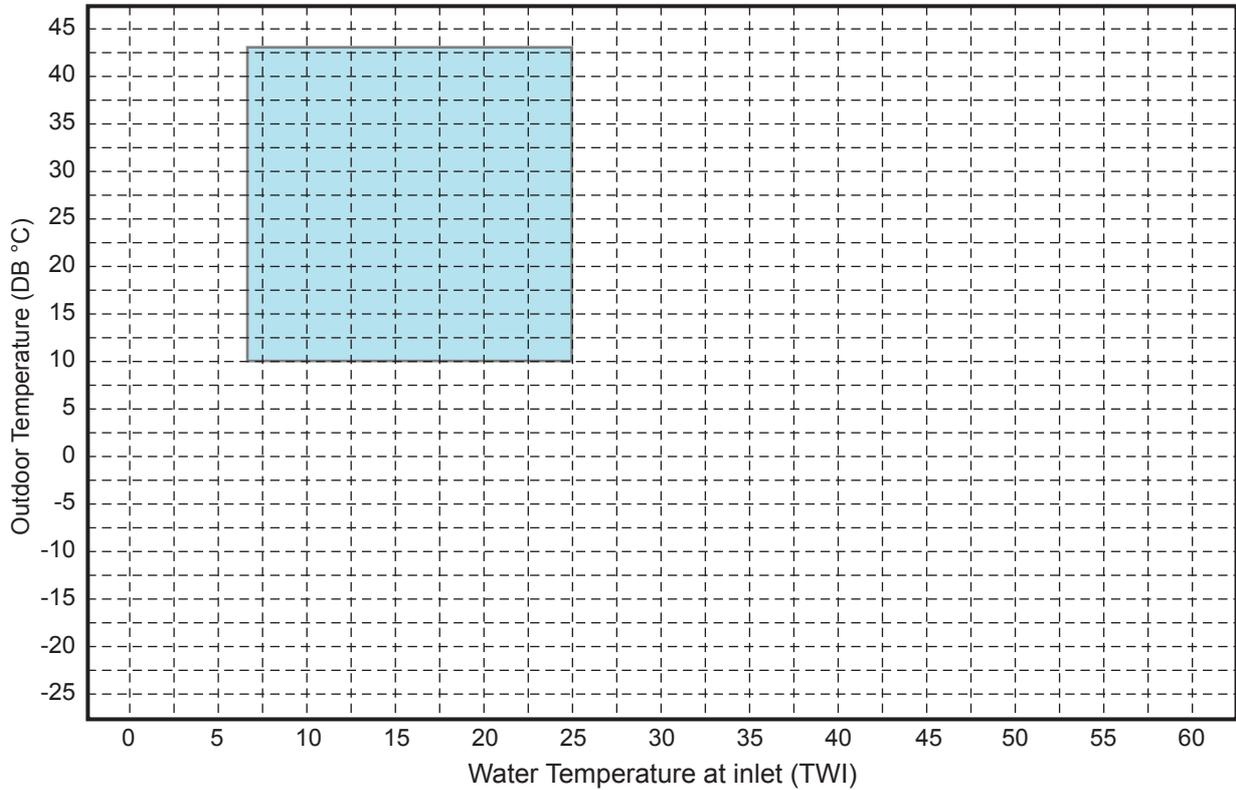


Heating and hot water operation

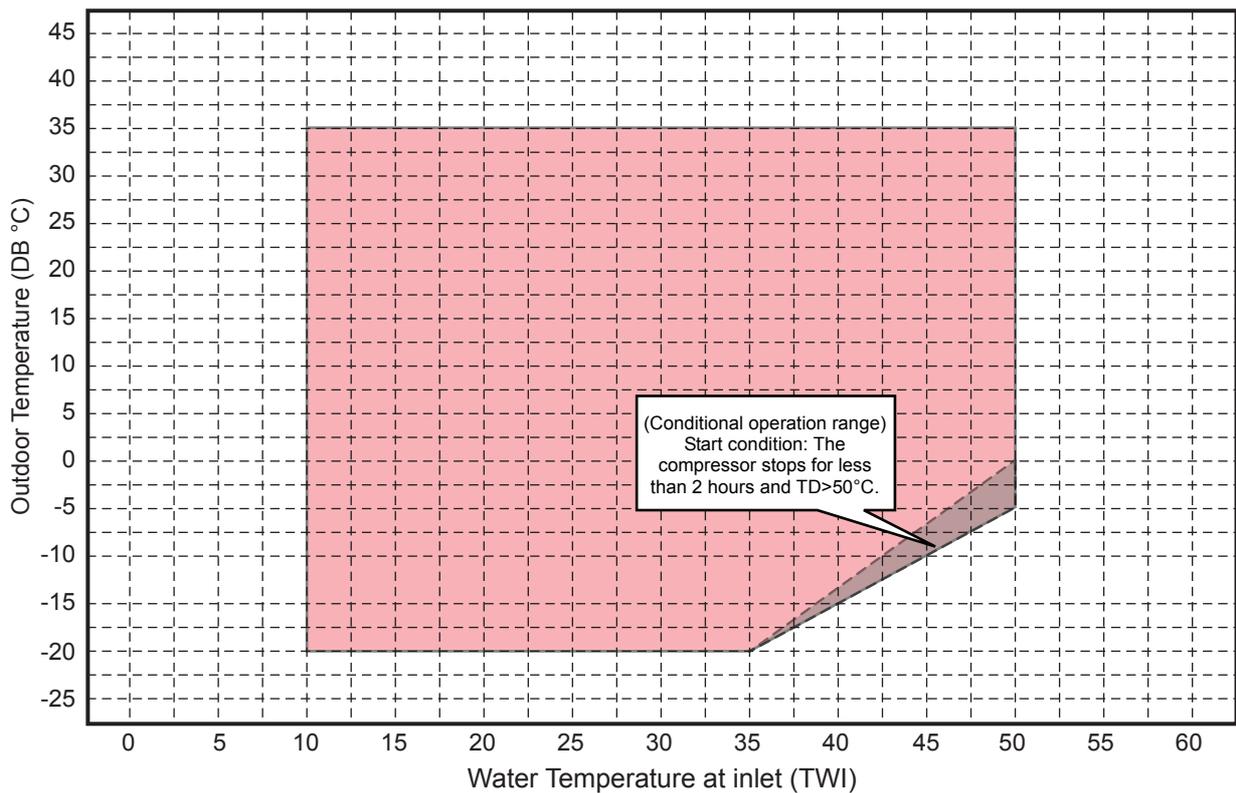

11, 14, 16 kW class
Cooling operation

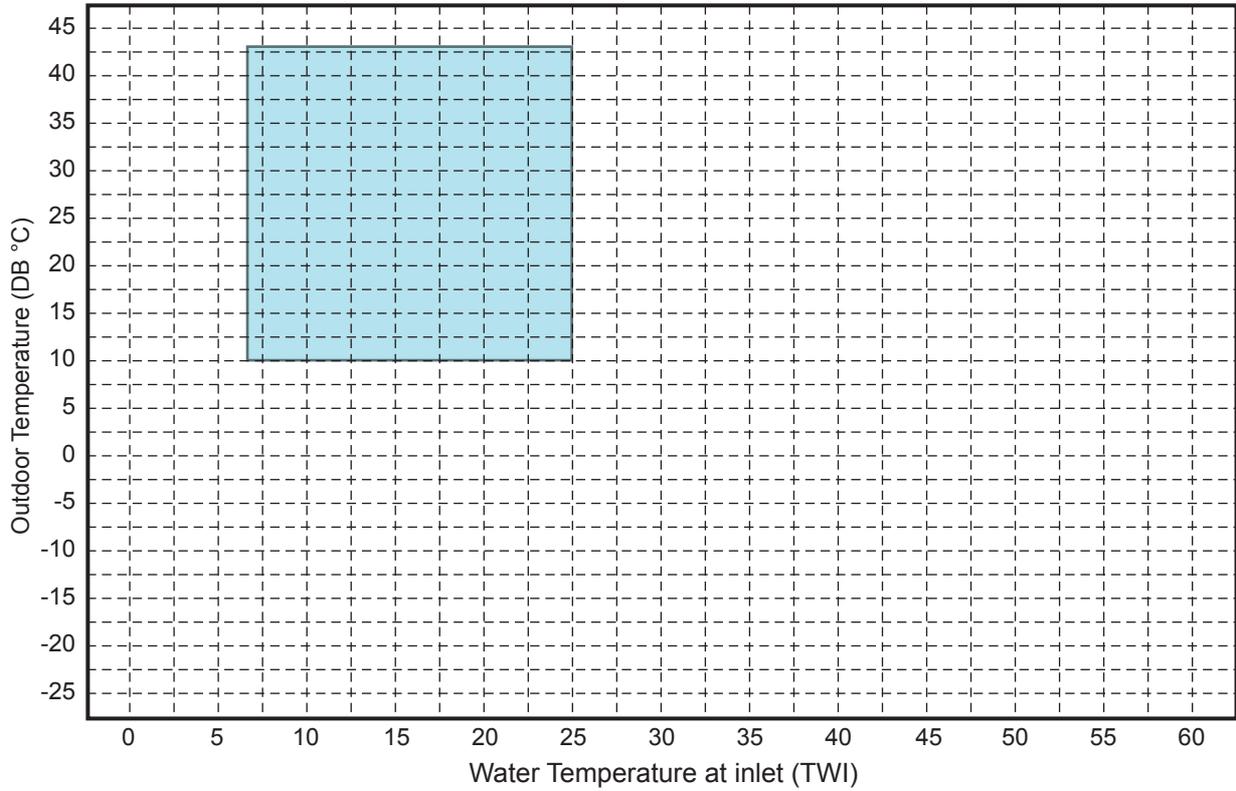


Heating and hot water operation

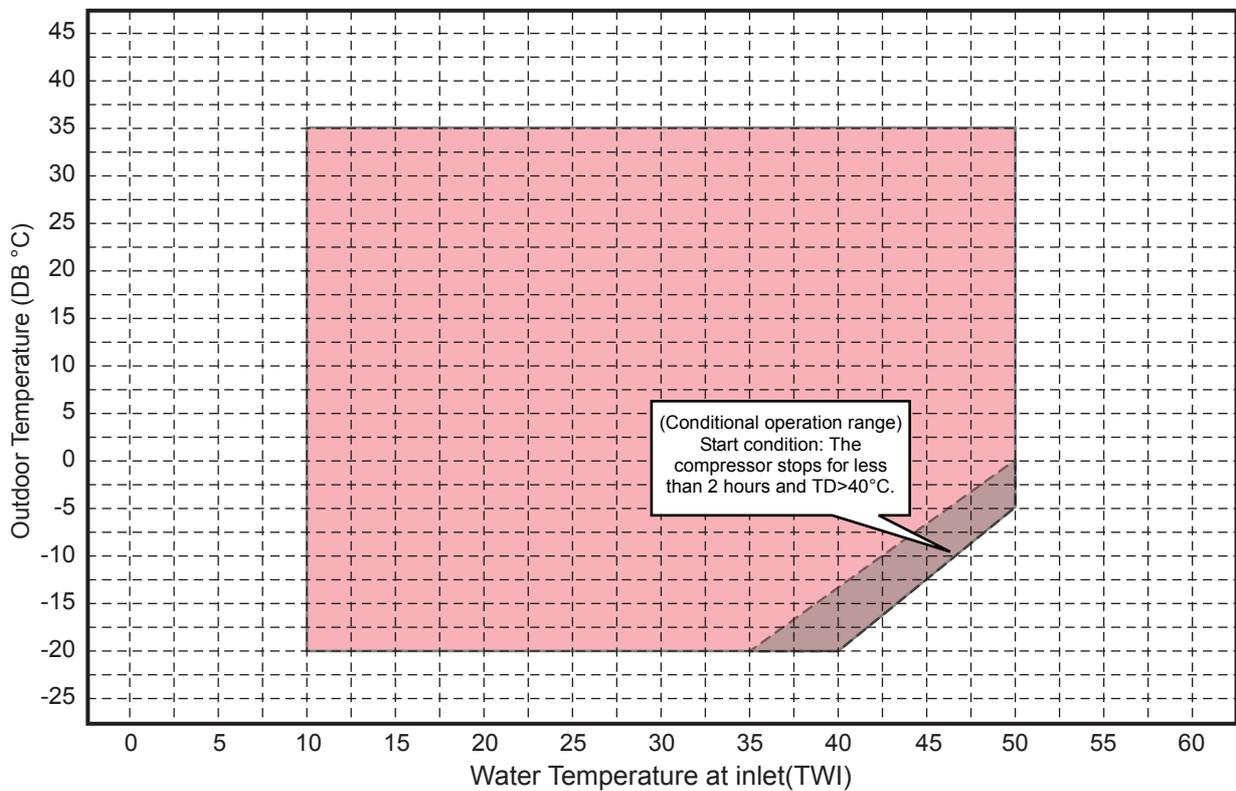

NOTE

Hot water produced only by cylinder heater when both cooling and hot water operation demanded.

**Powerful type
HWS-P805HR-E, HWS-P1105HR-E**

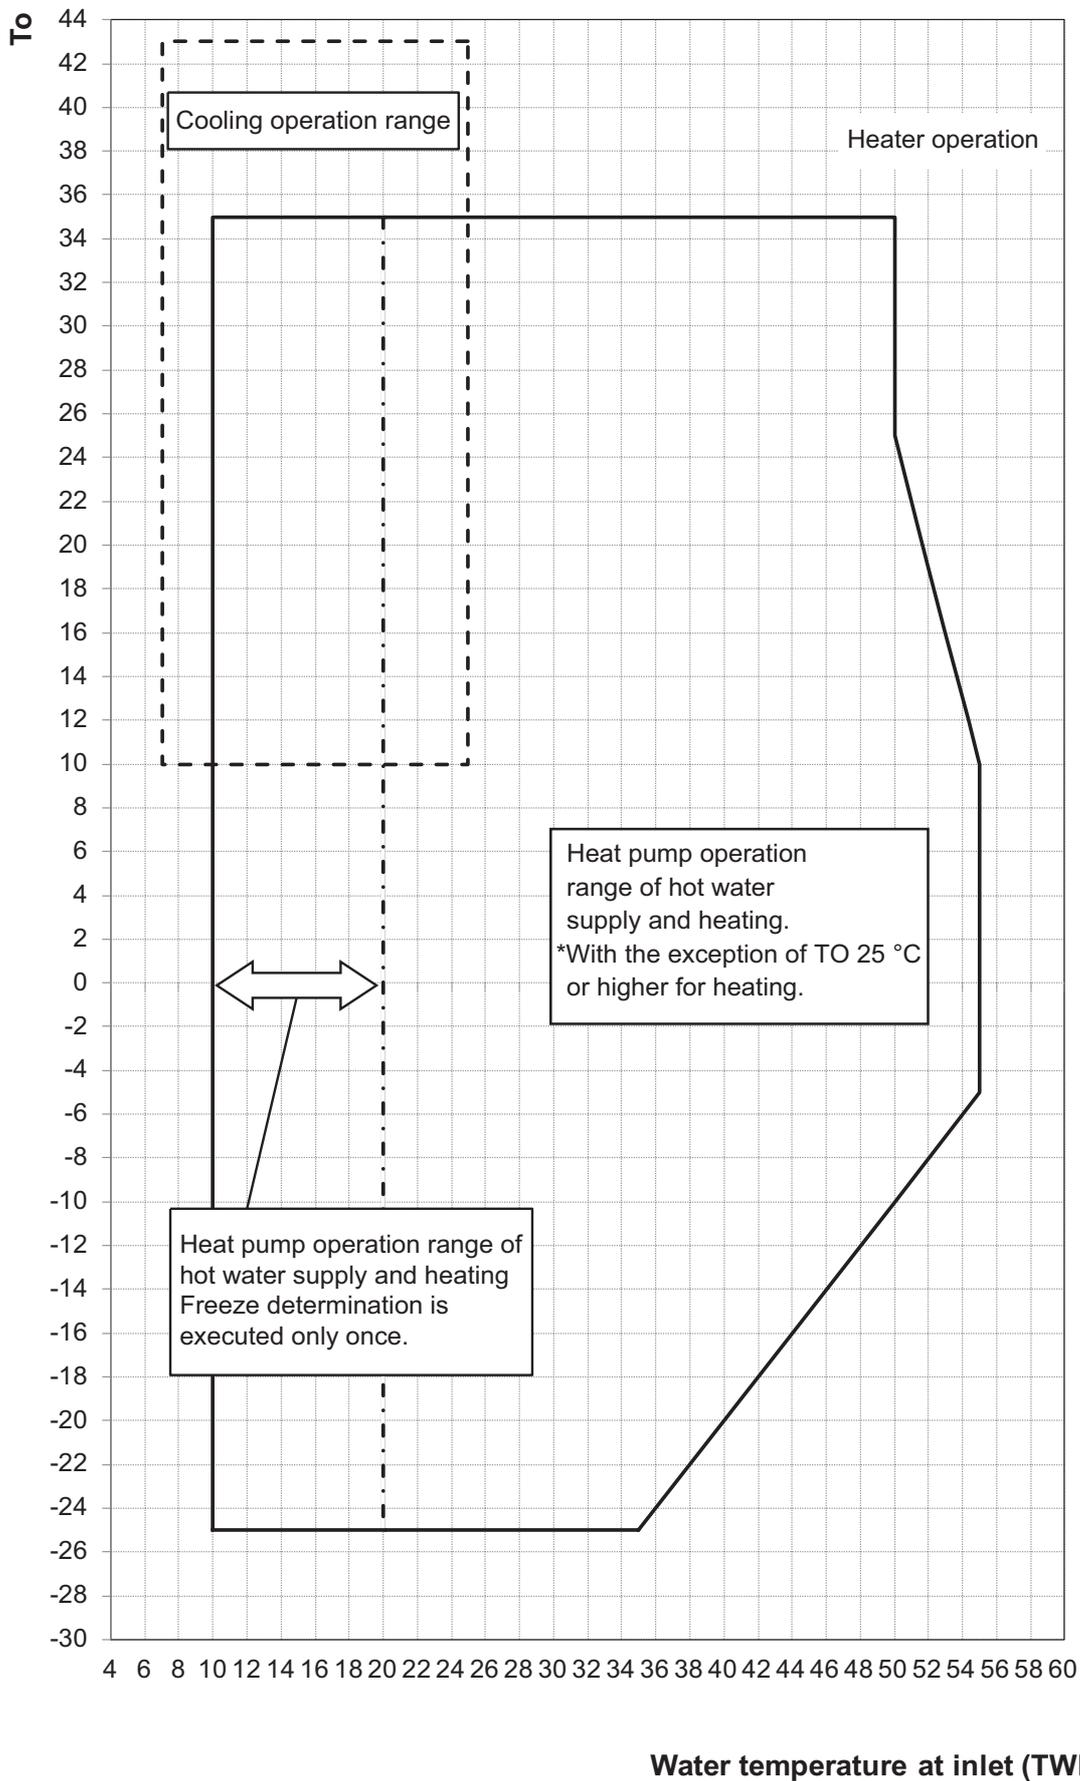

6. HOT WATER CYLINDER



6-1. Specification

Hot water cylinder specifications

Hot water cylinder			HWS-1501 CSHM3-E	HWS-2101 CSHM3-E	HWS-3001 CSHM3-E
Water volume		litres	150	210	300
Appearance	Color		White		
	Material		Plastic coated steel		
Cylinder	Material		Stainless steel		
Insulation	Material		Flame retardant expanded polyurethane foam		
	Thickness	mm	50		
Heat exchanger	Material		Stainless steel tube		
Immersion heater	Type		Single straight, Alloy 825 sheathed		
	Capacity	kW	2.75		
Outer dimension	Height	mm	1,090	1,474	2,040
	Diameter	mm	550		
Unit weight		kg	31	41	59
Packing dimension	Height	mm	1,213	1,781	2,118
	Width	mm	576		
	Depth	mm	640		
Total weight	unit and packing	kg	37	44	59
Maximum water temperature		°C	75		
Maximum water pressure		bar	10		
Water pipe Hydro-cylinder	Inlet	mm	22		
	Outlet	mm	22		
Water pipe Domestic water- cylinder	Inlet	mm	22		
	Outlet	mm	22		
Standard accessories	Expansion Vessel	litres	Not included		
			Installation manual		
			Safety group NF7bar		
			Compression nuts and olives		
			Cylinder heater key spanner		

6-2. Dimension


General dimensions and performance

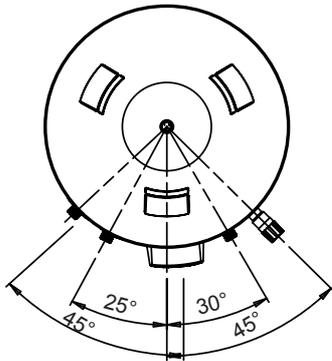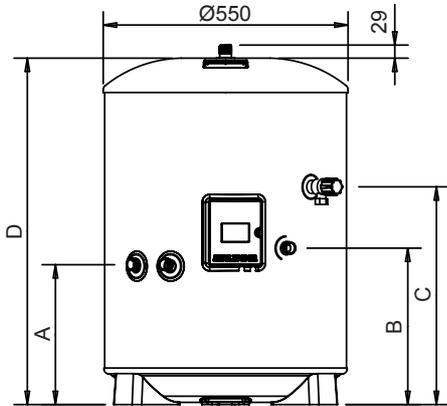


MODEL	HWS-1501CSHM3-E	HWS-2101CSHM3-E	HWS-3001CSHM3-E
NOMINAL CAPACITY (litres)	150	210	300
A (mm)	315	315	315
B (mm)	354	354	354
C (mm)	800	1184	1474
D (mm)	1090	1474	2040
SURFACE AREA (sq.m)	0.65	0.79	0.79
HOT WATER OUTPUT AT 60°C (litres)	102	163	254
MIXED HOT WATER OUTPUT AT 40°C (litres)	243	329.5	476
HEATLOSS (kWh/24h)	1.45	1.91	2.52
HEATING TIME 15°C TO 60°C - USING ELECTRIC CYLINDER HEATER ONLY (mins)	123	188	262
CAPACITY HEATED USING ELECTRIC CYLINDER HEATER ONLY (litres)	102	163	254

6-3. Piping Diagram

▼HWS-1501CSHM3-E, HWS-2101CSHM3-E, HWS-3001CAHM3-E

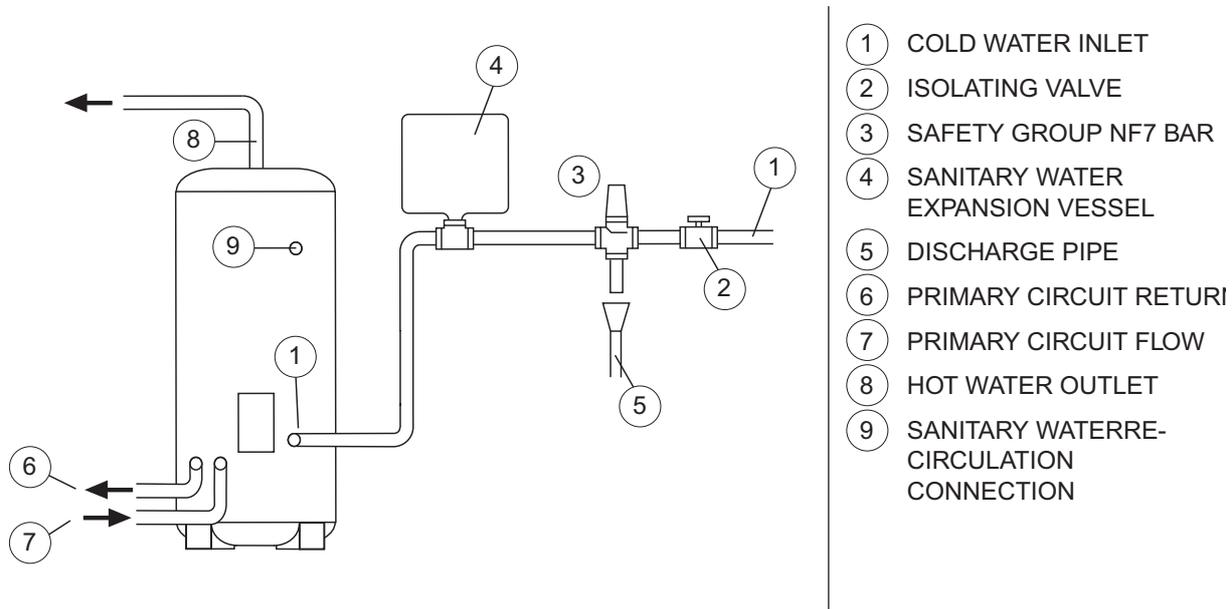


Typical discharge pipe arrangement
(extract from Building Regulation G3 Guidance section 3.9)

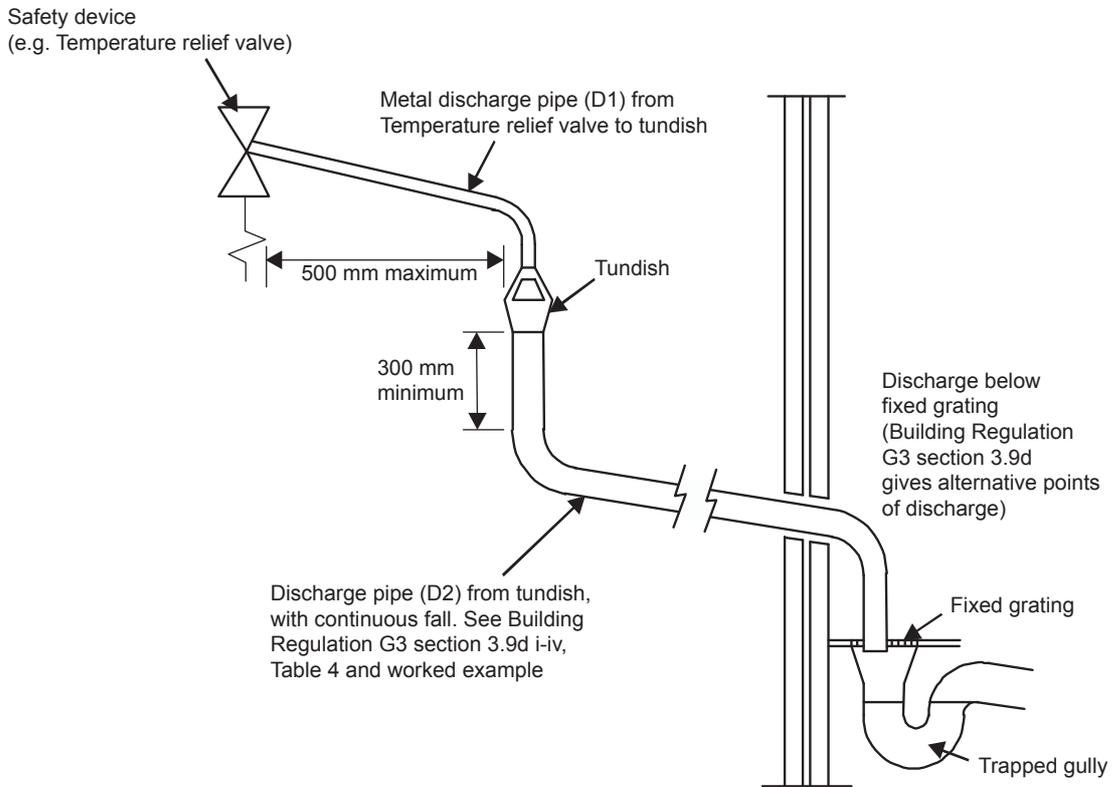


6-4. Wiring Diagram

▼HWS-1501CSHM3-E, HWS-2101CSH3-E, HWS-3001CSHM3-E Electrical Connections (Schematic)

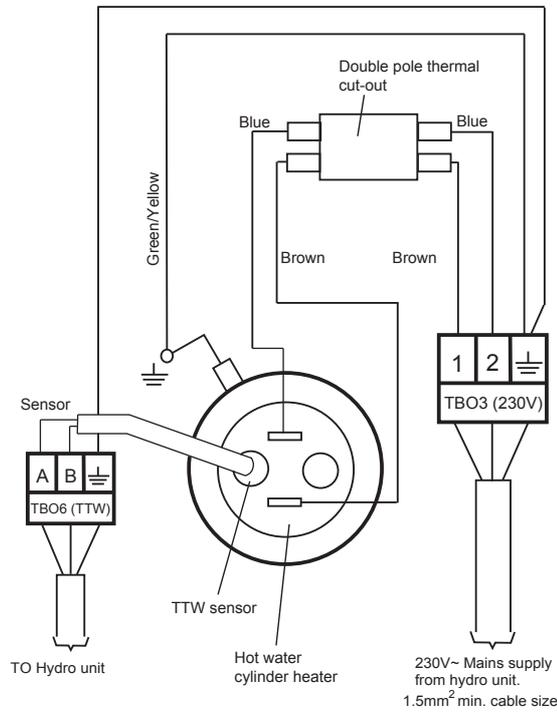

Thermal cut-out

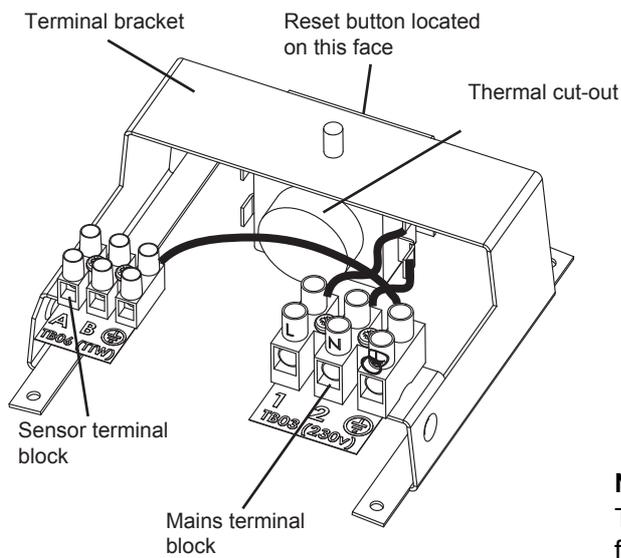

NOTE:
The cover and element assembly have been removed from this view for clarity

Air to Water Heat Pump Engineering Data Book

September 2017 Second edition

Model name:

HWS-455H-E	HWS-1405H8R-E	HWS-455XWHM3-E	HWS-P805XWHM3-E	HWS-1501CSHM3-E
HWS-805H-E	HWS-1605H8-E	HWS-805XWHM3-E	HWS-P805XWHT6-E	HWS-2101CSHM3-E
HWS-1105H-E	HWS-1605H8R-E	HWS-805XWHT6-E	HWS-P805XWHT9-E	HWS-3001CSHM3-E
HWS-1405H-E	HWS-P805HR-E	HWS-805XWHT9-E	HWS-P1105XWHM3-E	
HWS-1105H8-E	HWS-P1105HR-E	HWS-1405XWHM3-E	HWS-P1105XWHT6-E	
HWS-1105H8R-E		HWS-1405XWHT6-E	HWS-P1105XWHT9-E	
HWS-1405H8-E		HWS-1405XWHT9-E		

TOSHIBA CARRIER CORPORATION