013R9505 | AN080286405101en-010402 | ECM 510000023546

5 702420 111513

RA-ADAPTER

ENGINEERING TOMORROW

RA-ADAPTER

ENGINEERING
TOMORROW

014G0251


Danfoss Ally™
Danfoss Eco™

013R9505 | AN080286405101en-010402 | ECM 510000023546

5 702420 111513


How to remove a pre-mounted adapter

1.

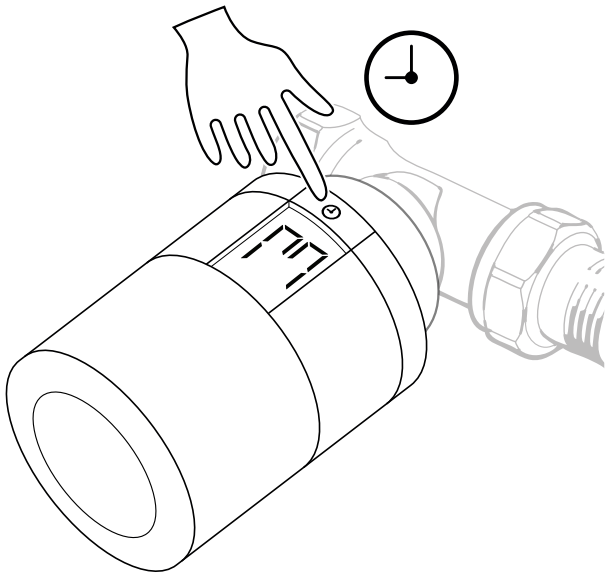


Press and hold ⏲ until large ⋒ flashes. This indicates you are in mounting mode.

2.

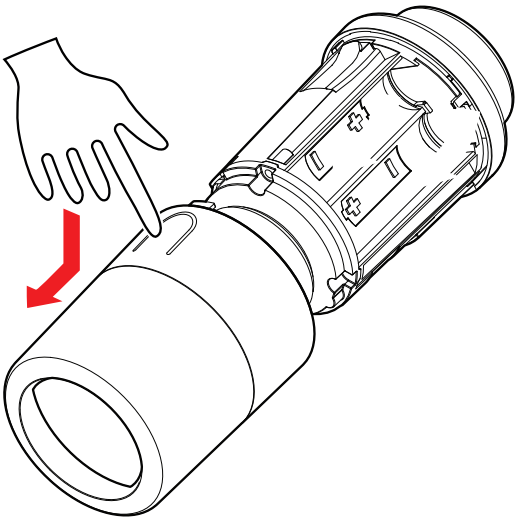

Remove the cover.

3.

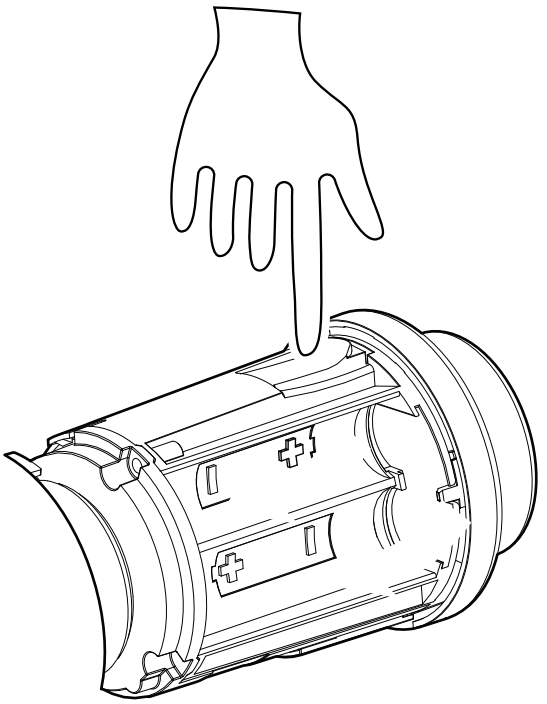

Press firmly on the tab and unscrew the thermostat from the adapter.